

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908563

Luminaire Tested: DFN2DIP-PN3F0-080D070US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908563
REPORT IS A COMBINATION OF REPORTS P901098 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D070US840-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13865.5 lumens
Efficiency: N/A
Efficacy: 103.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLLONL

Luminous Intensity Polar Plot

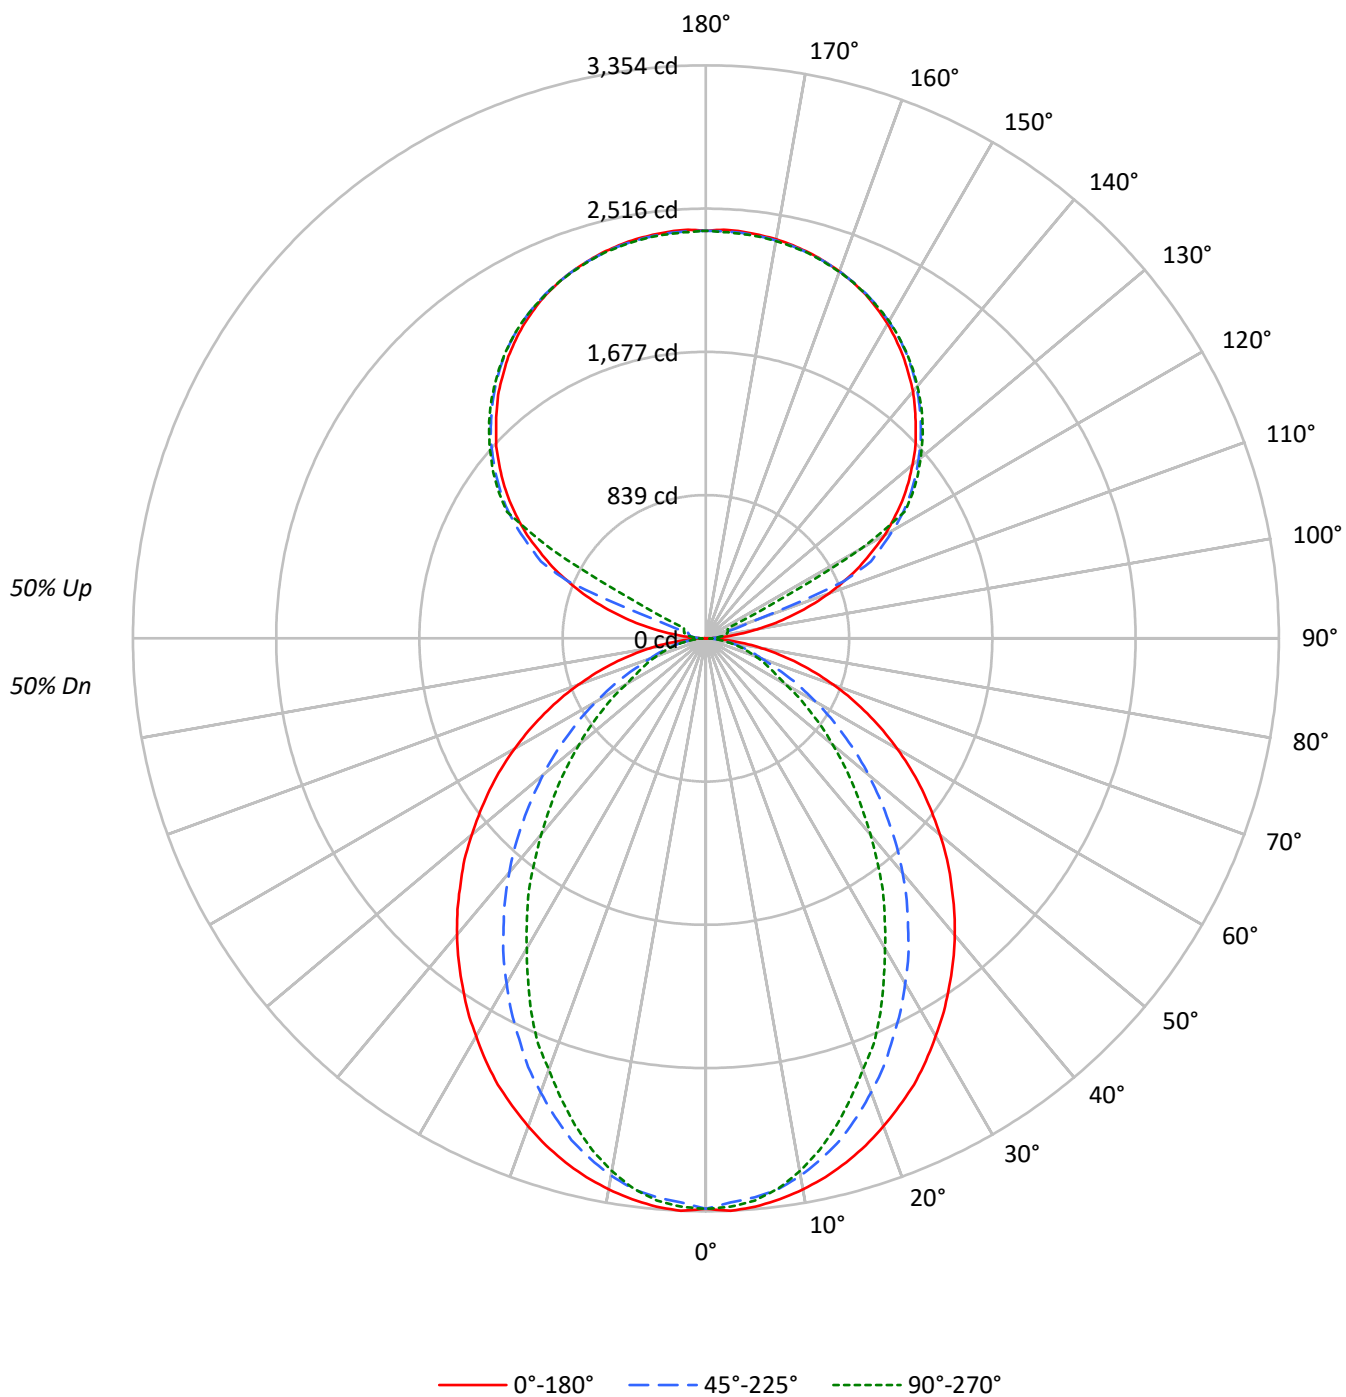

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	90	87	84	81	74	71	69	61	60	58	50	49	48
2	90	83	77	72	83	77	71	67	65	61	58	54	52	49	45	43	41
3	82	73	66	60	76	68	62	57	58	53	49	49	45	42	40	38	36
4	75	65	57	52	69	60	54	48	52	47	42	44	40	37	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	33	30	27
6	64	52	44	39	59	49	42	37	42	37	32	36	32	28	30	27	24
7	59	47	40	34	55	44	37	32	38	33	29	33	28	25	27	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	51	39	32	27	48	37	30	26	32	27	23	28	23	21	23	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3903	3903	3903
5°	3907	3839	3864
10°	3866	3761	3737
15°	3811	3634	3541
20°	3738	3460	3301
25°	3663	3265	3070
30°	3564	3066	2776
35°	3467	2852	2519
40°	3368	2631	2224
45°	3252	2387	1957
50°	3133	2140	1696
55°	3009	1876	1446
60°	2864	1601	1188
65°	2698	1322	1067
70°	2496	1062	964
75°	2242	930	873
80°	1874	771	751
85°	1274	502	555

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3252 cd/sqm

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	2.3
10°-20°	859.1	6.2
20°-30°	1206.1	8.7
30°-40°	1314.7	9.5
40°-50°	1208.4	8.7
50°-60°	949.0	6.8
60°-70°	617.7	4.5
70°-80°	318.0	2.3
80°-90°	85.4	0.6
90°-100°	78.7	0.6
100°-110°	293.3	2.1
110°-120°	777.8	5.6
120°-130°	1290.0	9.3
130°-140°	1370.3	9.9
140°-150°	1273.5	9.2
150°-160°	1023.9	7.4
160°-170°	659.7	4.8
170°-180°	227.1	1.6
0°-30°	2378.1	17.2
0°-40°	3692.9	26.6
0°-60°	5850.2	42.2
0°-90°	6871.3	49.6
90°-120°	1149.7	8.3
90°-150°	5083.5	36.7
90°-180°	6994.0	50.4
0°-180°	13865.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	2	21	34	43	47	13
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P908563

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.80	12.62	12.77	13.60	14.88	7.76	8.59	8.73	9.57	10.85
	3H	13.47	14.21	14.45	15.19	16.50	8.95	9.69	9.93	10.67	11.97
	4H	14.07	14.77	15.07	15.76	17.07	9.39	10.09	10.38	11.08	12.39
	6H	14.49	15.13	15.49	16.13	17.45	9.71	10.35	10.71	11.35	12.67
	8H	14.61	15.23	15.62	16.24	17.56	9.80	10.41	10.80	11.42	12.74
	12H	14.67	15.25	15.69	16.26	17.60	9.84	10.42	10.85	11.42	12.77
4H	2H	11.81	12.51	12.81	13.50	14.81	8.36	9.05	9.35	10.04	11.36
	3H	13.64	14.22	14.64	15.24	16.56	9.70	10.28	10.71	11.30	12.62
	4H	14.32	14.85	15.34	15.87	17.21	10.24	10.77	11.26	11.78	13.13
	6H	14.83	15.29	15.86	16.32	17.67	10.65	11.11	11.68	12.15	13.49
	8H	15.00	15.43	16.03	16.46	17.82	10.78	11.20	11.81	12.23	13.59
	12H	15.10	15.48	16.14	16.52	17.89	10.84	11.22	11.89	12.27	13.63
8H	4H	14.29	14.72	15.32	15.74	17.10	10.52	10.94	11.54	11.97	13.33
	6H	14.85	15.20	15.90	16.27	17.63	11.03	11.38	12.08	12.45	13.81
	8H	15.06	15.37	16.12	16.43	17.80	11.21	11.52	12.27	12.58	13.95
	12H	15.20	15.47	16.26	16.52	17.94	11.33	11.60	12.39	12.65	14.07
12H	4H	14.24	14.62	15.29	15.67	17.03	10.52	10.91	11.57	11.95	13.31
	6H	14.82	15.13	15.88	16.19	17.56	11.08	11.38	12.13	12.44	13.82
	8H	15.04	15.31	16.10	16.36	17.78	11.28	11.55	12.34	12.60	14.02

END OF REPORT