

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911204

Luminaire Tested: DFN2DIP-PN3F0-050D070US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911204
REPORT IS A COMBINATION OF REPORTS P899571 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D070US850-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12359.9 lumens
Efficiency: N/A
Efficacy: 124.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 99.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFLL

Luminous Intensity Polar Plot

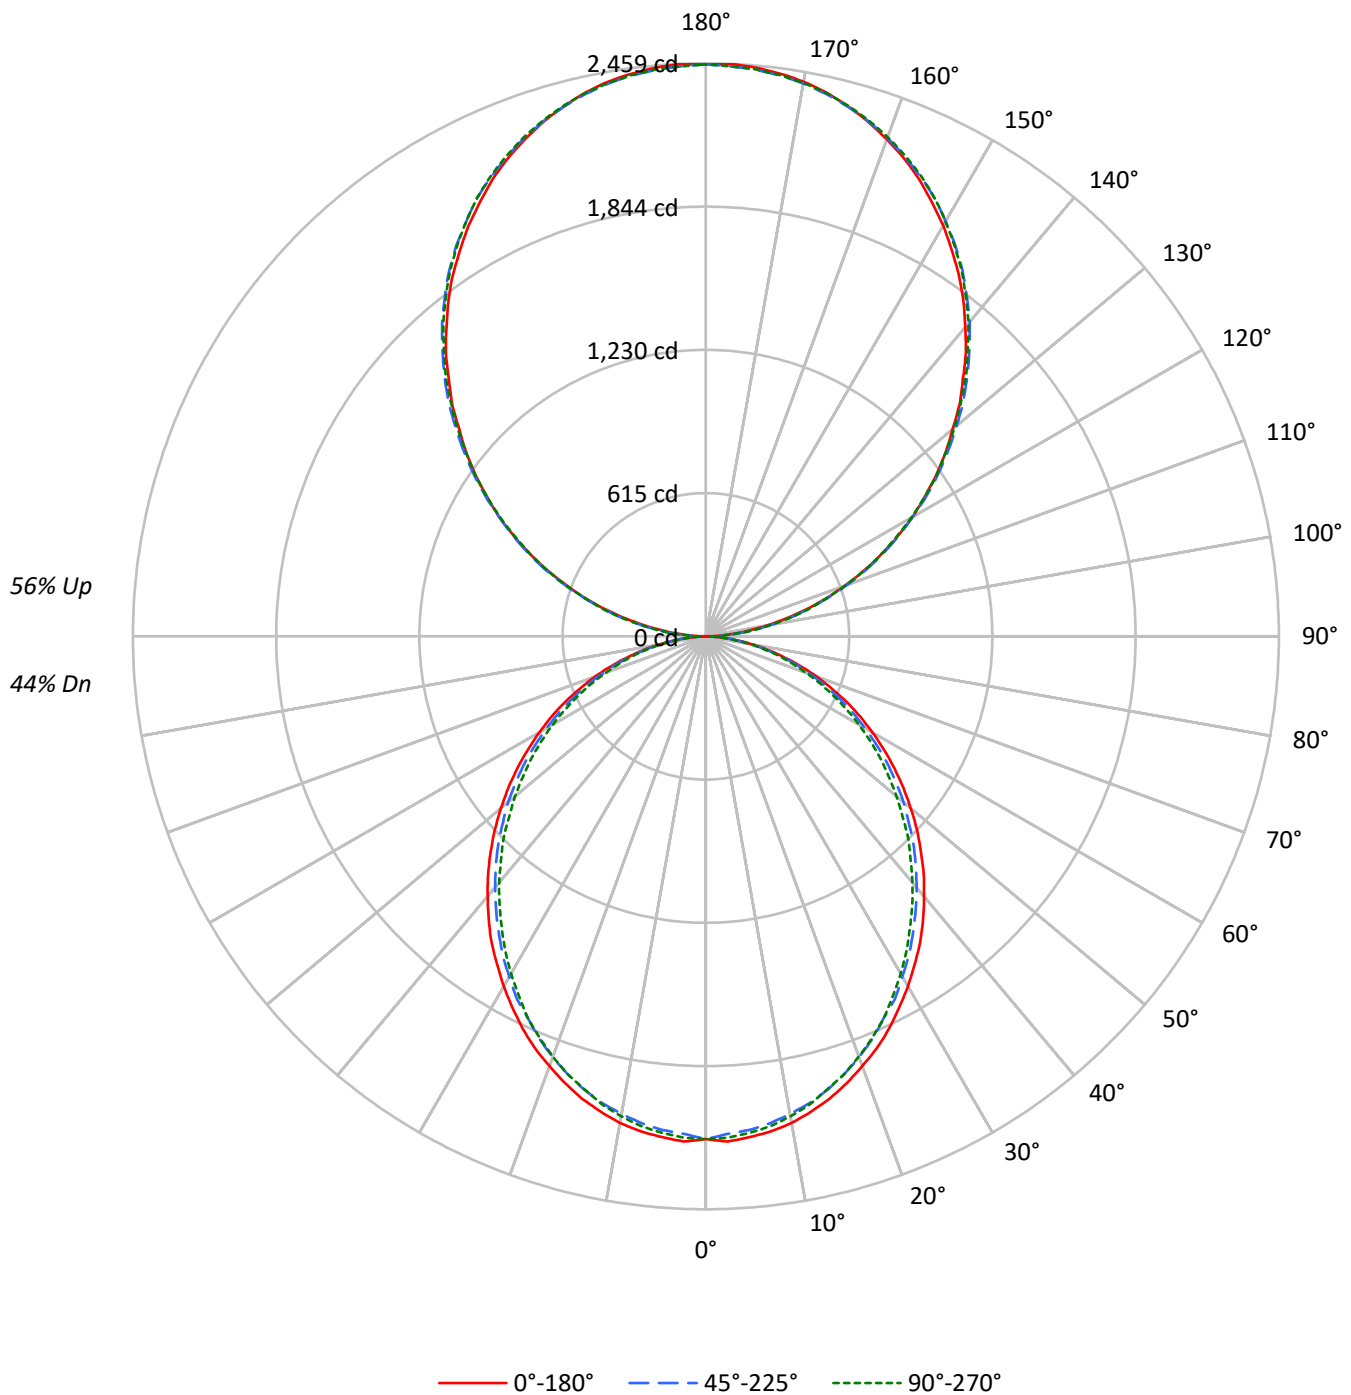

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	45	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	24	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2522	2522	2522
5°	2525	2485	2503
10°	2503	2450	2468
15°	2464	2408	2414
20°	2413	2350	2358
25°	2362	2281	2295
30°	2299	2217	2214
35°	2238	2142	2129
40°	2164	2066	2047
45°	2090	1989	1964
50°	2010	1909	1868
55°	1925	1816	1779
60°	1829	1706	1677
65°	1724	1591	1557
70°	1590	1452	1428
75°	1405	1285	1307
80°	1182	1071	1078
85°	833	709	702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2432 cd/sqm

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.6
10°-20°	571.4	4.6
20°-30°	839.7	6.8
30°-40°	975.2	7.9
40°-50°	974.0	7.9
50°-60°	849.3	6.9
60°-70°	627.9	5.1
70°-80°	355.2	2.9
80°-90°	100.7	0.8
90°-100°	151.9	1.2
100°-110°	482.7	3.9
110°-120°	826.1	6.7
120°-130°	1086.4	8.8
130°-140°	1219.5	9.9
140°-150°	1195.8	9.7
150°-160°	1003.1	8.1
160°-170°	665.3	5.4
170°-180°	232.5	1.9
0°-30°	1614.1	13.1
0°-40°	2589.4	20.9
0°-60°	4412.7	35.7
0°-90°	5496.5	44.5
90°-120°	1460.7	11.8
90°-150°	4962.4	40.1
90°-180°	6863.0	55.5
0°-180°	12359.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	2	27	72	68	70	12
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P911204

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.91	10.73	10.91	11.74	13.09	9.47	10.29	10.48	11.30	12.65
	3H	11.56	12.29	12.58	13.31	14.68	11.08	11.81	12.09	12.83	14.20
	4H	12.14	12.84	13.17	13.86	15.24	11.66	12.35	12.68	13.38	14.75
	6H	12.54	13.17	13.57	14.20	15.59	12.05	12.68	13.08	13.71	15.10
	8H	12.64	13.24	13.68	14.29	15.67	12.15	12.75	13.19	13.80	15.18
	12H	12.68	13.26	13.73	14.30	15.71	12.19	12.76	13.23	13.80	15.21
4H	2H	10.36	11.05	11.40	12.08	13.46	10.01	10.70	11.05	11.73	13.11
	3H	12.22	12.79	13.26	13.85	15.24	11.82	12.39	12.86	13.45	14.84
	4H	12.93	13.45	13.97	14.50	15.91	12.51	13.04	13.56	14.08	15.49
	6H	13.43	13.89	14.49	14.96	16.36	13.01	13.46	14.07	14.53	15.94
	8H	13.58	14.00	14.64	15.06	16.49	13.15	13.58	14.21	14.64	16.06
	12H	13.65	14.03	14.72	15.10	16.53	13.21	13.59	14.28	14.67	16.10
8H	4H	13.11	13.54	14.17	14.60	16.02	12.74	13.17	13.80	14.23	15.65
	6H	13.74	14.09	14.82	15.19	16.61	13.36	13.71	14.44	14.81	16.23
	8H	13.95	14.26	15.04	15.35	16.79	13.57	13.88	14.66	14.96	16.40
	12H	14.08	14.35	15.17	15.43	16.91	13.68	13.95	14.77	15.03	16.51
12H	4H	13.10	13.48	14.17	14.56	15.98	12.73	13.12	13.81	14.19	15.62
	6H	13.76	14.07	14.85	15.16	16.60	13.40	13.71	14.49	14.79	16.23
	8H	14.00	14.27	15.09	15.35	16.83	13.63	13.90	14.72	14.98	16.46