

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911216

Luminaire Tested: DFN2DIP-PN3F0-060D030US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911216
REPORT IS A COMBINATION OF REPORTS P899517 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D030US850-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9531.8 lumens
Efficiency: N/A
Efficacy: 118.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 80.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFLL

Luminous Intensity Polar Plot

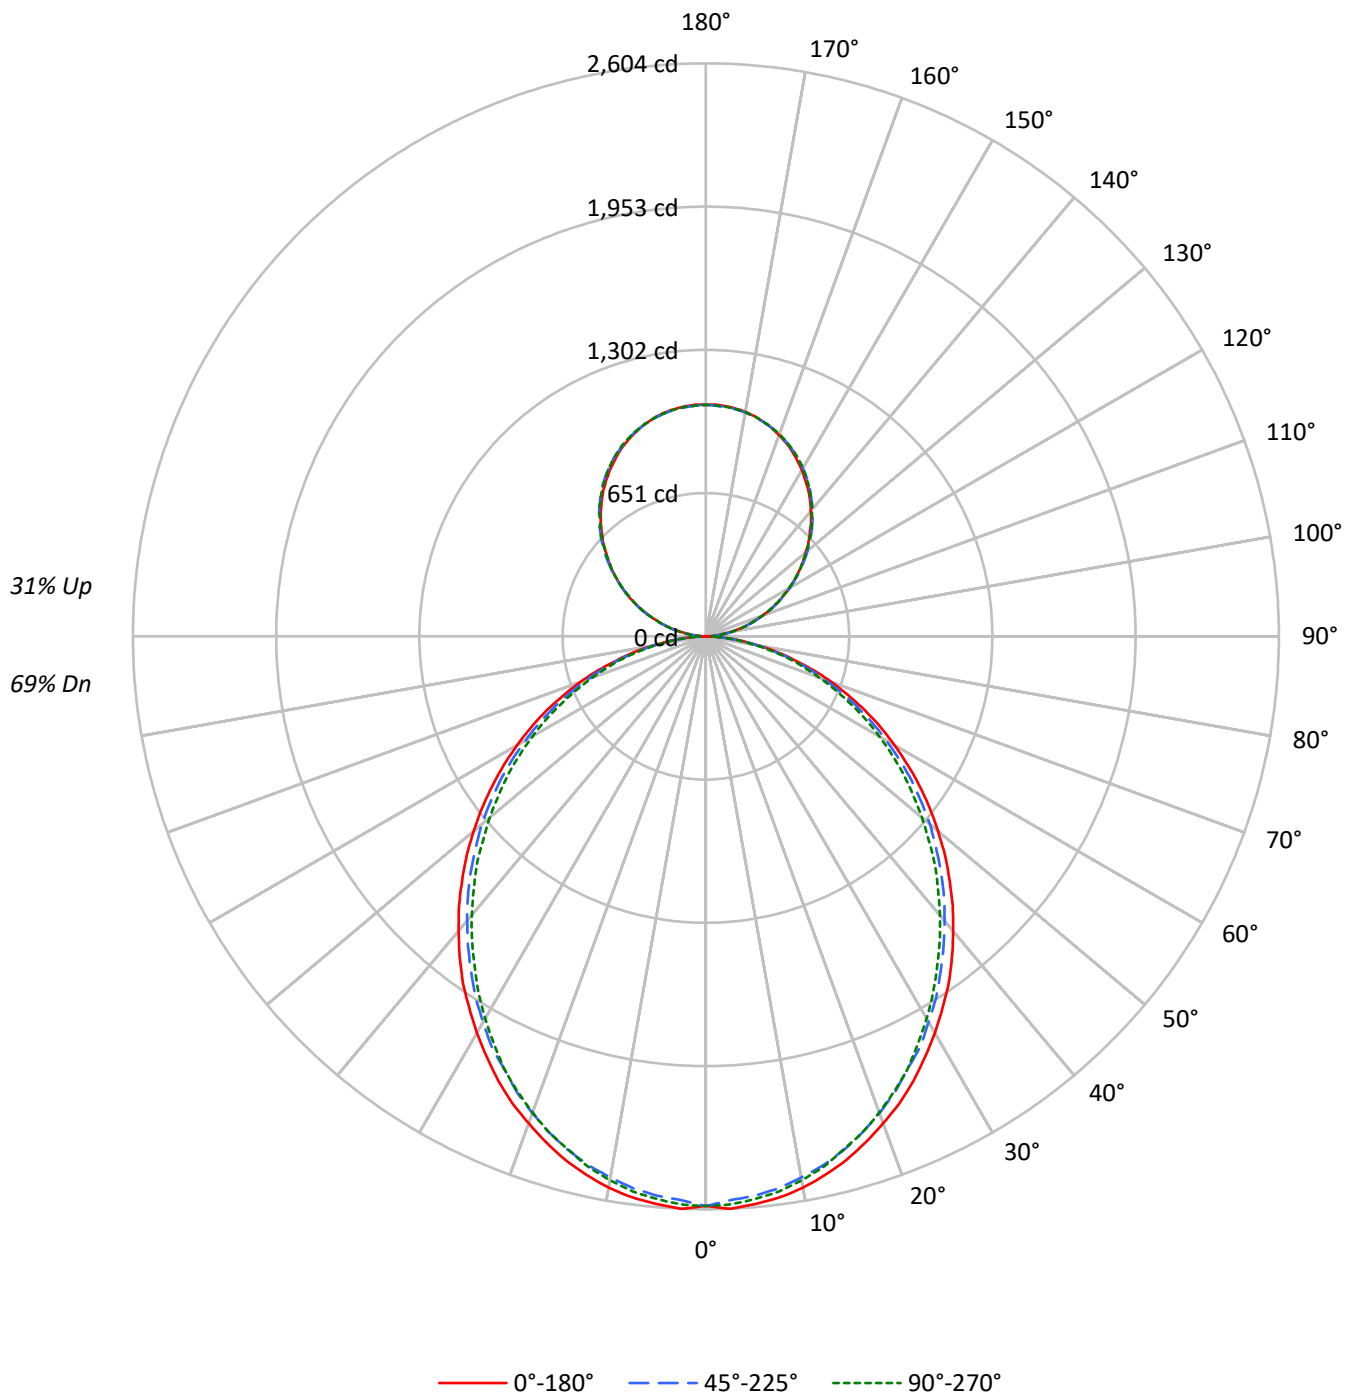

TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3027	3027	3027
5°	3030	2982	3003
10°	3003	2940	2961
15°	2957	2889	2897
20°	2896	2820	2830
25°	2835	2737	2754
30°	2758	2661	2657
35°	2686	2570	2554
40°	2597	2479	2457
45°	2508	2387	2357
50°	2411	2291	2241
55°	2310	2179	2135
60°	2194	2047	2013
65°	2068	1910	1869
70°	1908	1742	1713
75°	1686	1542	1568
80°	1418	1285	1294
85°	1000	850	844

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2508 cd/sqm

TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	2.6
10°-20°	685.6	7.2
20°-30°	1007.6	10.6
30°-40°	1170.3	12.3
40°-50°	1168.8	12.3
50°-60°	1019.2	10.7
60°-70°	753.4	7.9
70°-80°	426.3	4.5
80°-90°	115.5	1.2
90°-100°	65.1	0.7
100°-110°	206.9	2.2
110°-120°	354.0	3.7
120°-130°	465.6	4.9
130°-140°	522.6	5.5
140°-150°	512.5	5.4
150°-160°	429.9	4.5
160°-170°	285.1	3.0
170°-180°	99.7	1.0
0°-30°	1937.0	20.3
0°-40°	3107.2	32.6
0°-60°	5295.3	55.6
0°-90°	6590.4	69.1
90°-120°	626.0	6.6
90°-150°	2126.7	22.3
90°-180°	2941.0	30.9
0°-180°	9531.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	1	11	31	29	30	9
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5



TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2

TEST NUMBER: P911216

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.68	13.75	13.46	14.54	15.51	12.24	13.31	13.02	14.10	15.07
	3H	14.35	15.31	15.14	16.11	17.11	13.87	14.83	14.66	15.63	16.63
	4H	14.95	15.85	15.75	16.66	17.67	14.46	15.36	15.26	16.18	17.19
	6H	15.35	16.18	16.17	17.01	18.03	14.86	15.69	15.68	16.52	17.54
	8H	15.46	16.25	16.29	17.09	18.12	14.97	15.76	15.79	16.60	17.63
	12H	15.51	16.27	16.34	17.10	18.15	15.01	15.77	15.85	16.61	17.66
4H	2H	13.17	14.07	13.97	14.88	15.89	12.81	13.72	13.62	14.53	15.54
	3H	15.04	15.80	15.86	16.64	17.67	14.64	15.39	15.46	16.24	17.27
	4H	15.76	16.45	16.59	17.29	18.35	15.34	16.03	16.18	16.88	17.93
	6H	16.28	16.87	17.13	17.75	18.80	15.86	16.45	16.71	17.32	18.38
	8H	16.43	16.99	17.29	17.85	18.92	16.01	16.56	16.86	17.43	18.50
	12H	16.51	17.01	17.39	17.90	18.97	16.07	16.57	16.95	17.46	18.54
8H	4H	15.97	16.52	16.82	17.39	18.46	15.60	16.15	16.45	17.02	18.09
	6H	16.60	17.06	17.48	17.97	19.04	16.23	16.69	17.11	17.59	18.66
	8H	16.82	17.23	17.71	18.13	19.22	16.44	16.84	17.33	17.75	18.83
	12H	16.96	17.32	17.85	18.21	19.35	16.56	16.92	17.45	17.81	18.95
12H	4H	15.96	16.46	16.84	17.35	18.43	15.60	16.10	16.47	16.99	18.06
	6H	16.63	17.04	17.52	17.94	19.03	16.27	16.68	17.16	17.58	18.67
	8H	16.88	17.24	17.77	18.13	19.27	16.51	16.87	17.40	17.76	18.90

END OF REPORT