

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911218

Luminaire Tested: DFN2DIP-PN3F0-060D030US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911218
REPORT IS A COMBINATION OF REPORTS P899518 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D030US850-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8600.3 lumens
Efficiency: N/A
Efficacy: 107.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 80.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

Luminous Intensity Polar Plot

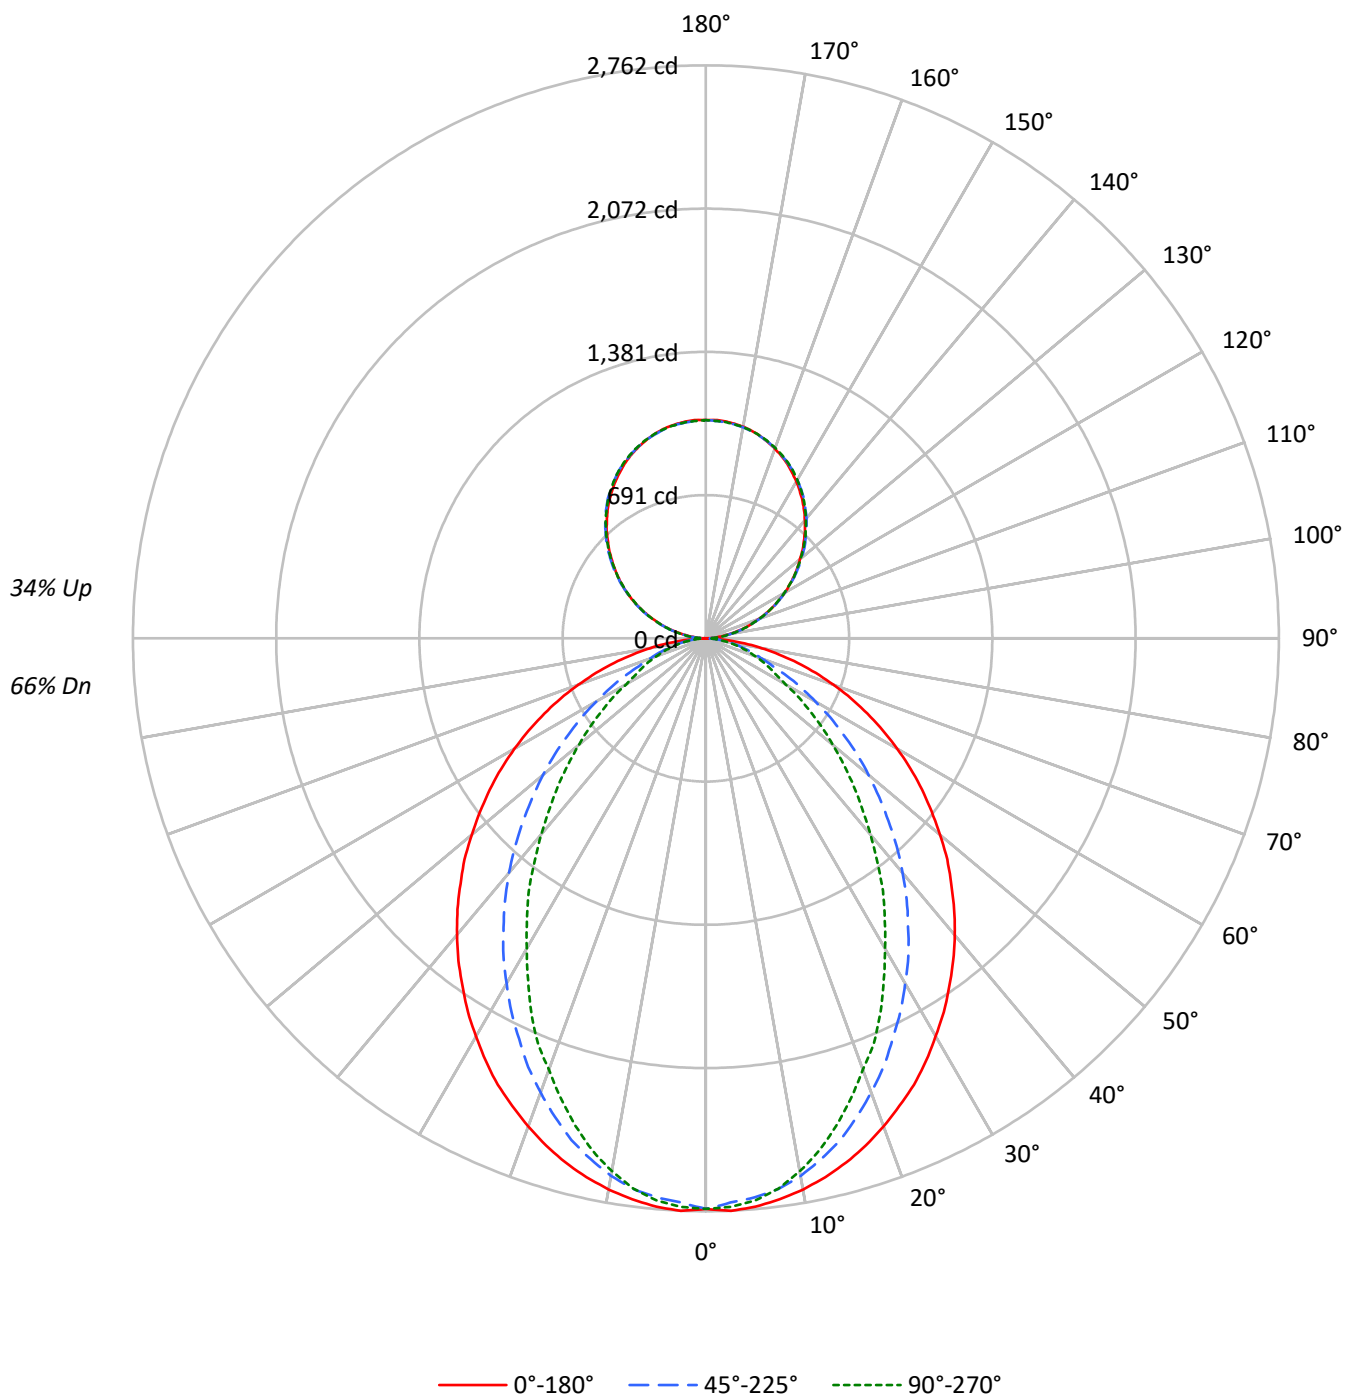

TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3215	3215	3215
5°	3218	3162	3183
10°	3184	3097	3078
15°	3139	2993	2916
20°	3079	2850	2719
25°	3017	2689	2528
30°	2936	2525	2287
35°	2855	2349	2075
40°	2774	2167	1832
45°	2679	1966	1612
50°	2581	1762	1397
55°	2478	1545	1190
60°	2359	1319	978
65°	2222	1089	879
70°	2056	874	793
75°	1847	766	719
80°	1544	635	619
85°	1049	413	457

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2679 cd/sqm

TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	3.0
10°-20°	707.6	8.2
20°-30°	993.4	11.6
30°-40°	1082.8	12.6
40°-50°	995.2	11.6
50°-60°	781.6	9.1
60°-70°	508.8	5.9
70°-80°	261.9	3.0
80°-90°	69.8	0.8
90°-100°	65.1	0.8
100°-110°	206.9	2.4
110°-120°	354.0	4.1
120°-130°	465.6	5.4
130°-140°	522.6	6.1
140°-150°	512.5	6.0
150°-160°	429.9	5.0
160°-170°	285.1	3.3
170°-180°	99.7	1.2
0°-30°	1958.7	22.8
0°-40°	3041.5	35.4
0°-60°	4818.4	56.0
0°-90°	5658.9	65.8
90°-120°	626.0	7.3
90°-150°	2126.7	24.7
90°-180°	2941.0	34.2
0°-180°	8600.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	1	11	31	29	30	8
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5



TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2

TEST NUMBER: P911218

CATALOG NUMBER: DFN2DIP-PN3F0-060D030US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.53	13.50	13.34	14.34	15.37	8.49	9.47	9.31	10.30	11.33
	3H	14.21	15.08	15.04	15.93	16.98	9.69	10.56	10.52	11.40	12.46
	4H	14.82	15.64	15.67	16.49	17.56	10.14	10.96	10.98	11.81	12.88
	6H	15.24	16.00	16.10	16.86	17.94	10.46	11.22	11.32	12.08	13.16
	8H	15.37	16.09	16.24	16.97	18.05	10.55	11.28	11.42	12.15	13.23
	12H	15.44	16.12	16.31	16.99	18.10	10.60	11.29	11.47	12.16	13.26
4H	2H	12.56	13.39	13.41	14.24	15.30	9.10	9.93	9.95	10.78	11.85
	3H	14.40	15.08	15.26	15.96	17.05	10.46	11.14	11.32	12.03	13.11
	4H	15.09	15.71	15.96	16.59	17.70	11.01	11.63	11.88	12.51	13.62
	6H	15.61	16.14	16.50	17.05	18.16	11.43	11.97	12.32	12.87	13.98
	8H	15.78	16.28	16.67	17.18	18.31	11.56	12.06	12.45	12.96	14.08
	12H	15.88	16.33	16.79	17.25	18.38	11.62	12.08	12.54	12.99	14.13
8H	4H	15.07	15.57	15.96	16.47	17.59	11.29	11.80	12.19	12.70	13.82
	6H	15.63	16.05	16.55	16.99	18.11	11.81	12.22	12.73	13.17	14.29
	8H	15.84	16.21	16.77	17.14	18.29	12.00	12.36	12.93	13.30	14.44
	12H	15.98	16.31	16.92	17.23	18.43	12.12	12.44	13.05	13.37	14.56
12H	4H	15.02	15.48	15.94	16.39	17.53	11.31	11.76	12.22	12.67	13.81
	6H	15.61	15.97	16.53	16.91	18.05	11.86	12.23	12.79	13.16	14.30
	8H	15.83	16.15	16.76	17.08	18.27	12.07	12.39	13.00	13.32	14.51

END OF REPORT