

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911234

Luminaire Tested: DFN2DIP-PN3F0-060D070US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911234
REPORT IS A COMBINATION OF REPORTS P899574 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D070US850-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12526.2 lumens
Efficiency: N/A
Efficacy: 112.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 111.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLLFLL

Luminous Intensity Polar Plot

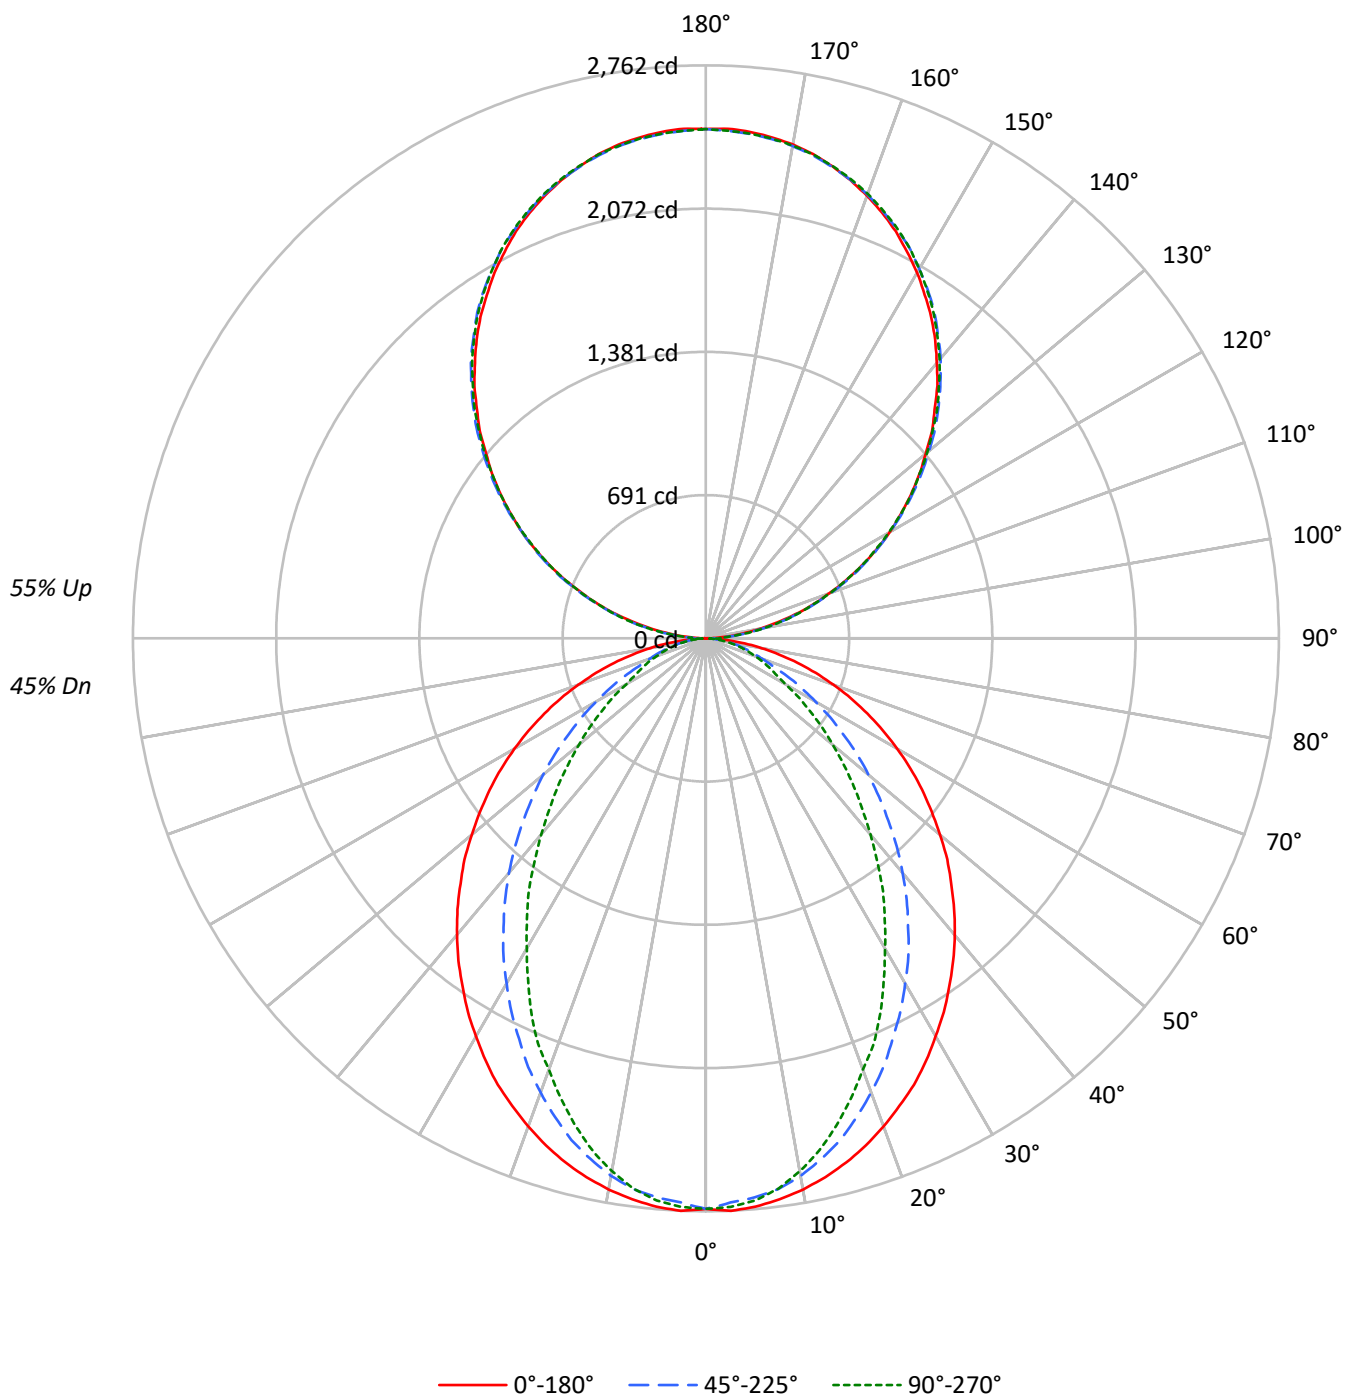

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	85	82	79	71	69	67	58	57	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	52	49	47	41	40	38
3	81	72	65	60	74	67	60	56	56	51	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	47	50	45	41	41	38	35	33	31	29
5	69	57	50	44	63	53	46	41	45	40	36	37	33	30	30	28	25
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	36	32	37	32	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	19	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3215	3215	3215
5°	3218	3162	3183
10°	3184	3097	3078
15°	3139	2993	2916
20°	3079	2850	2719
25°	3017	2689	2528
30°	2936	2525	2287
35°	2855	2349	2075
40°	2774	2167	1832
45°	2679	1966	1612
50°	2581	1762	1397
55°	2478	1545	1190
60°	2359	1319	978
65°	2222	1089	879
70°	2056	874	793
75°	1847	766	719
80°	1544	635	619
85°	1049	413	457

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2679 cd/sqm

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	2.1
10°-20°	707.6	5.6
20°-30°	993.4	7.9
30°-40°	1082.8	8.6
40°-50°	995.2	7.9
50°-60°	781.6	6.2
60°-70°	508.8	4.1
70°-80°	261.9	2.1
80°-90°	73.8	0.6
90°-100°	151.9	1.2
100°-110°	482.7	3.9
110°-120°	826.1	6.6
120°-130°	1086.4	8.7
130°-140°	1219.5	9.7
140°-150°	1195.8	9.5
150°-160°	1003.1	8.0
160°-170°	665.3	5.3
170°-180°	232.5	1.9
0°-30°	1958.7	15.6
0°-40°	3041.5	24.3
0°-60°	4818.4	38.5
0°-90°	5662.9	45.2
90°-120°	1460.7	11.7
90°-150°	4962.4	39.6
90°-180°	6863.0	54.8
0°-180°	12526.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	2	27	72	68	70	12
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P911234

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.70	11.49	11.70	12.50	13.84	6.66	7.46	7.67	8.47	9.81
	3H	12.37	13.08	13.38	14.09	15.46	7.84	8.55	8.86	9.57	10.93
	4H	12.97	13.64	14.00	14.66	16.03	8.29	8.96	9.32	9.98	11.35
	6H	13.38	14.00	14.42	15.03	16.41	8.60	9.22	9.64	10.25	11.63
	8H	13.51	14.09	14.55	15.14	16.51	8.69	9.28	9.73	10.32	11.70
	12H	13.57	14.12	14.61	15.16	16.56	8.73	9.29	9.78	10.32	11.72
4H	2H	10.71	11.38	11.74	12.40	13.77	7.25	7.92	8.29	8.94	10.31
	3H	12.53	13.09	13.57	14.14	15.52	8.59	9.15	9.63	10.20	11.58
	4H	13.22	13.73	14.26	14.77	16.17	9.13	9.64	10.18	10.69	12.09
	6H	13.72	14.16	14.78	15.23	16.63	9.54	9.98	10.60	11.05	12.45
	8H	13.89	14.30	14.95	15.36	16.78	9.67	10.08	10.73	11.14	12.55
	12H	13.98	14.35	15.06	15.42	16.84	9.73	10.10	10.80	11.17	12.59
8H	4H	13.18	13.59	14.24	14.65	16.06	9.41	9.82	10.47	10.87	12.29
	6H	13.74	14.07	14.82	15.17	16.59	9.92	10.25	11.00	11.35	12.77
	8H	13.95	14.25	15.04	15.33	16.76	10.10	10.40	11.19	11.48	12.91
	12H	14.08	14.34	15.17	15.42	16.89	10.21	10.48	11.31	11.55	13.03
12H	4H	13.13	13.50	14.20	14.57	15.99	9.41	9.78	10.49	10.85	12.27
	6H	13.71	14.01	14.80	15.09	16.52	9.96	10.26	11.05	11.34	12.78
	8H	13.93	14.19	15.02	15.26	16.74	10.17	10.43	11.26	11.51	12.98

END OF REPORT