

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911268

Luminaire Tested: DFN2DIP-PN3F0-070D090US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911268
REPORT IS A COMBINATION OF REPORTS P899603 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D090US850-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16518.6 lumens
Efficiency: N/A
Efficacy: 117.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFLL

Luminous Intensity Polar Plot

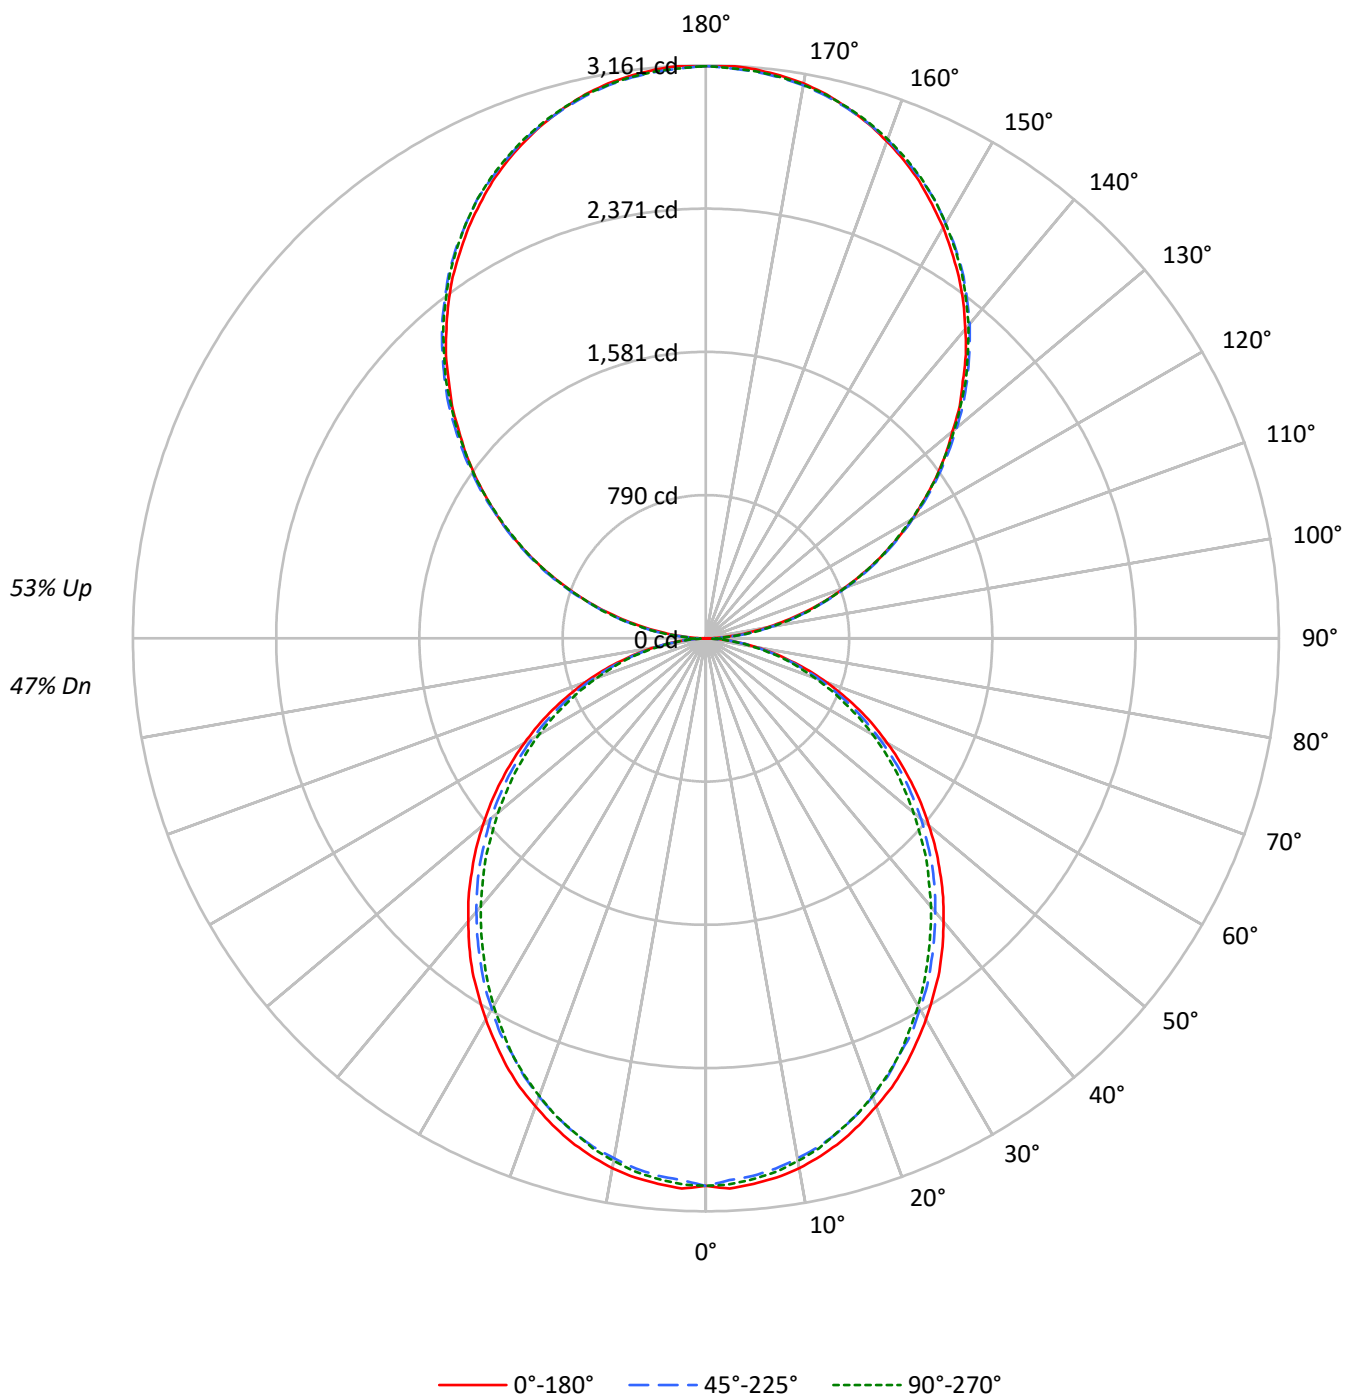

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	67	67	67	53	53	53
1	97	93	89	85	89	85	82	79	71	69	67	59	57	55	47	46	45
2	88	81	75	70	81	75	69	65	63	59	55	51	49	46	41	39	38
3	81	71	64	58	74	66	59	54	55	50	47	45	42	39	37	34	32
4	74	63	55	49	67	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	47	39	34	39	34	30	33	29	25	27	24	21
7	58	45	37	32	53	42	35	30	36	30	26	30	26	23	24	21	19
8	53	41	33	28	49	38	31	27	33	27	23	27	23	20	22	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	46	34	27	22	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3531	3531	3531
5°	3535	3479	3504
10°	3504	3430	3455
15°	3450	3371	3379
20°	3378	3290	3302
25°	3307	3194	3213
30°	3218	3104	3100
35°	3134	2999	2980
40°	3030	2892	2866
45°	2926	2785	2750
50°	2813	2672	2615
55°	2694	2542	2491
60°	2560	2388	2348
65°	2413	2228	2180
70°	2226	2032	1999
75°	1967	1798	1829
80°	1655	1500	1509
85°	1167	993	984

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3127 cd/sqm

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.3	1.7
10°-20°	799.9	4.8
20°-30°	1175.6	7.1
30°-40°	1365.3	8.3
40°-50°	1363.6	8.3
50°-60°	1189.1	7.2
60°-70°	879.0	5.3
70°-80°	497.3	3.0
80°-90°	140.2	0.8
90°-100°	195.3	1.2
100°-110°	620.6	3.8
110°-120°	1062.1	6.4
120°-130°	1396.8	8.5
130°-140°	1567.9	9.5
140°-150°	1537.5	9.3
150°-160°	1289.7	7.8
160°-170°	855.3	5.2
170°-180°	299.0	1.8
0°-30°	2259.8	13.7
0°-40°	3625.1	21.9
0°-60°	6177.8	37.4
0°-90°	7694.3	46.6
90°-120°	1878.1	11.4
90°-150°	6380.2	38.6
90°-180°	8824.0	53.4
0°-180°	16518.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3021	3021	3021	3021	3021	
5°	3021	3009	2977	3000	2995	287
15°	2876	2858	2820	2832	2818	810
25°	2602	2579	2530	2536	2530	1198
35°	2245	2216	2170	2152	2138	1402
45°	1827	1807	1763	1731	1720	1410
55°	1383	1365	1330	1296	1281	1236
65°	933	915	886	860	845	922
75°	488	482	467	450	456	521
85°	119	116	114	104	102	133
90°	3	34	93	88	90	16
95°	139	166	170	170	166	155
105°	573	580	586	591	591	605
115°	1066	1081	1076	1074	1066	1054
125°	1550	1574	1566	1558	1555	1385
135°	2005	2035	2040	2038	2030	1550
145°	2434	2453	2468	2471	2461	1521
155°	2784	2791	2800	2813	2805	1281
165°	3028	3025	3025	3044	3031	854
175°	3151	3143	3138	3157	3140	299
180°	3157	3157	3157	3157	3157	

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3020.6	3020.6	3020.6	3020.6	3020.6
2.5°	3038.2	3023.7	2991.6	3020.6	3015.0
5°	3020.6	3009.3	2977.2	3000.3	2994.7
7.5°	3000.3	2983.0	2950.9	2974.4	2968.6
10°	2968.6	2948.2	2913.3	2936.5	2927.9
12.5°	2924.8	2907.6	2872.8	2887.2	2881.3
15°	2875.5	2858.2	2820.3	2832.1	2817.5
17.5°	2814.4	2797.2	2759.3	2773.8	2759.3
20°	2747.5	2730.4	2689.7	2698.3	2686.9
22.5°	2681.0	2654.8	2616.9	2616.9	2611.0
25°	2602.5	2579.3	2530.1	2535.6	2530.1
27.5°	2515.2	2494.9	2457.3	2448.7	2434.1
30°	2428.4	2404.9	2361.5	2352.9	2341.1
32.5°	2335.2	2318.0	2271.5	2253.9	2242.2
35°	2245.3	2216.3	2169.8	2152.2	2137.7
37.5°	2143.6	2117.4	2070.8	2050.5	2036.0
40°	2039.1	2015.7	1969.1	1943.3	1931.5
42.5°	1937.4	1914.0	1867.8	1838.5	1821.2
45°	1827.1	1806.8	1763.0	1731.3	1719.5
47.5°	1719.5	1699.2	1652.6	1620.6	1603.4
50°	1606.2	1591.6	1550.9	1510.3	1495.8
52.5°	1495.8	1475.5	1437.9	1405.9	1385.5
55°	1382.7	1365.2	1330.4	1295.5	1281.0
57.5°	1269.4	1254.8	1216.9	1182.1	1170.4
60°	1155.9	1144.5	1103.9	1071.8	1063.2
62.5°	1045.6	1025.3	996.3	967.4	955.6
65°	932.6	914.9	886.0	859.8	845.3
67.5°	816.3	801.6	775.6	755.3	743.6
70°	708.8	697.1	670.8	650.5	639.1
72.5°	598.4	586.8	572.2	551.9	543.3
75°	487.8	482.3	467.4	450.3	456.1
77.5°	389.3	377.5	371.6	363.0	354.4
80°	290.6	287.6	281.7	273.0	267.2
82.5°	197.5	197.5	194.7	183.1	183.1
85°	119.0	116.2	113.5	104.5	101.7
87.5°	52.3	46.6	40.7	32.1	28.9
90°	2.9	34.3	93.3	87.5	90.4
92.5°	59.0	80.0	82.8	85.6	85.6
95°	139.0	165.6	170.3	170.3	165.6
97.5°	231.2	256.0	266.5	266.5	266.5
100°	337.8	359.8	367.3	367.3	364.5
102.5°	450.1	466.3	476.8	479.6	476.8
105°	572.9	580.5	586.2	591.0	591.0
107.5°	694.7	706.1	706.1	708.0	694.7
110°	812.7	828.0	828.0	828.0	820.3

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	940.2	956.4	953.5	946.0	940.2
115°	1065.9	1081.1	1076.3	1073.5	1065.9
117.5°	1190.5	1211.5	1198.2	1190.5	1182.9
120°	1316.2	1337.0	1316.2	1316.2	1307.5
122.5°	1430.3	1457.0	1443.7	1436.0	1430.3
125°	1550.3	1574.0	1566.5	1557.8	1555.0
127.5°	1667.3	1696.8	1686.3	1674.9	1667.3
130°	1776.7	1811.0	1806.2	1800.5	1790.0
132.5°	1899.5	1926.1	1928.0	1914.7	1907.1
135°	2005.1	2034.6	2040.3	2037.5	2029.9
137.5°	2123.1	2146.9	2151.7	2149.8	2138.4
140°	2226.9	2250.6	2263.9	2263.9	2253.5
142.5°	2333.4	2357.2	2364.8	2367.7	2357.2
145°	2434.4	2453.3	2468.5	2471.4	2461.0
147.5°	2524.7	2548.5	2559.9	2564.7	2554.2
150°	2618.0	2634.2	2644.6	2653.2	2644.6
152.5°	2700.7	2716.9	2730.2	2740.8	2730.2
155°	2783.6	2791.1	2799.8	2813.1	2804.6
157.5°	2854.9	2860.7	2865.4	2884.4	2871.1
160°	2918.7	2924.4	2927.3	2943.4	2932.0
162.5°	2977.7	2977.7	2980.5	2998.6	2985.3
165°	3028.1	3025.2	3025.2	3044.3	3031.0
167.5°	3073.8	3065.3	3065.3	3084.2	3070.9
170°	3108.1	3100.4	3097.7	3116.6	3100.4
172.5°	3131.8	3124.3	3121.4	3140.5	3124.3
175°	3150.9	3143.2	3137.6	3156.7	3140.5
177.5°	3161.3	3153.8	3148.0	3164.2	3148.0
180°	3156.7	3156.7	3156.7	3156.7	3156.7

TEST NUMBER: P911268

CATALOG NUMBER: DFN2DIP-PN3F0-070D090US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.29	12.12	12.28	13.12	14.44	10.85	11.68	11.84	12.68	14.00
	3H	12.94	13.69	13.94	14.69	16.04	12.46	13.20	13.46	14.21	15.55
	4H	13.52	14.23	14.53	15.24	16.59	13.04	13.74	14.05	14.76	16.10
	6H	13.92	14.57	14.94	15.58	16.94	13.43	14.08	14.45	15.09	16.45
	8H	14.02	14.64	15.04	15.67	17.03	13.53	14.15	14.55	15.18	16.54
	12H	14.06	14.65	15.10	15.68	17.06	13.57	14.16	14.60	15.18	16.56
4H	2H	11.74	12.45	12.76	13.46	14.81	11.39	12.10	12.41	13.11	14.46
	3H	13.60	14.19	14.62	15.23	16.59	13.20	13.79	14.22	14.83	16.19
	4H	14.31	14.85	15.34	15.88	17.26	13.89	14.43	14.92	15.46	16.85
	6H	14.82	15.28	15.86	16.33	17.72	14.39	14.86	15.44	15.91	17.29
	8H	14.96	15.40	16.00	16.44	17.84	14.53	14.97	15.58	16.02	17.41
	12H	15.03	15.42	16.09	16.48	17.89	14.59	14.98	15.65	16.05	17.45
8H	4H	14.50	14.93	15.54	15.98	17.37	14.13	14.56	15.17	15.61	17.00
	6H	15.12	15.48	16.19	16.57	17.96	14.75	15.10	15.81	16.19	17.59
	8H	15.34	15.65	16.41	16.73	18.14	14.95	15.27	16.03	16.34	17.75
	12H	15.46	15.74	16.54	16.81	18.26	15.06	15.34	16.14	16.41	17.86
12H	4H	14.48	14.87	15.54	15.94	17.34	14.12	14.51	15.18	15.57	16.97
	6H	15.15	15.46	16.22	16.54	17.95	14.78	15.10	15.86	16.17	17.59
	8H	15.38	15.66	16.46	16.73	18.18	15.01	15.29	16.09	16.36	17.81

END OF REPORT