

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913867

Luminaire Tested: DFN2DIP-PN3F0-030D040US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913867
REPORT IS A COMBINATION OF REPORTS P901046 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-030D040US927-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5157.1 lumens
Efficiency: N/A
Efficacy: 95.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 53.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLLONL

Luminous Intensity Polar Plot

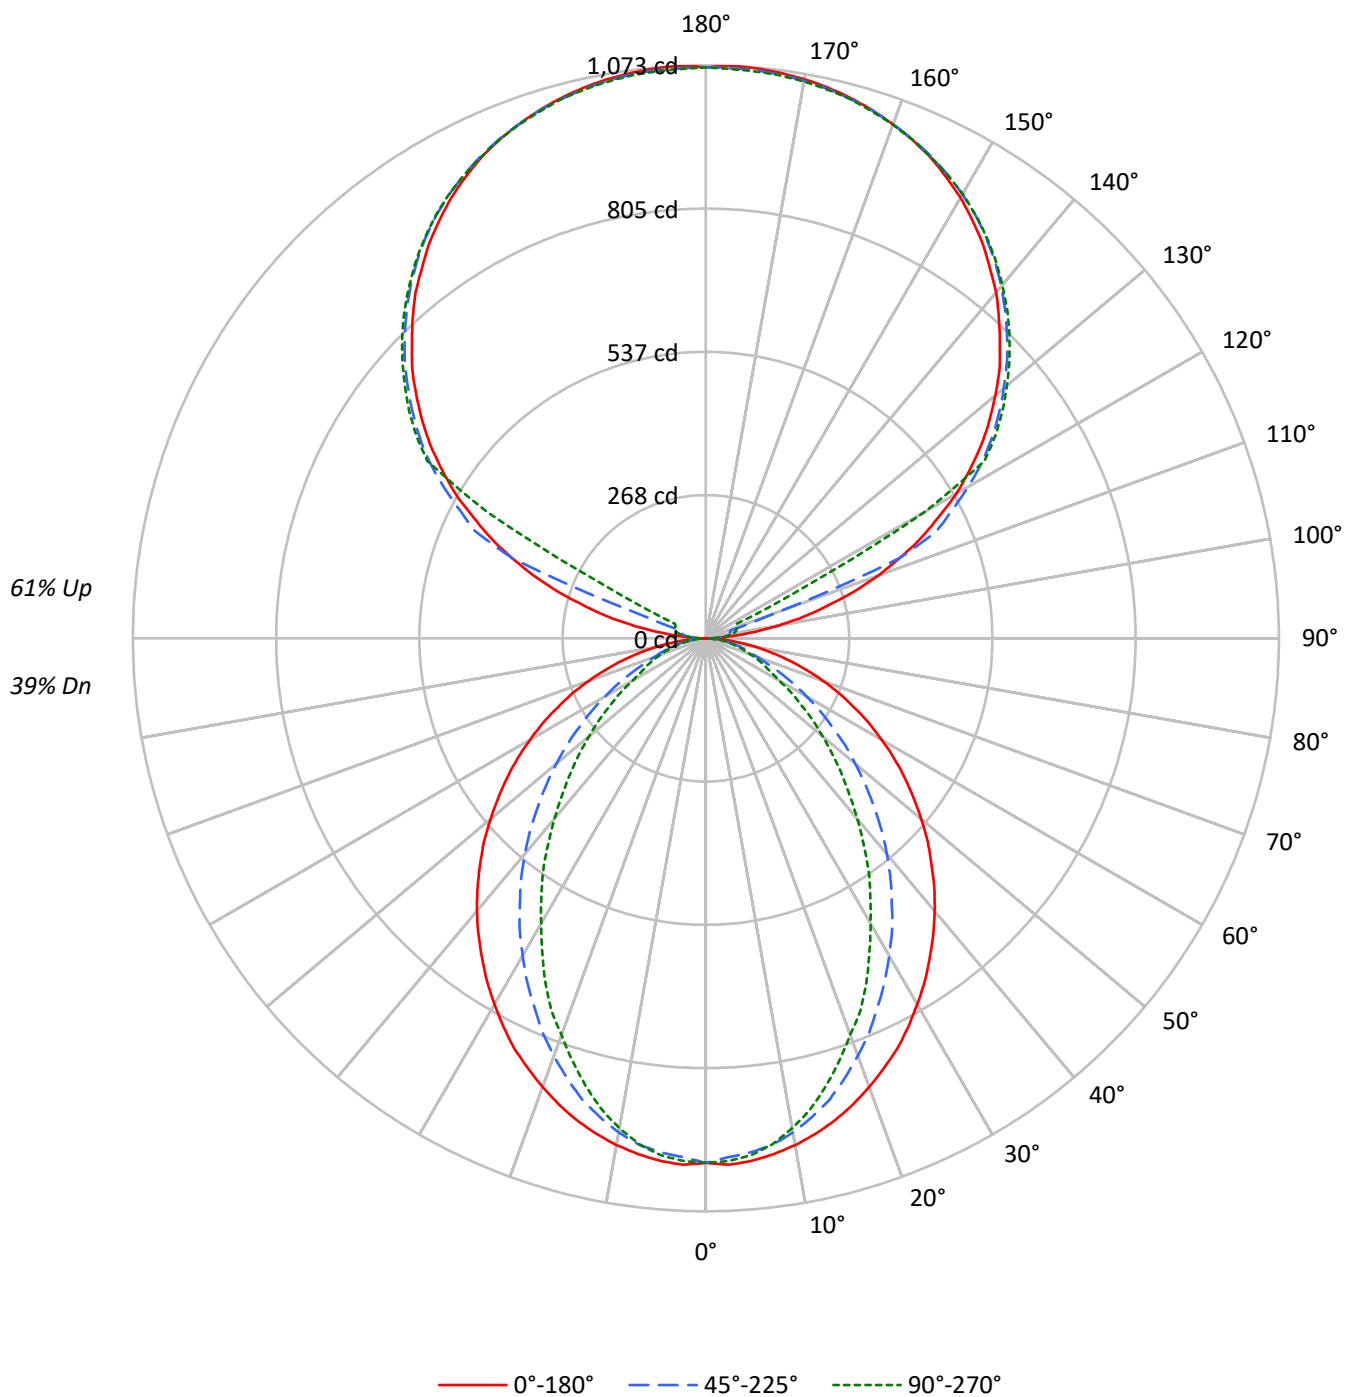

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1148	1148	1148
5°	1149	1129	1137
10°	1137	1106	1099
15°	1121	1069	1042
20°	1100	1018	971
25°	1078	961	903
30°	1049	902	817
35°	1020	839	741
40°	991	774	654
45°	957	702	576
50°	922	630	499
55°	885	552	425
60°	842	471	350
65°	794	389	314
70°	734	312	283
75°	659	274	257
80°	552	227	221
85°	375	148	164

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 957 cd/sqm

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.1	1.8
10°-20°	252.7	4.9
20°-30°	354.8	6.9
30°-40°	386.8	7.5
40°-50°	355.5	6.9
50°-60°	279.2	5.4
60°-70°	181.7	3.5
70°-80°	93.5	1.8
80°-90°	25.8	0.5
90°-100°	35.2	0.7
100°-110°	131.5	2.5
110°-120°	348.6	6.8
120°-130°	578.2	11.2
130°-140°	614.2	11.9
140°-150°	570.9	11.1
150°-160°	458.9	8.9
160°-170°	295.7	5.7
170°-180°	101.8	2.0
0°-30°	699.6	13.6
0°-40°	1086.3	21.1
0°-60°	1720.9	33.4
0°-90°	2021.9	39.2
90°-120°	515.3	10.0
90°-150°	2278.7	44.2
90°-180°	3135.0	60.8
0°-180°	5157.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	982	982	982	982	982	
5°	982	978	966	974	972	93
15°	934	924	894	877	868	263
25°	848	820	761	724	711	390
35°	731	685	607	551	532	457
45°	597	538	444	381	360	461
55°	454	385	289	236	219	406
65°	307	235	155	124	122	304
75°	164	101	71	65	64	173
85°	38	20	17	17	17	44
90°	1	9	15	19	21	5
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	982.2	982.2	982.2	982.2	982.2
2.5°	986.7	982.2	972.4	981.4	979.6
5°	982.2	977.8	966.2	974.2	971.5
7.5°	974.2	968.9	956.5	960.0	955.5
10°	963.5	957.4	939.6	936.8	931.6
12.5°	950.2	942.2	918.2	912.9	903.1
15°	934.2	924.4	894.2	877.3	868.5
17.5°	915.5	901.3	864.0	844.5	830.2
20°	894.2	876.4	831.9	809.8	790.2
22.5°	871.2	850.6	799.1	768.9	755.6
25°	848.0	819.5	760.9	724.4	711.1
27.5°	820.5	790.2	725.3	683.6	663.1
30°	791.2	757.3	686.2	641.0	616.9
32.5°	762.6	721.8	649.0	595.6	573.3
35°	730.7	685.3	607.1	551.1	531.6
37.5°	699.6	650.6	568.0	506.6	484.5
40°	666.7	613.4	527.1	464.0	440.9
42.5°	632.9	576.1	486.2	420.4	398.2
45°	597.4	537.7	444.5	381.3	360.0
47.5°	563.6	500.5	404.5	341.3	321.8
50°	526.2	463.1	365.4	304.0	285.3
52.5°	489.7	423.1	328.0	269.3	252.5
55°	454.2	384.8	288.8	235.6	218.7
57.5°	417.8	346.7	254.3	204.5	190.2
60°	380.4	309.3	217.8	172.5	158.3
62.5°	344.0	272.9	186.6	144.0	137.0
65°	306.7	234.6	154.6	124.5	121.8
67.5°	271.2	199.1	124.5	109.3	106.6
70°	233.8	164.5	103.1	94.2	90.6
72.5°	198.2	132.4	86.2	79.1	77.3
75°	163.5	101.3	71.1	64.9	64.0
77.5°	128.9	71.9	56.0	52.4	50.6
80°	96.9	51.6	42.6	39.1	39.1
82.5°	67.5	34.7	29.3	27.6	27.6
85°	38.2	19.5	16.9	16.9	16.9
87.5°	14.3	7.1	7.1	6.3	6.3
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P913867

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.49	7.24	7.54	8.29	9.71	2.46	3.21	3.51	4.26	5.68
	3H	8.16	8.83	9.22	9.89	11.32	3.63	4.30	4.69	5.36	6.80
	4H	8.76	9.39	9.83	10.45	11.90	4.07	4.71	5.15	5.77	7.22
	6H	9.17	9.75	10.25	10.82	12.28	4.39	4.97	5.47	6.03	7.49
	8H	9.29	9.85	10.38	10.93	12.38	4.47	5.03	5.56	6.11	7.56
	12H	9.35	9.87	10.44	10.95	12.42	4.51	5.04	5.60	6.11	7.59
4H	2H	6.50	7.13	7.57	8.19	9.64	3.04	3.67	4.12	4.73	6.18
	3H	8.31	8.84	9.40	9.93	11.39	4.37	4.90	5.46	5.99	7.45
	4H	9.00	9.48	10.09	10.56	12.04	4.91	5.40	6.00	6.48	7.96
	6H	9.50	9.92	10.60	11.02	12.49	5.32	5.74	6.42	6.84	8.31
	8H	9.67	10.06	10.77	11.15	12.64	5.45	5.83	6.54	6.93	8.42
	12H	9.76	10.11	10.87	11.22	12.71	5.50	5.85	6.62	6.96	8.45
8H	4H	8.96	9.34	10.05	10.44	11.93	5.18	5.57	6.28	6.67	8.15
	6H	9.51	9.83	10.63	10.97	12.45	5.69	6.01	6.81	7.15	8.63
	8H	9.72	10.00	10.85	11.12	12.63	5.88	6.16	7.00	7.27	8.78
	12H	9.85	10.10	10.98	11.21	12.76	5.99	6.23	7.12	7.35	8.89
12H	4H	8.90	9.25	10.02	10.36	11.86	5.18	5.53	6.30	6.64	8.14
	6H	9.49	9.77	10.61	10.89	12.39	5.74	6.02	6.86	7.14	8.64
	8H	9.70	9.95	10.83	11.06	12.60	5.94	6.19	7.07	7.30	8.84

END OF REPORT