

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913909

Luminaire Tested: DFN2DIP-PN3F0-040D080US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913909
REPORT IS A COMBINATION OF REPORTS P901103 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D080US927-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9411.1 lumens
Efficiency: N/A
Efficacy: 97.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 96.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

Luminous Intensity Polar Plot

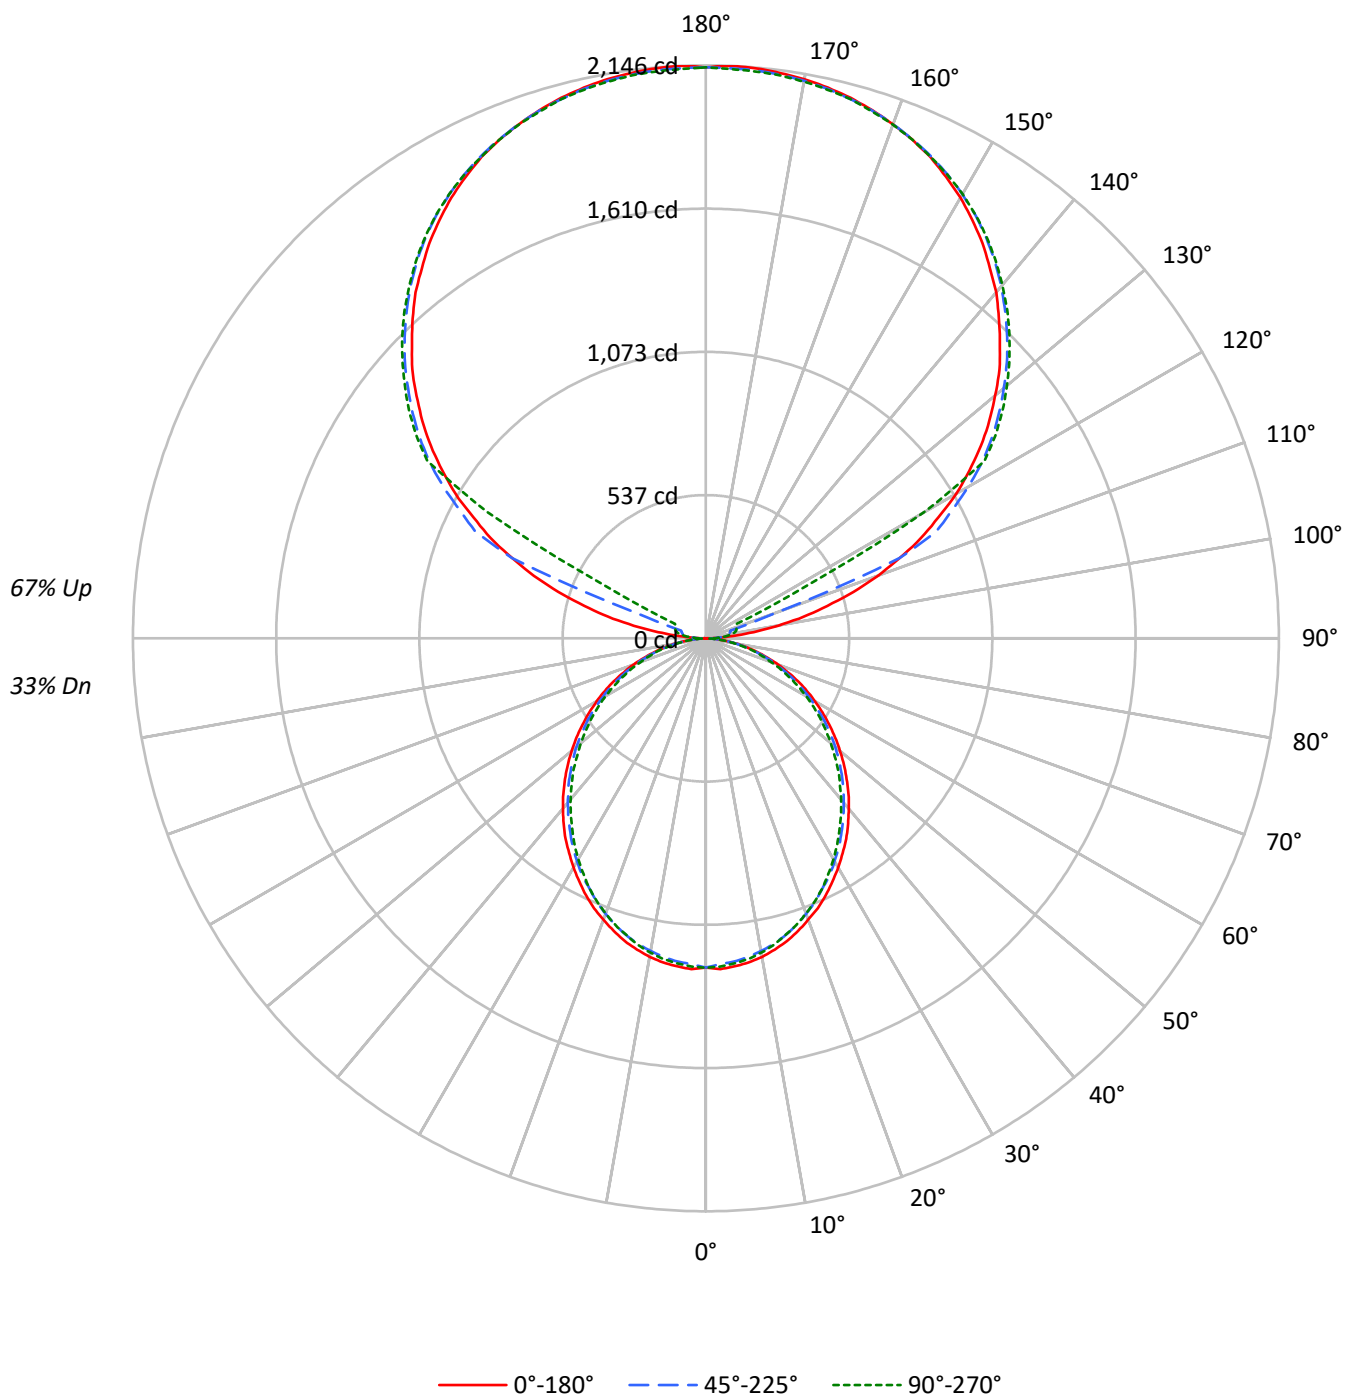

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1441	1441	1441
5°	1443	1420	1430
10°	1430	1400	1410
15°	1408	1376	1379
20°	1379	1343	1348
25°	1350	1304	1311
30°	1314	1267	1265
35°	1279	1224	1216
40°	1237	1180	1170
45°	1195	1137	1122
50°	1148	1091	1067
55°	1100	1038	1017
60°	1045	975	959
65°	985	909	890
70°	909	830	816
75°	803	734	747
80°	675	612	616
85°	477	405	402

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1442 cd/sqm

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.2
10°-20°	326.5	3.5
20°-30°	479.8	5.1
30°-40°	557.3	5.9
40°-50°	556.6	5.9
50°-60°	485.3	5.2
60°-70°	358.8	3.8
70°-80°	203.0	2.2
80°-90°	57.3	0.6
90°-100°	70.5	0.7
100°-110°	262.9	2.8
110°-120°	697.3	7.4
120°-130°	1156.5	12.3
130°-140°	1228.4	13.1
140°-150°	1141.7	12.1
150°-160°	917.9	9.8
160°-170°	591.5	6.3
170°-180°	203.6	2.2
0°-30°	922.4	9.8
0°-40°	1479.7	15.7
0°-60°	2521.7	26.8
0°-90°	3140.8	33.4
90°-120°	1030.7	11.0
90°-150°	4557.3	48.4
90°-180°	6270.0	66.6
0°-180°	9411.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	2	18	31	39	42	9
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8

TEST NUMBER: P913909

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.73	7.46	7.82	8.55	10.04	6.29	7.02	7.38	8.11	9.60
	3H	8.37	9.03	9.47	10.12	11.63	7.89	8.55	8.99	9.64	11.15
	4H	8.95	9.57	10.06	10.67	12.18	8.47	9.09	9.57	10.18	11.70
	6H	9.34	9.91	10.46	11.01	12.54	8.85	9.42	9.97	10.52	12.05
	8H	9.44	9.98	10.56	11.10	12.62	8.95	9.49	10.07	10.61	12.13
	12H	9.48	10.00	10.60	11.11	12.65	8.98	9.50	10.11	10.61	12.15
4H	2H	7.17	7.79	8.29	8.89	10.40	6.82	7.44	7.94	8.54	10.05
	3H	9.02	9.54	10.14	10.66	12.19	8.62	9.13	9.74	10.26	11.78
	4H	9.72	10.20	10.85	11.31	12.86	9.31	9.78	10.43	10.89	12.44
	6H	10.22	10.63	11.36	11.77	13.31	9.80	10.21	10.93	11.35	12.88
	8H	10.37	10.75	11.50	11.88	13.43	9.94	10.32	11.07	11.45	13.00
	12H	10.43	10.78	11.58	11.92	13.48	9.99	10.34	11.14	11.48	13.04
8H	4H	9.90	10.29	11.04	11.41	12.97	9.53	9.91	10.67	11.04	12.60
	6H	10.52	10.84	11.67	12.01	13.56	10.15	10.46	11.30	11.63	13.18
	8H	10.74	11.01	11.90	12.16	13.73	10.35	10.63	11.51	11.78	13.35
	12H	10.86	11.10	12.02	12.25	13.85	10.46	10.70	11.62	11.85	13.45
12H	4H	9.88	10.23	11.03	11.37	12.93	9.52	9.87	10.67	11.01	12.56
	6H	10.55	10.82	11.71	11.97	13.54	10.19	10.46	11.34	11.61	13.18
	8H	10.78	11.02	11.94	12.17	13.77	10.41	10.65	11.57	11.80	13.40

END OF REPORT