

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913925

Luminaire Tested: DFN2DIP-PN3F0-050D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913925
REPORT IS A COMBINATION OF REPORTS P901063 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D050US927-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7842.6 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 82.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

Luminous Intensity Polar Plot

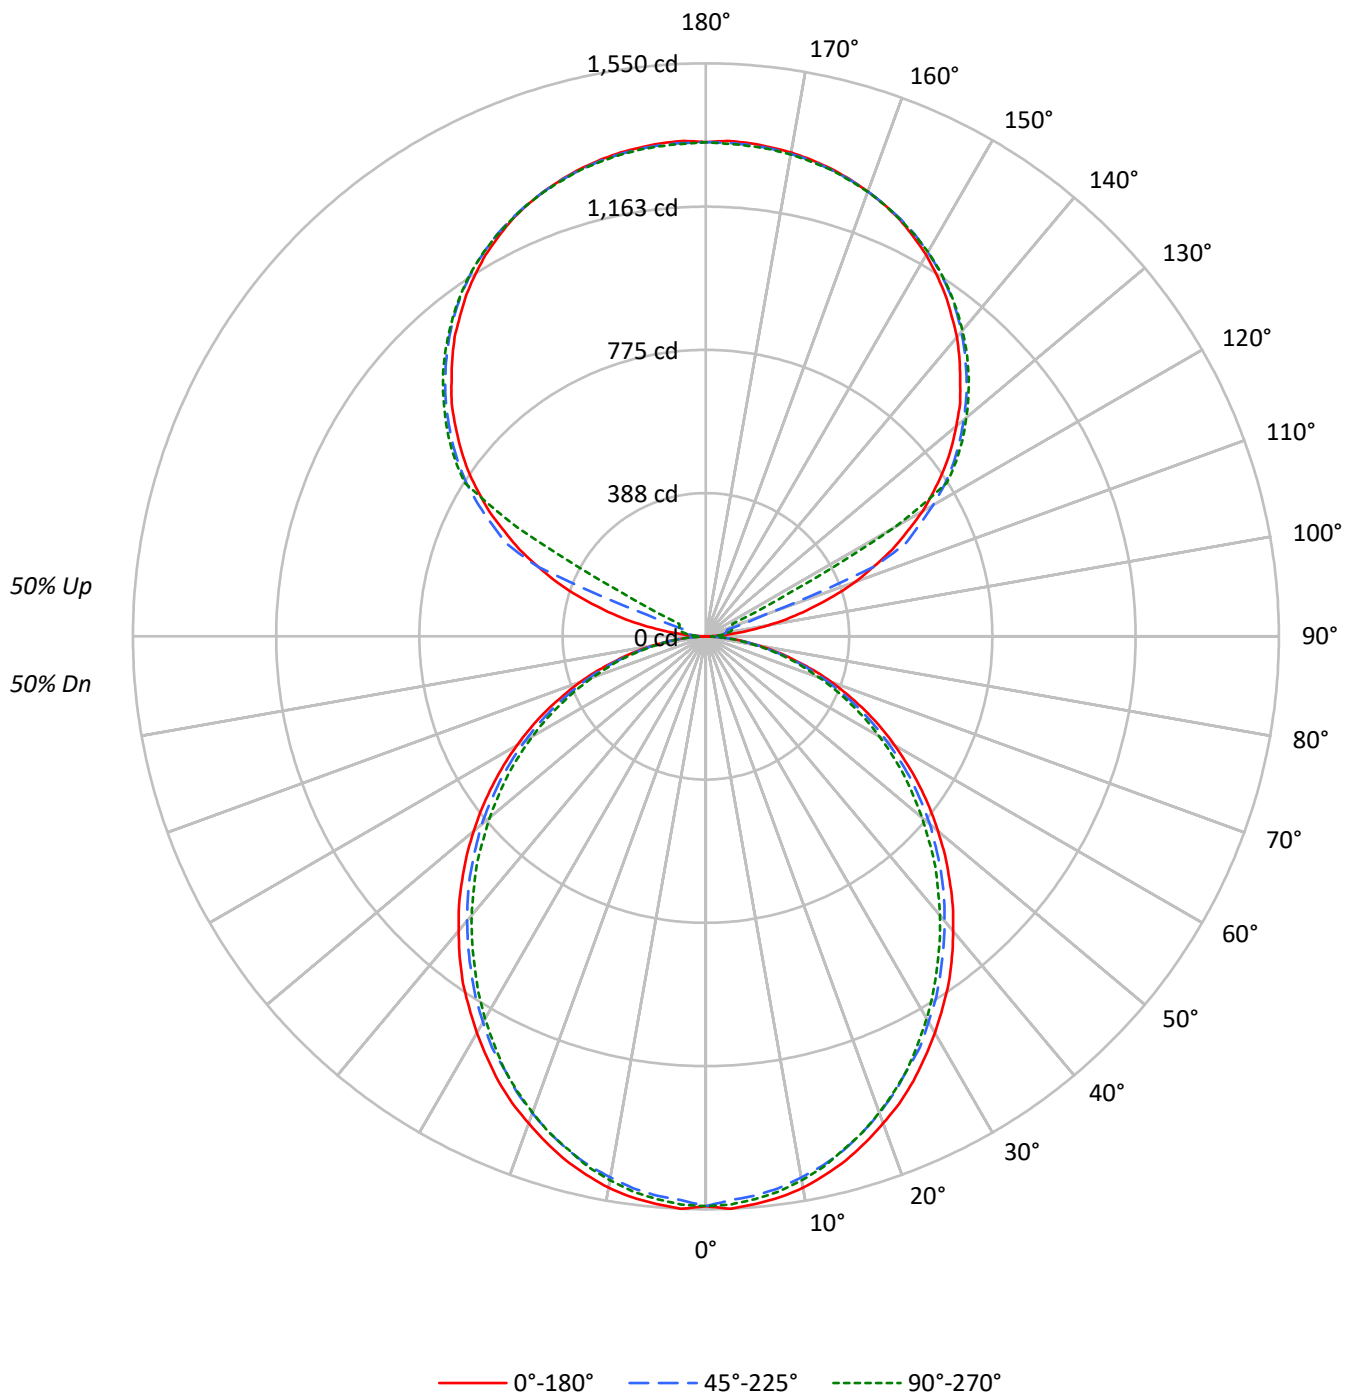

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1802	1802	1802
5°	1803	1775	1788
10°	1788	1750	1763
15°	1760	1720	1724
20°	1724	1679	1685
25°	1687	1630	1639
30°	1642	1584	1582
35°	1599	1530	1521
40°	1546	1475	1463
45°	1493	1421	1403
50°	1435	1363	1334
55°	1375	1297	1271
60°	1306	1218	1198
65°	1231	1137	1112
70°	1136	1037	1020
75°	1004	918	933
80°	844	765	770
85°	595	506	502

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1493 cd/sqm

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	145.1	1.8
10°-20°	408.1	5.2
20°-30°	599.8	7.6
30°-40°	696.6	8.9
40°-50°	695.8	8.9
50°-60°	606.7	7.7
60°-70°	448.5	5.7
70°-80°	253.7	3.2
80°-90°	69.3	0.9
90°-100°	44.1	0.6
100°-110°	164.3	2.1
110°-120°	435.8	5.6
120°-130°	722.8	9.2
130°-140°	767.8	9.8
140°-150°	713.6	9.1
150°-160°	573.7	7.3
160°-170°	369.7	4.7
170°-180°	127.2	1.6
0°-30°	1153.0	14.7
0°-40°	1849.6	23.6
0°-60°	3152.1	40.2
0°-90°	3923.6	50.0
90°-120°	644.2	8.2
90°-150°	2848.4	36.3
90°-180°	3919.0	50.0
0°-180°	7842.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1541	1541	1541	1541	1541	
5°	1541	1535	1519	1531	1528	146
15°	1467	1458	1439	1445	1438	413
25°	1328	1316	1291	1294	1291	611
35°	1146	1131	1107	1098	1091	715
45°	932	922	900	883	877	719
55°	706	697	679	661	654	631
65°	476	467	452	439	431	470
75°	249	246	238	230	233	266
85°	61	59	58	53	52	68
90°	1	12	19	24	26	7
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1541.2	1541.2	1541.2	1541.2	1541.2
2.5°	1550.1	1542.8	1526.5	1541.2	1538.4
5°	1541.2	1535.4	1519.0	1530.8	1528.0
7.5°	1530.8	1522.0	1505.7	1517.7	1514.7
10°	1514.7	1504.3	1486.5	1498.3	1493.9
12.5°	1492.3	1483.5	1465.8	1473.1	1470.1
15°	1467.1	1458.3	1439.0	1445.0	1437.6
17.5°	1436.0	1427.2	1407.9	1415.2	1407.9
20°	1401.9	1393.1	1372.4	1376.7	1370.9
22.5°	1367.9	1354.6	1335.2	1335.2	1332.2
25°	1327.9	1316.1	1290.9	1293.7	1290.9
27.5°	1283.3	1273.0	1253.8	1249.3	1242.0
30°	1239.0	1227.1	1204.9	1200.5	1194.5
32.5°	1191.5	1182.7	1159.0	1150.0	1144.1
35°	1145.6	1130.8	1107.1	1098.1	1090.8
37.5°	1093.7	1080.4	1056.6	1046.2	1038.9
40°	1040.5	1028.5	1004.7	991.5	985.6
42.5°	988.6	976.6	953.0	938.0	929.2
45°	932.2	921.9	899.5	883.4	877.3
47.5°	877.3	867.0	843.3	826.9	818.1
50°	819.5	812.1	791.4	770.6	763.2
52.5°	763.2	752.8	733.6	717.3	706.9
55°	705.5	696.6	678.7	661.0	653.6
57.5°	647.6	640.2	620.9	603.2	597.1
60°	589.8	584.0	563.2	546.8	542.5
62.5°	533.5	523.2	508.3	493.5	487.6
65°	475.8	466.8	452.0	438.7	431.3
67.5°	416.5	409.0	395.8	385.4	379.4
70°	361.6	355.7	342.3	331.9	326.1
72.5°	305.4	299.4	292.0	281.6	277.2
75°	248.9	246.1	238.5	229.7	232.7
77.5°	198.6	192.6	189.6	185.2	180.9
80°	148.3	146.7	143.7	139.3	136.3
82.5°	100.8	100.8	99.3	93.4	93.4
85°	60.7	59.3	57.8	53.3	51.9
87.5°	26.7	23.8	20.8	16.3	14.8
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P913925

CATALOG NUMBER: DFN2DIP-PN3F0-050D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.28	10.14	10.24	11.11	12.39	8.84	9.70	9.80	10.68	11.95
	3H	10.94	11.71	11.90	12.69	13.98	10.45	11.23	11.42	12.21	13.50
	4H	11.52	12.25	12.50	13.24	14.54	11.03	11.77	12.02	12.75	14.05
	6H	11.91	12.59	12.91	13.58	14.89	11.43	12.10	12.42	13.09	14.40
	8H	12.02	12.66	13.02	13.67	14.98	11.53	12.17	12.53	13.18	14.49
	12H	12.06	12.67	13.07	13.67	15.01	11.57	12.18	12.57	13.18	14.51
4H	2H	9.74	10.47	10.73	11.46	12.76	9.39	10.12	10.38	11.11	12.41
	3H	11.60	12.21	12.59	13.22	14.54	11.20	11.81	12.19	12.82	14.14
	4H	12.31	12.87	13.31	13.87	15.21	11.89	12.45	12.90	13.46	14.80
	6H	12.82	13.30	13.83	14.33	15.66	12.39	12.87	13.41	13.91	15.24
	8H	12.96	13.41	13.98	14.44	15.79	12.54	12.99	13.55	14.01	15.36
	12H	13.03	13.44	14.07	14.48	15.83	12.60	13.00	13.63	14.04	15.40
8H	4H	12.50	12.95	13.52	13.97	15.32	12.13	12.58	13.15	13.60	14.95
	6H	13.12	13.50	14.17	14.56	15.91	12.75	13.12	13.79	14.19	15.53
	8H	13.34	13.67	14.39	14.72	16.09	12.96	13.28	14.01	14.34	15.70
	12H	13.47	13.76	14.52	14.80	16.21	13.07	13.36	14.12	14.40	15.81
12H	4H	12.48	12.89	13.52	13.93	15.29	12.12	12.53	13.16	13.57	14.92
	6H	13.15	13.48	14.20	14.53	15.90	12.79	13.12	13.84	14.17	15.53
	8H	13.39	13.68	14.44	14.72	16.13	13.02	13.31	14.07	14.35	15.76

END OF REPORT