

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913932

Luminaire Tested: DFN2DIP-PN3F0-050D070US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913932
REPORT IS A COMBINATION OF REPORTS P899571 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D070US927-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8828.9 lumens
Efficiency: N/A
Efficacy: 88.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 99.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFLL

Luminous Intensity Polar Plot

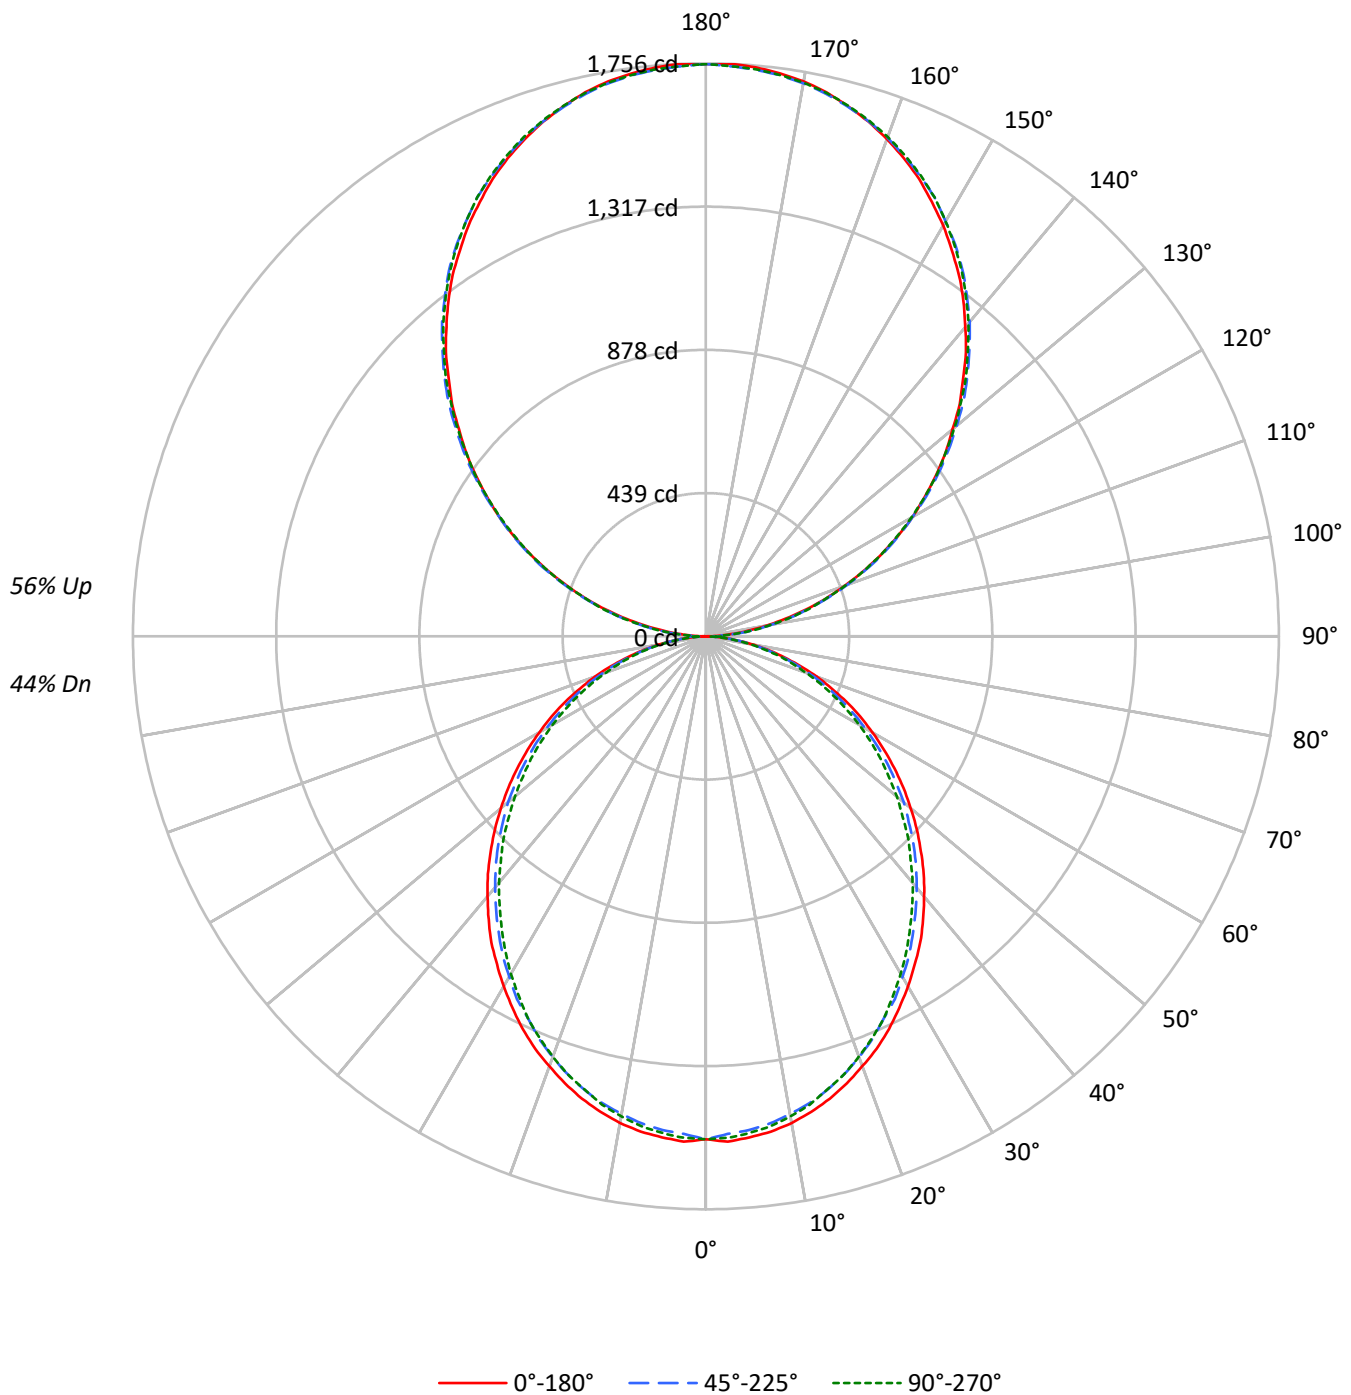

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	45	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	24	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1802	1802	1802
5°	1803	1775	1788
10°	1788	1750	1763
15°	1760	1720	1724
20°	1724	1679	1685
25°	1687	1630	1639
30°	1642	1584	1582
35°	1599	1530	1521
40°	1546	1475	1463
45°	1493	1421	1403
50°	1435	1363	1334
55°	1375	1297	1271
60°	1306	1218	1198
65°	1231	1137	1112
70°	1136	1037	1020
75°	1004	918	933
80°	844	765	770
85°	595	506	502

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1737 cd/sqm

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	145.1	1.6
10°-20°	408.1	4.6
20°-30°	599.8	6.8
30°-40°	696.6	7.9
40°-50°	695.8	7.9
50°-60°	606.7	6.9
60°-70°	448.5	5.1
70°-80°	253.7	2.9
80°-90°	71.9	0.8
90°-100°	108.5	1.2
100°-110°	344.8	3.9
110°-120°	590.1	6.7
120°-130°	776.1	8.8
130°-140°	871.1	9.9
140°-150°	854.2	9.7
150°-160°	716.6	8.1
160°-170°	475.2	5.4
170°-180°	166.1	1.9
0°-30°	1153.0	13.1
0°-40°	1849.6	20.9
0°-60°	3152.1	35.7
0°-90°	3926.3	44.5
90°-120°	1043.4	11.8
90°-150°	3544.8	40.1
90°-180°	4903.0	55.5
0°-180°	8828.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1541	1541	1541	1541	1541	
5°	1541	1535	1519	1531	1528	146
15°	1467	1458	1439	1445	1438	413
25°	1328	1316	1291	1294	1291	611
35°	1146	1131	1107	1098	1091	715
45°	932	922	900	883	877	719
55°	706	697	679	661	654	631
65°	476	467	452	439	431	470
75°	249	246	238	230	233	266
85°	61	59	58	53	52	68
90°	2	19	52	49	50	9
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1372	1373	1367	845
155°	1546	1551	1556	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1541.2	1541.2	1541.2	1541.2	1541.2
2.5°	1550.1	1542.8	1526.5	1541.2	1538.4
5°	1541.2	1535.4	1519.0	1530.8	1528.0
7.5°	1530.8	1522.0	1505.7	1517.7	1514.7
10°	1514.7	1504.3	1486.5	1498.3	1493.9
12.5°	1492.3	1483.5	1465.8	1473.1	1470.1
15°	1467.1	1458.3	1439.0	1445.0	1437.6
17.5°	1436.0	1427.2	1407.9	1415.2	1407.9
20°	1401.9	1393.1	1372.4	1376.7	1370.9
22.5°	1367.9	1354.6	1335.2	1335.2	1332.2
25°	1327.9	1316.1	1290.9	1293.7	1290.9
27.5°	1283.3	1273.0	1253.8	1249.3	1242.0
30°	1239.0	1227.1	1204.9	1200.5	1194.5
32.5°	1191.5	1182.7	1159.0	1150.0	1144.1
35°	1145.6	1130.8	1107.1	1098.1	1090.8
37.5°	1093.7	1080.4	1056.6	1046.2	1038.9
40°	1040.5	1028.5	1004.7	991.5	985.6
42.5°	988.6	976.6	953.0	938.0	929.2
45°	932.2	921.9	899.5	883.4	877.3
47.5°	877.3	867.0	843.3	826.9	818.1
50°	819.5	812.1	791.4	770.6	763.2
52.5°	763.2	752.8	733.6	717.3	706.9
55°	705.5	696.6	678.7	661.0	653.6
57.5°	647.6	640.2	620.9	603.2	597.1
60°	589.8	584.0	563.2	546.8	542.5
62.5°	533.5	523.2	508.3	493.5	487.6
65°	475.8	466.8	452.0	438.7	431.3
67.5°	416.5	409.0	395.8	385.4	379.4
70°	361.6	355.7	342.3	331.9	326.1
72.5°	305.4	299.4	292.0	281.6	277.2
75°	248.9	246.1	238.5	229.7	232.7
77.5°	198.6	192.6	189.6	185.2	180.9
80°	148.3	146.7	143.7	139.3	136.3
82.5°	100.8	100.8	99.3	93.4	93.4
85°	60.7	59.3	57.8	53.3	51.9
87.5°	26.7	23.8	20.8	16.3	14.8
90°	1.6	19.0	51.8	48.6	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.7	94.7	92.0
97.5°	128.5	142.2	148.1	148.1	148.1
100°	187.7	199.9	204.1	204.1	202.5
102.5°	250.1	259.0	264.9	266.5	264.9
105°	318.3	322.5	325.7	328.4	328.4
107.5°	386.0	392.3	392.3	393.4	386.0
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.4	531.4	529.8	525.5	522.4
115°	592.2	600.6	598.0	596.4	592.2
117.5°	661.4	673.0	665.7	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.1	797.8	794.6
125°	861.3	874.5	870.3	865.5	864.0
127.5°	926.3	942.7	936.9	930.6	926.3
130°	987.1	1006.1	1003.5	1000.4	994.5
132.5°	1055.3	1070.2	1071.2	1063.8	1059.5
135°	1114.0	1130.4	1133.6	1131.9	1127.7
137.5°	1179.6	1192.8	1195.4	1194.4	1188.0
140°	1237.2	1250.5	1257.8	1257.8	1252.0
142.5°	1296.4	1309.6	1313.8	1315.4	1309.6
145°	1352.5	1363.0	1371.5	1373.1	1367.3
147.5°	1402.7	1415.9	1422.3	1424.9	1419.1
150°	1454.5	1463.5	1469.3	1474.1	1469.3
152.5°	1500.5	1509.5	1516.9	1522.7	1516.9
155°	1546.5	1550.7	1555.5	1562.9	1558.1
157.5°	1586.2	1589.4	1592.0	1602.6	1595.1
160°	1621.6	1624.8	1626.3	1635.3	1629.0
162.5°	1654.4	1654.4	1656.0	1666.0	1658.6
165°	1682.4	1680.8	1680.8	1691.4	1683.9
167.5°	1707.8	1703.0	1703.0	1713.6	1706.2
170°	1726.8	1722.6	1721.0	1731.5	1722.6
172.5°	1740.0	1735.7	1734.2	1744.8	1735.7
175°	1750.6	1746.4	1743.2	1753.7	1744.8
177.5°	1756.4	1752.1	1749.0	1758.0	1749.0
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P913932

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.74	9.56	9.75	10.57	11.92	8.30	9.12	9.31	10.13	11.48
	3H	10.39	11.12	11.41	12.15	13.51	9.91	10.64	10.92	11.66	13.03
	4H	10.97	11.67	12.00	12.69	14.07	10.49	11.18	11.52	12.21	13.58
	6H	11.37	12.00	12.40	13.03	14.42	10.88	11.51	11.91	12.54	13.93
	8H	11.47	12.07	12.51	13.12	14.51	10.98	11.58	12.02	12.63	14.02
	12H	11.51	12.09	12.56	13.13	14.54	11.02	11.59	12.06	12.63	14.04
4H	2H	9.19	9.89	10.23	10.91	12.29	8.84	9.54	9.88	10.56	11.94
	3H	11.05	11.63	12.09	12.68	14.07	10.65	11.22	11.69	12.28	13.67
	4H	11.76	12.29	12.80	13.33	14.74	11.34	11.87	12.39	12.91	14.33
	6H	12.26	12.72	13.32	13.79	15.19	11.84	12.29	12.90	13.36	14.77
	8H	12.41	12.83	13.47	13.89	15.32	11.98	12.41	13.04	13.47	14.89
	12H	12.48	12.86	13.55	13.94	15.36	12.04	12.42	13.12	13.50	14.93
8H	4H	11.95	12.37	13.00	13.43	14.85	11.57	12.00	12.63	13.06	14.48
	6H	12.57	12.92	13.65	14.02	15.44	12.19	12.54	13.27	13.65	15.07
	8H	12.78	13.09	13.87	14.18	15.62	12.40	12.71	13.49	13.79	15.23
	12H	12.91	13.18	14.00	14.26	15.74	12.51	12.78	13.60	13.86	15.34
12H	4H	11.93	12.31	13.00	13.39	14.81	11.57	11.95	12.64	13.03	14.45
	6H	12.59	12.90	13.68	13.99	15.43	12.23	12.54	13.32	13.63	15.06
	8H	12.83	13.10	13.92	14.18	15.66	12.46	12.73	13.55	13.81	15.29

END OF REPORT