

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913938

Luminaire Tested: DFN2DIP-PN3F0-050D080US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913938
REPORT IS A COMBINATION OF REPORTS P899586 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D080US927-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8975.4 lumens
Efficiency: N/A
Efficacy: 84.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 106.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLLFLL

Luminous Intensity Polar Plot

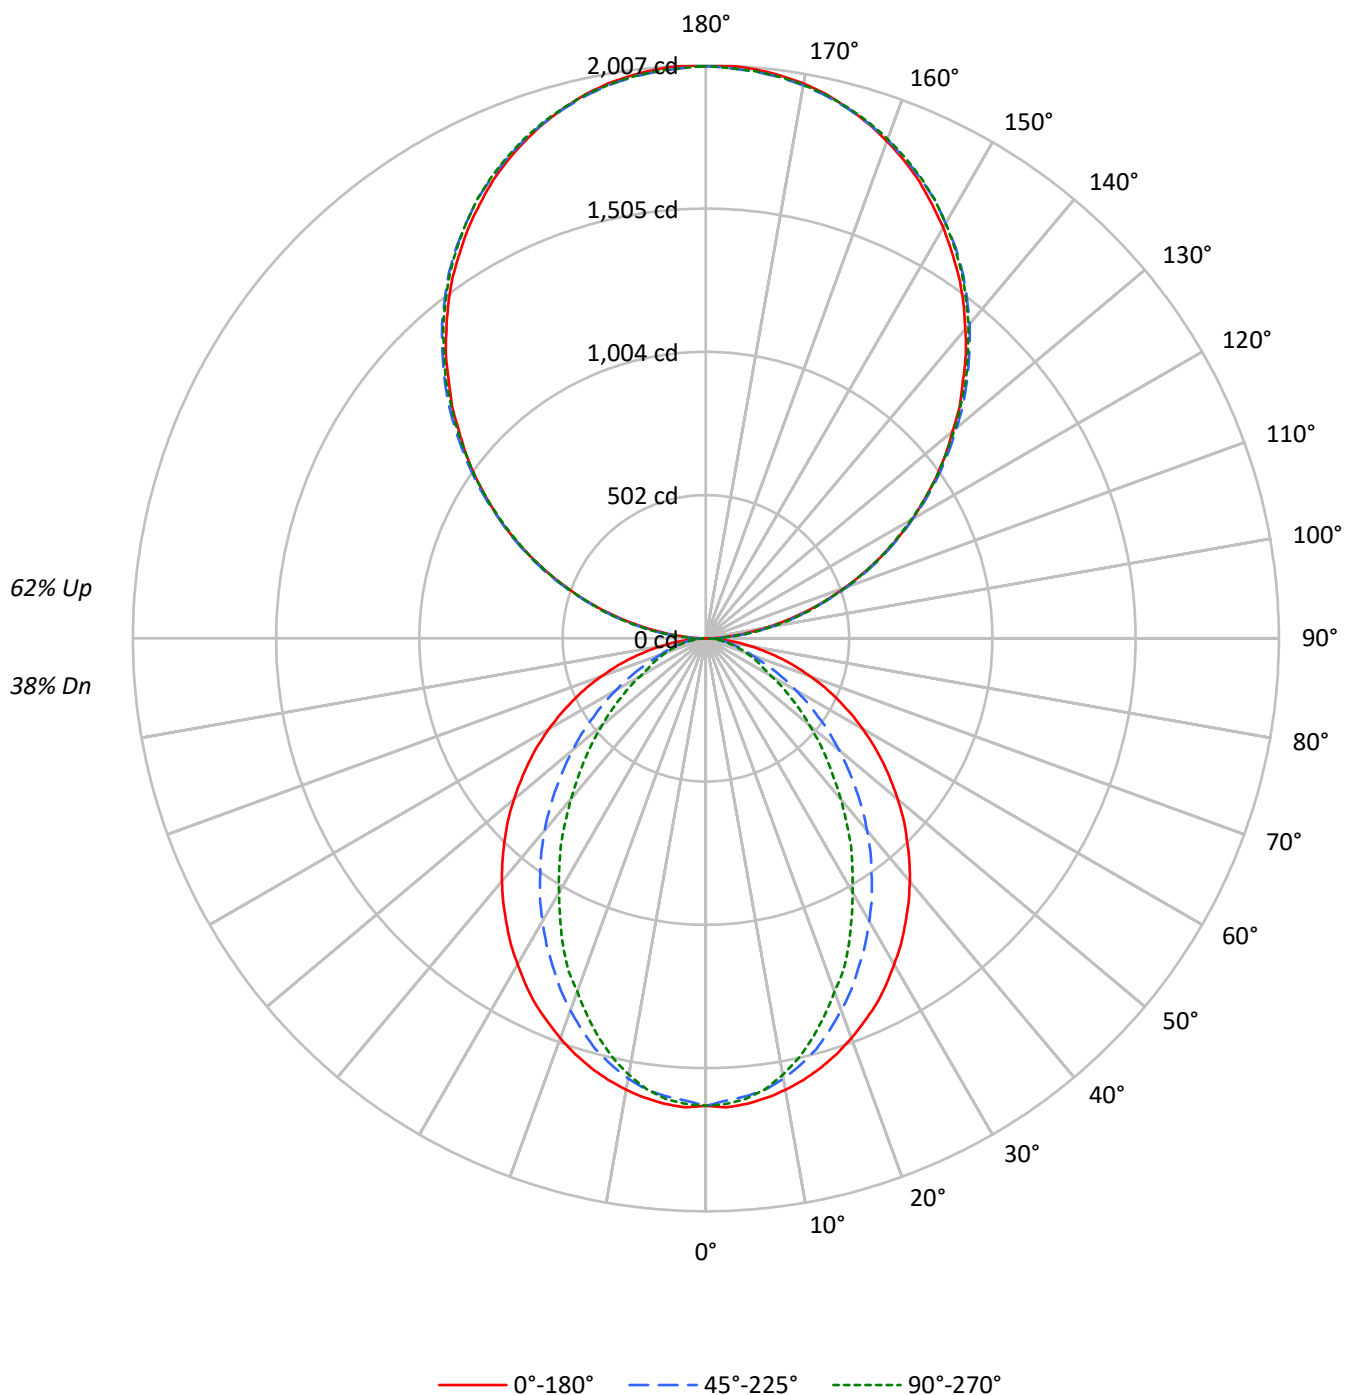

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	76	76	76	60	60	60	45	45	45
1	95	91	88	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	80	74	69	79	73	68	64	59	56	53	47	45	43	36	34	33
3	80	71	64	58	72	64	58	54	53	48	45	42	39	37	32	30	28
4	73	63	55	49	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	42	61	51	44	39	42	37	33	34	30	28	26	24	22
6	62	50	42	37	56	46	39	34	38	33	29	31	27	24	24	21	19
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	17
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	49	38	30	26	45	35	28	24	29	24	21	24	20	17	19	16	14
10	46	35	28	23	42	32	26	21	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1914	1914	1914
5°	1916	1882	1895
10°	1895	1844	1832
15°	1868	1781	1736
20°	1833	1696	1618
25°	1796	1601	1505
30°	1747	1503	1361
35°	1700	1398	1235
40°	1651	1290	1090
45°	1595	1170	959
50°	1536	1049	831
55°	1475	920	709
60°	1404	785	582
65°	1323	648	524
70°	1224	521	473
75°	1099	456	428
80°	919	379	368
85°	625	246	272

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1986 cd/sqm

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	153.4	1.7
10°-20°	421.2	4.7
20°-30°	591.3	6.6
30°-40°	644.6	7.2
40°-50°	592.4	6.6
50°-60°	465.3	5.2
60°-70°	302.9	3.4
70°-80°	155.9	1.7
80°-90°	45.5	0.5
90°-100°	124.0	1.4
100°-110°	394.1	4.4
110°-120°	674.4	7.5
120°-130°	886.9	9.9
130°-140°	995.5	11.1
140°-150°	976.2	10.9
150°-160°	818.9	9.1
160°-170°	543.1	6.1
170°-180°	189.8	2.1
0°-30°	1165.9	13.0
0°-40°	1810.5	20.2
0°-60°	2868.2	32.0
0°-90°	3372.5	37.6
90°-120°	1192.5	13.3
90°-150°	4051.1	45.1
90°-180°	5603.0	62.4
0°-180°	8975.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1637	1637	1637	1637	1637	
5°	1637	1630	1610	1624	1619	155
15°	1557	1541	1490	1462	1448	439
25°	1413	1366	1268	1207	1185	650
35°	1218	1142	1012	918	886	762
45°	996	896	741	636	600	769
55°	757	641	481	393	364	676
65°	511	391	258	208	203	507
75°	273	169	118	108	107	288
85°	64	33	28	28	28	73
90°	2	22	59	56	57	9
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1637.0	1637.0	1637.0	1637.0	1637.0
2.5°	1644.4	1637.0	1620.7	1635.6	1632.6
5°	1637.0	1629.7	1610.3	1623.7	1619.3
7.5°	1623.7	1614.9	1594.1	1600.0	1592.5
10°	1605.9	1595.5	1566.0	1561.5	1552.6
12.5°	1583.7	1570.4	1530.3	1521.5	1505.1
15°	1557.0	1540.7	1490.4	1462.3	1447.5
17.5°	1525.9	1502.2	1439.9	1407.4	1383.6
20°	1490.4	1460.7	1386.6	1349.7	1317.0
22.5°	1451.9	1417.8	1331.8	1281.5	1259.3
25°	1413.3	1365.9	1268.1	1207.4	1185.1
27.5°	1367.5	1317.0	1208.9	1139.2	1105.2
30°	1318.6	1262.2	1143.7	1068.2	1028.1
32.5°	1271.1	1202.9	1081.6	992.6	955.5
35°	1217.8	1142.2	1011.9	918.5	885.9
37.5°	1165.9	1084.4	946.7	844.4	807.5
40°	1111.1	1022.3	878.4	773.3	734.8
42.5°	1054.9	960.0	810.4	700.7	663.8
45°	995.6	896.3	740.8	635.5	599.9
47.5°	939.3	834.2	674.1	568.9	536.3
50°	877.1	771.9	608.9	506.6	475.6
52.5°	816.3	705.1	546.7	448.9	420.8
55°	757.0	641.4	481.4	392.6	364.5
57.5°	696.3	577.8	423.7	340.8	317.0
60°	634.1	515.6	362.9	287.5	263.7
62.5°	573.4	454.9	311.1	240.0	228.2
65°	511.1	391.1	257.8	207.5	203.0
67.5°	451.9	331.8	207.5	182.2	177.8
70°	389.7	274.1	171.8	157.0	151.1
72.5°	330.4	220.7	143.7	131.9	128.9
75°	272.6	168.8	118.5	108.1	106.7
77.5°	214.8	119.9	93.4	87.4	84.4
80°	161.4	86.0	71.1	65.2	65.2
82.5°	112.6	57.8	48.9	45.9	45.9
85°	63.7	32.6	28.1	28.1	28.1
87.5°	23.8	11.8	11.8	10.4	10.4
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P913938

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.08	8.82	9.14	9.88	11.32	4.04	4.78	5.11	5.84	7.28
	3H	9.74	10.40	10.81	11.47	12.93	5.22	5.88	6.29	6.95	8.41
	4H	10.34	10.97	11.43	12.04	13.51	5.66	6.29	6.74	7.36	8.82
	6H	10.75	11.33	11.85	12.40	13.88	5.97	6.55	7.06	7.62	9.10
	8H	10.88	11.42	11.97	12.51	13.98	6.06	6.60	7.15	7.70	9.17
	12H	10.93	11.45	12.03	12.54	14.03	6.09	6.61	7.20	7.70	9.19
4H	2H	8.08	8.71	9.17	9.78	11.25	4.62	5.25	5.71	6.32	7.79
	3H	9.90	10.42	10.99	11.52	12.99	5.96	6.48	7.06	7.58	9.06
	4H	10.58	11.06	11.68	12.15	13.65	6.50	6.98	7.60	8.07	9.56
	6H	11.08	11.49	12.19	12.61	14.10	6.91	7.31	8.02	8.43	9.92
	8H	11.25	11.64	12.36	12.74	14.25	7.03	7.41	8.14	8.52	10.02
	12H	11.34	11.69	12.47	12.80	14.32	7.09	7.43	8.21	8.55	10.06
8H	4H	10.54	10.92	11.65	12.03	13.53	6.77	7.15	7.88	8.25	9.76
	6H	11.10	11.41	12.23	12.56	14.06	7.27	7.59	8.41	8.74	10.24
	8H	11.31	11.58	12.44	12.71	14.24	7.46	7.74	8.60	8.86	10.39
	12H	11.44	11.68	12.58	12.80	14.37	7.57	7.81	8.71	8.94	10.50
12H	4H	10.49	10.83	11.61	11.95	13.46	6.77	7.11	7.89	8.23	9.74
	6H	11.07	11.35	12.21	12.47	14.00	7.32	7.60	8.46	8.73	10.25
	8H	11.28	11.52	12.42	12.65	14.21	7.52	7.77	8.66	8.89	10.45

END OF REPORT