

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913953

Luminaire Tested: DFN2DIP-PN3F0-060D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913953
REPORT IS A COMBINATION OF REPORTS P901065 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D050US927-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8626.8 lumens
Efficiency: N/A
Efficacy: 91.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

Luminous Intensity Polar Plot

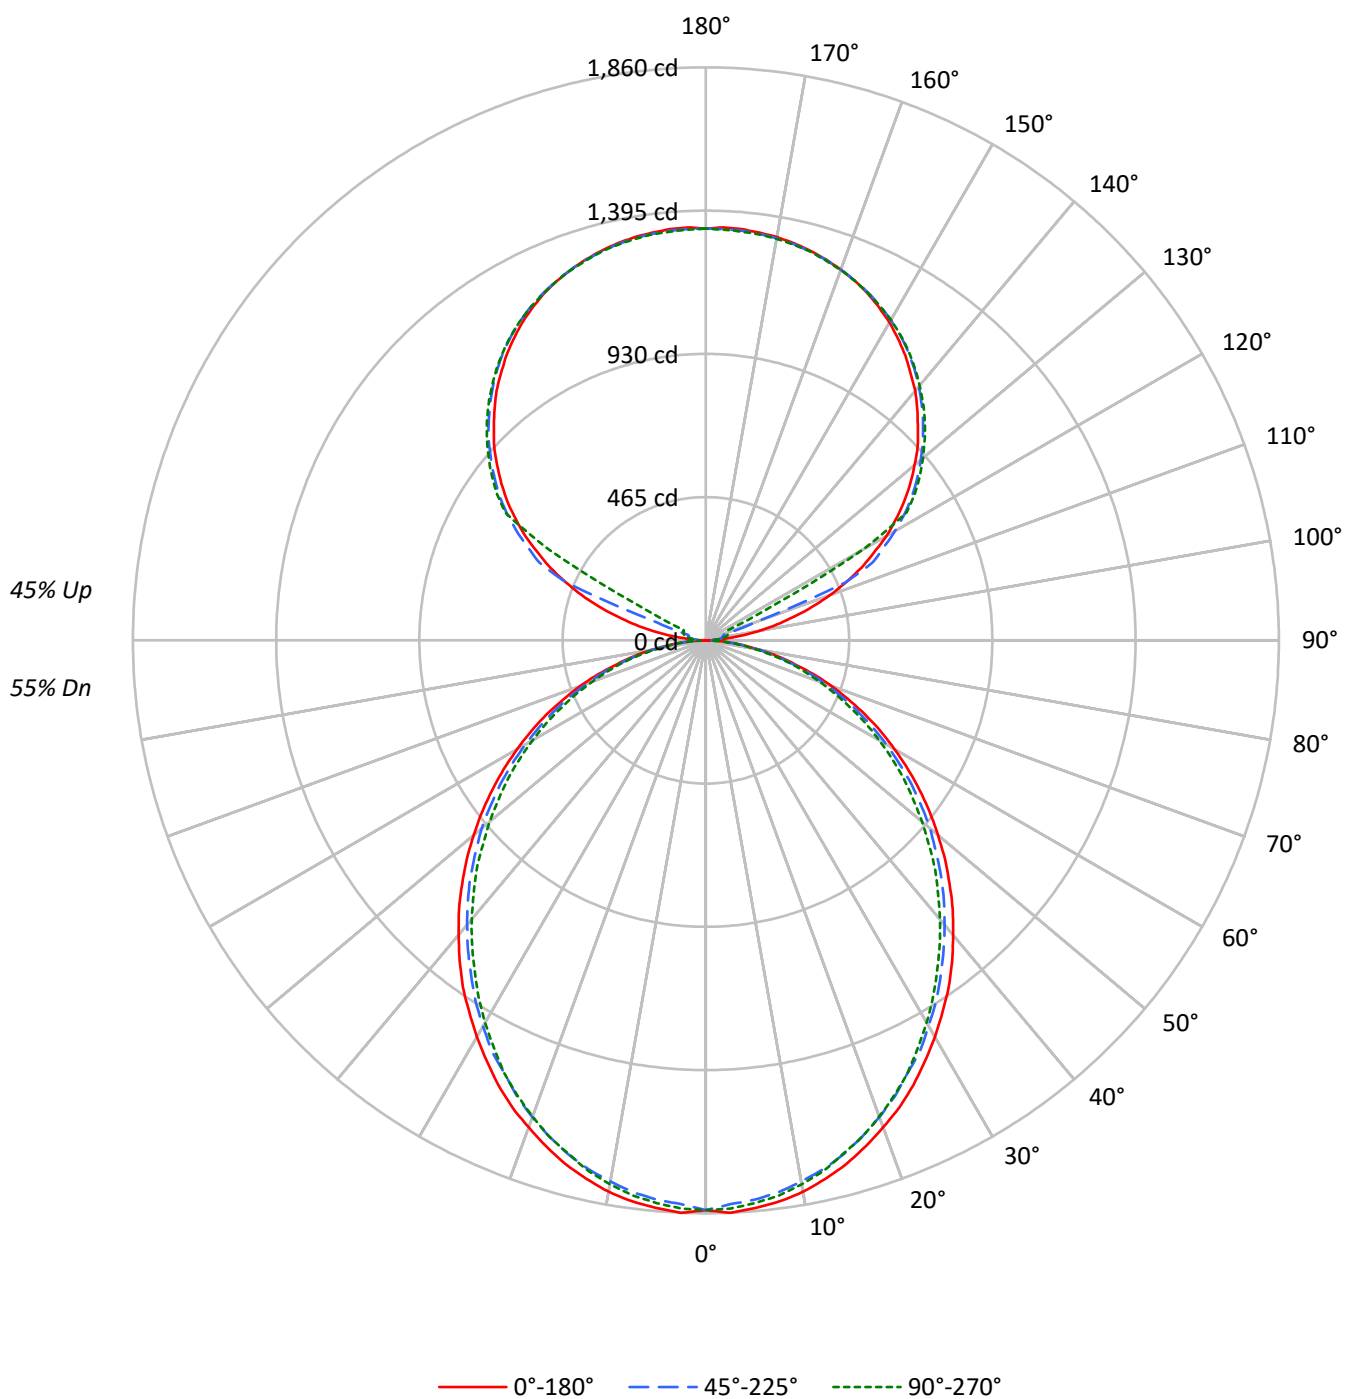

TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2162	2162	2162
5°	2164	2130	2145
10°	2145	2100	2115
15°	2112	2064	2069
20°	2069	2014	2022
25°	2025	1955	1967
30°	1970	1901	1898
35°	1919	1836	1825
40°	1855	1771	1755
45°	1792	1705	1684
50°	1722	1636	1601
55°	1650	1556	1525
60°	1567	1462	1438
65°	1477	1364	1335
70°	1363	1244	1224
75°	1205	1101	1120
80°	1013	918	924
85°	714	607	603

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1792 cd/sqm

TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	2.0
10°-20°	489.8	5.7
20°-30°	719.8	8.3
30°-40°	836.0	9.7
40°-50°	834.9	9.7
50°-60°	728.0	8.4
60°-70°	538.2	6.2
70°-80°	304.5	3.5
80°-90°	82.7	1.0
90°-100°	44.1	0.5
100°-110°	164.3	1.9
110°-120°	435.8	5.1
120°-130°	722.8	8.4
130°-140°	767.8	8.9
140°-150°	713.6	8.3
150°-160°	573.7	6.7
160°-170°	369.7	4.3
170°-180°	127.2	1.5
0°-30°	1383.6	16.0
0°-40°	2219.6	25.7
0°-60°	3782.5	43.8
0°-90°	4707.9	54.6
90°-120°	644.2	7.5
90°-150°	2848.4	33.0
90°-180°	3919.0	45.4
0°-180°	8626.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	1	12	19	24	26	8
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4



TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P913953

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.32	11.23	11.24	12.16	13.37	9.89	10.79	10.80	11.72	12.93
	3H	11.98	12.79	12.91	13.74	14.97	11.50	12.31	12.43	13.25	14.48
	4H	12.57	13.33	13.51	14.28	15.52	12.08	12.85	13.03	13.80	15.04
	6H	12.97	13.67	13.92	14.63	15.88	12.48	13.18	13.43	14.14	15.39
	8H	13.07	13.74	14.03	14.71	15.96	12.58	13.25	13.54	14.22	15.47
	12H	13.12	13.76	14.08	14.72	16.00	12.62	13.26	13.59	14.23	15.50
4H	2H	10.79	11.55	11.74	12.50	13.74	10.44	11.20	11.39	12.15	13.39
	3H	12.65	13.29	13.61	14.27	15.52	12.25	12.89	13.21	13.87	15.12
	4H	13.36	13.95	14.33	14.92	16.20	12.94	13.53	13.91	14.50	15.78
	6H	13.87	14.38	14.85	15.37	16.65	13.45	13.95	14.43	14.95	16.23
	8H	14.02	14.49	15.00	15.48	16.77	13.59	14.07	14.58	15.06	16.35
	12H	14.09	14.52	15.09	15.53	16.82	13.66	14.08	14.66	15.09	16.38
8H	4H	13.56	14.03	14.54	15.02	16.31	13.19	13.66	14.17	14.65	15.94
	6H	14.18	14.57	15.19	15.61	16.89	13.81	14.20	14.82	15.23	16.52
	8H	14.40	14.74	15.42	15.76	17.07	14.02	14.36	15.03	15.38	16.69
	12H	14.53	14.83	15.55	15.85	17.20	14.13	14.43	15.15	15.45	16.80
12H	4H	13.54	13.97	14.55	14.98	16.27	13.18	13.61	14.18	14.61	15.91
	6H	14.21	14.56	15.23	15.58	16.88	13.85	14.19	14.86	15.21	16.52
	8H	14.45	14.75	15.47	15.77	17.12	14.08	14.38	15.10	15.40	16.75

END OF REPORT