

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914017

Luminaire Tested: DFN2DIP-PN3F0-080D070US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914017
REPORT IS A COMBINATION OF REPORTS P901097 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D070US927-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11763.9 lumens
Efficiency: N/A
Efficacy: 87.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

Luminous Intensity Polar Plot

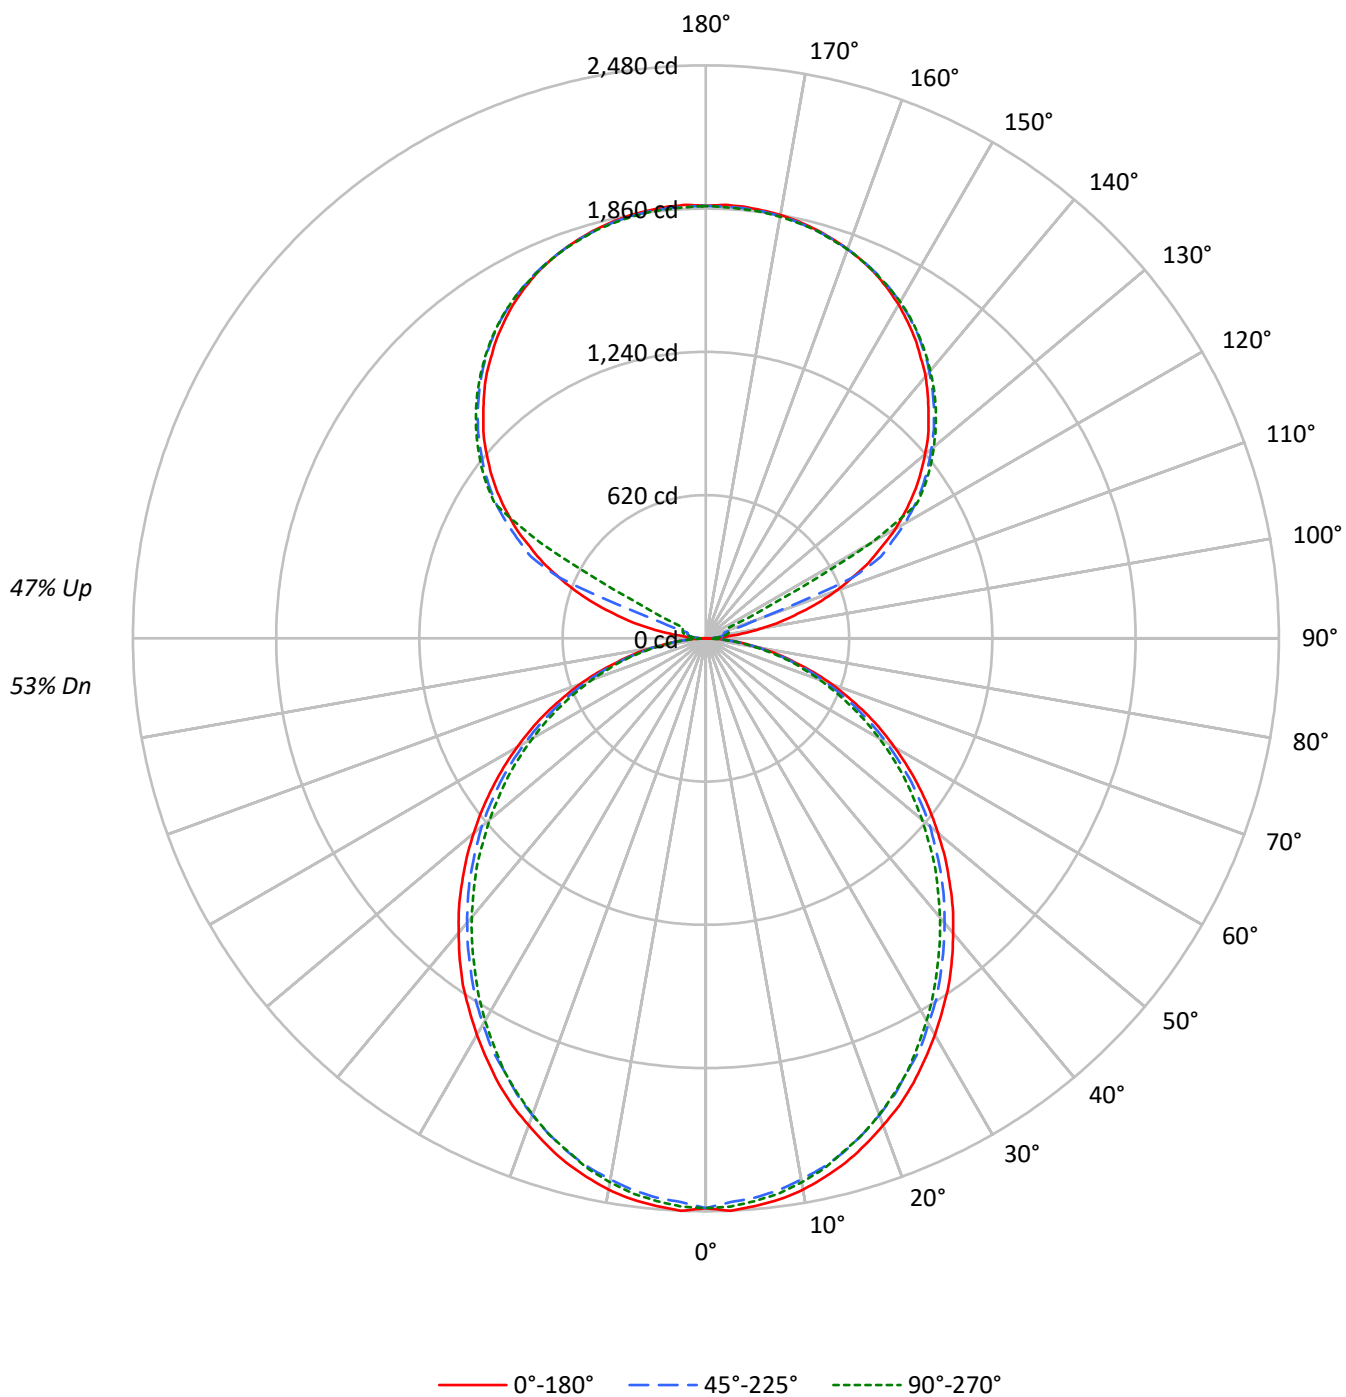

TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	94	90	87	91	87	84	81	75	72	70	63	61	60	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	53	47	51	46	42	44	40	36	37	33	31
5	69	57	49	43	63	53	46	41	46	40	36	39	35	31	33	30	27
6	63	51	43	37	59	48	41	35	41	36	31	35	31	28	30	26	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	31	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	26	22	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2883	2883	2883
5°	2885	2840	2860
10°	2860	2800	2820
15°	2817	2752	2759
20°	2758	2686	2696
25°	2700	2607	2623
30°	2627	2534	2530
35°	2558	2448	2433
40°	2474	2361	2340
45°	2389	2273	2245
50°	2297	2181	2135
55°	2200	2075	2033
60°	2090	1949	1917
65°	1970	1819	1780
70°	1817	1659	1632
75°	1606	1468	1493
80°	1351	1225	1232
85°	952	810	803

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2389 cd/sqm

TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	2.0
10°-20°	653.0	5.6
20°-30°	959.7	8.2
30°-40°	1114.6	9.5
40°-50°	1113.2	9.5
50°-60°	970.7	8.3
60°-70°	717.6	6.1
70°-80°	406.0	3.5
80°-90°	110.4	0.9
90°-100°	61.7	0.5
100°-110°	230.0	2.0
110°-120°	610.1	5.2
120°-130°	1011.9	8.6
130°-140°	1074.9	9.1
140°-150°	999.0	8.5
150°-160°	803.2	6.8
160°-170°	517.5	4.4
170°-180°	178.1	1.5
0°-30°	1844.8	15.7
0°-40°	2959.4	25.2
0°-60°	5043.4	42.9
0°-90°	6277.4	53.4
90°-120°	901.9	7.7
90°-150°	3987.7	33.9
90°-180°	5487.0	46.6
0°-180°	11763.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	1	16	27	34	36	11
95°	88	43	53	60	58	104
105°	412	452	83	97	103	440
115°	779	802	836	209	111	767
125°	1101	1119	1144	1154	1158	982
135°	1362	1384	1396	1410	1407	1052
145°	1580	1579	1602	1612	1605	988
155°	1740	1728	1744	1752	1742	802
165°	1834	1826	1830	1839	1830	518
175°	1876	1866	1869	1878	1865	178
180°	1871	1871	1871	1871	1871	

TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	1.3	16.2	27.0	33.9	36.5
92.5°	33.9	28.4	32.5	35.3	36.5
95°	87.9	43.3	52.8	59.7	58.2
97.5°	158.4	47.5	69.0	73.2	74.5
100°	239.8	54.2	77.2	87.9	90.7
102.5°	329.0	326.5	79.9	94.7	98.9
105°	411.7	452.3	82.6	97.4	102.9
107.5°	507.8	541.6	85.4	100.2	105.7
110°	600.0	628.3	237.0	101.6	106.9



TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	686.7	710.9	687.9	104.2	108.4
115°	778.6	801.6	835.5	208.6	111.1
117.5°	858.6	885.6	908.7	714.9	360.2
120°	947.9	968.2	992.7	1008.9	826.1
122.5°	1023.7	1045.4	1072.6	1080.6	1082.0
125°	1100.9	1118.6	1144.3	1153.8	1157.8
127.5°	1171.3	1190.3	1210.7	1224.2	1225.5
130°	1237.7	1259.4	1274.2	1289.2	1287.9
132.5°	1305.4	1323.1	1337.9	1350.1	1348.8
135°	1362.3	1384.0	1396.1	1409.8	1407.1
137.5°	1421.8	1438.1	1451.8	1465.3	1461.3
140°	1480.0	1491.0	1505.8	1518.0	1511.2
142.5°	1528.9	1538.4	1555.9	1566.7	1560.0
145°	1580.4	1579.0	1601.9	1611.5	1604.7
147.5°	1624.9	1621.0	1643.9	1650.7	1645.4
150°	1668.3	1658.9	1680.6	1688.6	1681.9
152.5°	1704.9	1694.1	1714.4	1722.5	1713.1
155°	1740.1	1728.0	1744.2	1752.3	1741.5
157.5°	1768.5	1757.8	1770.0	1779.5	1768.5
160°	1793.0	1784.8	1793.0	1801.0	1791.5
162.5°	1814.6	1806.5	1813.2	1822.7	1810.5
165°	1833.5	1825.5	1829.5	1839.0	1829.5
167.5°	1848.5	1840.2	1844.4	1853.9	1841.7
170°	1860.7	1852.5	1855.2	1864.7	1852.5
172.5°	1868.8	1860.7	1863.4	1872.9	1860.7
175°	1875.5	1866.0	1868.8	1878.2	1864.7
177.5°	1878.2	1868.8	1870.2	1879.7	1867.4
180°	1871.4	1871.4	1871.4	1871.4	1871.4

TEST NUMBER: P914017

CATALOG NUMBER: DFN2DIP-PN3F0-080D070US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.22	12.11	12.14	13.05	14.28	10.78	11.67	11.70	12.62	13.84
	3H	12.87	13.67	13.81	14.63	15.87	12.39	13.19	13.33	14.15	15.39
	4H	13.46	14.22	14.41	15.18	16.43	12.97	13.73	13.93	14.69	15.94
	6H	13.86	14.55	14.82	15.52	16.79	13.37	14.06	14.33	15.03	16.30
	8H	13.96	14.62	14.93	15.61	16.87	13.47	14.13	14.44	15.11	16.38
	12H	14.01	14.64	14.98	15.61	16.90	13.51	14.14	14.49	15.12	16.41
4H	2H	11.68	12.44	12.64	13.40	14.65	11.33	12.08	12.29	13.04	14.30
	3H	13.54	14.17	14.51	15.16	16.43	13.14	13.77	14.11	14.76	16.03
	4H	14.25	14.83	15.23	15.81	17.10	13.83	14.41	14.81	15.39	16.69
	6H	14.76	15.26	15.75	16.27	17.56	14.34	14.84	15.33	15.84	17.13
	8H	14.91	15.37	15.90	16.37	17.68	14.48	14.95	15.47	15.95	17.25
	12H	14.98	15.40	15.99	16.42	17.73	14.54	14.96	15.55	15.98	17.29
8H	4H	14.45	14.91	15.44	15.91	17.22	14.08	14.54	15.07	15.54	16.85
	6H	15.07	15.46	16.09	16.50	17.80	14.70	15.08	15.71	16.12	17.43
	8H	15.29	15.63	16.31	16.66	17.98	14.90	15.24	15.93	16.27	17.59
	12H	15.42	15.72	16.45	16.74	18.10	15.02	15.32	16.05	16.34	17.70
12H	4H	14.43	14.85	15.44	15.87	17.18	14.07	14.49	15.08	15.51	16.82
	6H	15.10	15.44	16.12	16.47	17.79	14.74	15.07	15.76	16.10	17.43
	8H	15.34	15.64	16.37	16.66	18.03	14.97	15.27	16.00	16.29	17.66

END OF REPORT