

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914027

Luminaire Tested: DFN2DIP-PN3F0-080D090US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914027
REPORT IS A COMBINATION OF REPORTS P901126 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D090US927-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12445.1 lumens
Efficiency: N/A
Efficacy: 82.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLLONL

Luminous Intensity Polar Plot

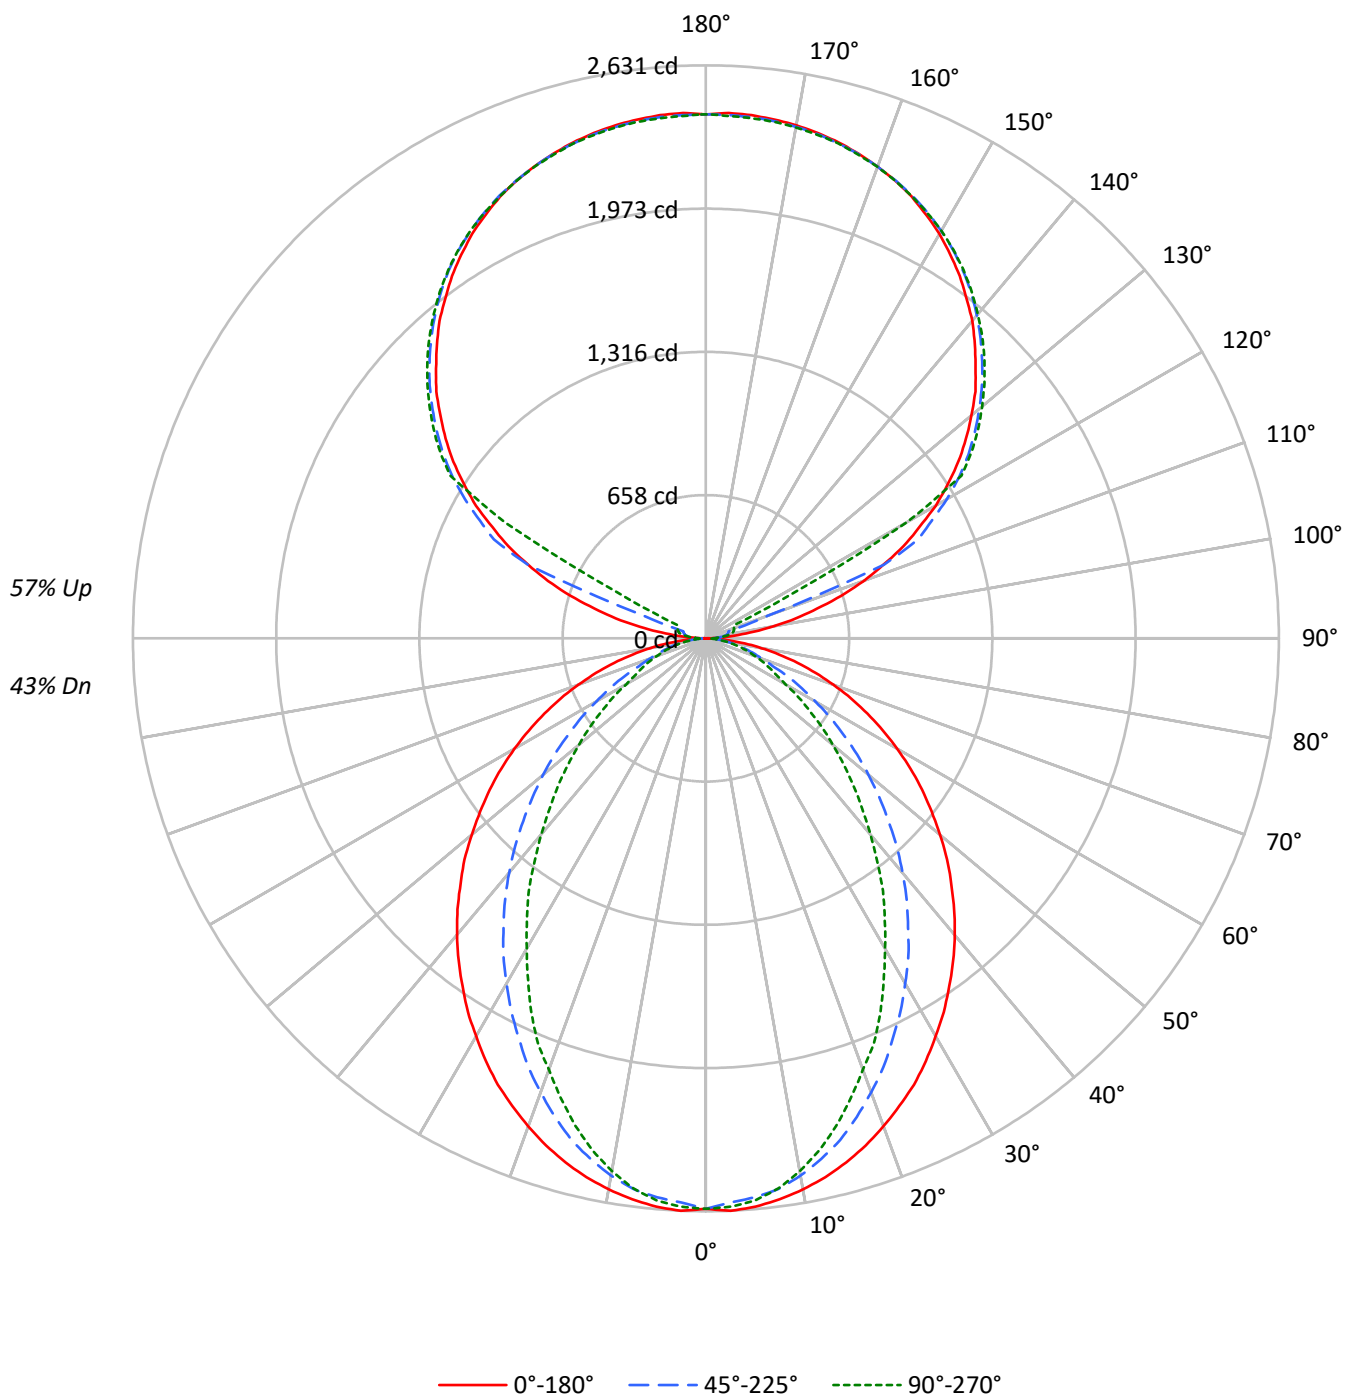

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	27	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	22	19
8	54	42	35	30	49	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3062	3062	3062
5°	3065	3011	3031
10°	3033	2950	2931
15°	2989	2850	2778
20°	2932	2714	2590
25°	2874	2561	2408
30°	2796	2405	2178
35°	2719	2238	1976
40°	2642	2064	1745
45°	2551	1872	1535
50°	2458	1679	1330
55°	2360	1472	1134
60°	2247	1256	932
65°	2116	1037	837
70°	1958	833	756
75°	1759	729	685
80°	1471	605	589
85°	1000	394	435

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2551 cd/sqm

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.0
10°-20°	673.9	5.4
20°-30°	946.1	7.6
30°-40°	1031.3	8.3
40°-50°	947.9	7.6
50°-60°	744.4	6.0
60°-70°	484.5	3.9
70°-80°	249.4	2.0
80°-90°	67.9	0.5
90°-100°	79.3	0.6
100°-110°	295.8	2.4
110°-120°	784.4	6.3
120°-130°	1301.0	10.5
130°-140°	1382.0	11.1
140°-150°	1284.4	10.3
150°-160°	1032.6	8.3
160°-170°	665.4	5.3
170°-180°	229.0	1.8
0°-30°	1865.5	15.0
0°-40°	2896.8	23.3
0°-60°	4589.2	36.9
0°-90°	5391.1	43.3
90°-120°	1159.5	9.3
90°-150°	5127.0	41.2
90°-180°	7054.0	56.7
0°-180°	12445.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	21	35	44	47	12
95°	113	56	68	77	75	134
105°	529	582	106	125	132	566
115°	1001	1031	1074	268	143	986
125°	1415	1438	1471	1483	1489	1262
135°	1752	1780	1795	1813	1809	1353
145°	2032	2030	2060	2072	2063	1271
155°	2237	2222	2243	2253	2239	1031
165°	2357	2347	2352	2364	2352	666
175°	2411	2399	2403	2415	2398	229
180°	2406	2406	2406	2406	2406	

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	1.7	20.9	34.7	43.6	46.9
92.5°	43.6	36.6	41.7	45.3	46.9
95°	113.1	55.6	67.8	76.7	74.9
97.5°	203.7	61.0	88.7	94.0	95.7
100°	308.2	69.7	99.3	113.1	116.6
102.5°	423.0	419.7	102.7	121.8	127.1
105°	529.3	581.6	106.2	125.3	132.3
107.5°	652.9	696.3	109.8	128.8	135.9
110°	771.3	807.8	304.8	130.6	137.5

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	882.8	914.0	884.5	134.0	139.3
115°	1001.1	1030.6	1074.3	268.2	142.8
117.5°	1103.8	1138.6	1168.3	919.2	463.1
120°	1218.8	1244.8	1276.3	1297.1	1062.1
122.5°	1316.2	1344.1	1379.0	1389.3	1391.2
125°	1415.4	1438.1	1471.2	1483.4	1488.6
127.5°	1505.9	1530.3	1556.6	1574.0	1575.6
130°	1591.3	1619.3	1638.3	1657.5	1655.9
132.5°	1678.4	1701.1	1720.1	1735.9	1734.2
135°	1751.6	1779.5	1795.0	1812.6	1809.1
137.5°	1828.1	1849.0	1866.5	1883.9	1878.7
140°	1902.9	1917.0	1936.0	1951.7	1943.1
142.5°	1965.8	1978.0	2000.5	2014.4	2005.7
145°	2031.9	2030.0	2059.7	2071.9	2063.2
147.5°	2089.2	2084.1	2113.6	2122.3	2115.4
150°	2145.1	2132.9	2160.8	2171.1	2162.4
152.5°	2192.0	2178.1	2204.2	2214.7	2202.5
155°	2237.3	2221.8	2242.6	2253.0	2239.1
157.5°	2273.9	2260.0	2275.7	2287.9	2273.9
160°	2305.2	2294.7	2305.2	2315.6	2303.4
162.5°	2333.0	2322.6	2331.3	2343.5	2327.8
165°	2357.4	2347.0	2352.2	2364.4	2352.2
167.5°	2376.6	2366.1	2371.4	2383.6	2367.9
170°	2392.3	2381.8	2385.3	2397.5	2381.8
172.5°	2402.7	2392.3	2395.8	2408.0	2392.3
175°	2411.3	2399.1	2402.7	2414.8	2397.5
177.5°	2414.8	2402.7	2404.5	2416.7	2401.0
180°	2406.2	2406.2	2406.2	2406.2	2406.2

TEST NUMBER: P914027

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.34	11.12	11.36	12.14	13.51	6.31	7.08	7.32	8.11	9.47
	3H	12.01	12.70	13.04	13.73	15.12	7.48	8.18	8.51	9.21	10.60
	4H	12.61	13.27	13.65	14.30	15.70	7.93	8.59	8.97	9.62	11.01
	6H	13.02	13.63	14.07	14.67	16.07	8.24	8.85	9.29	9.89	11.29
	8H	13.14	13.72	14.20	14.78	16.18	8.33	8.90	9.38	9.96	11.36
	12H	13.20	13.75	14.26	14.80	16.22	8.37	8.91	9.43	9.96	11.39
4H	2H	10.35	11.01	11.40	12.04	13.44	6.89	7.55	7.94	8.58	9.98
	3H	12.17	12.71	13.22	13.78	15.18	8.23	8.78	9.28	9.84	11.25
	4H	12.85	13.35	13.91	14.41	15.84	8.77	9.27	9.83	10.33	11.75
	6H	13.36	13.79	14.43	14.87	16.29	9.18	9.61	10.25	10.69	12.11
	8H	13.53	13.93	14.60	15.00	16.44	9.30	9.71	10.38	10.78	12.21
	12H	13.62	13.98	14.71	15.06	16.51	9.36	9.73	10.45	10.81	12.25
8H	4H	12.81	13.22	13.89	14.29	15.72	9.04	9.44	10.11	10.51	11.95
	6H	13.37	13.70	14.47	14.81	16.25	9.55	9.88	10.64	10.99	12.43
	8H	13.58	13.87	14.68	14.97	16.42	9.74	10.03	10.84	11.12	12.58
	12H	13.72	13.97	14.82	15.06	16.56	9.85	10.10	10.95	11.19	12.69
12H	4H	12.76	13.13	13.85	14.21	15.65	9.04	9.41	10.13	10.49	11.93
	6H	13.35	13.64	14.45	14.73	16.19	9.60	9.89	10.70	10.98	12.44
	8H	13.56	13.82	14.66	14.91	16.40	9.80	10.06	10.90	11.15	12.64

END OF REPORT