

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914049

Luminaire Tested: DFN2DIP-PN3F0-090D080US927-FLLONL

Issue Date: 11/21/2024

**Test Information**


Test Method: LM-79-2019  
Report Number: P914049  
REPORT IS A COMBINATION OF REPORTS P901113 AND P897955  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-PN3F0-090D080US927-FLLONL  
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 13332.4 lumens  
Efficiency: N/A  
Efficacy: 86.3 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')  
CIE Type: General Diffuse  
  
Input Watts (W): 154.4  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9954  
Total Harmonic Distortion (THDi): 0.076  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P914049  
CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

### Luminous Intensity Polar Plot

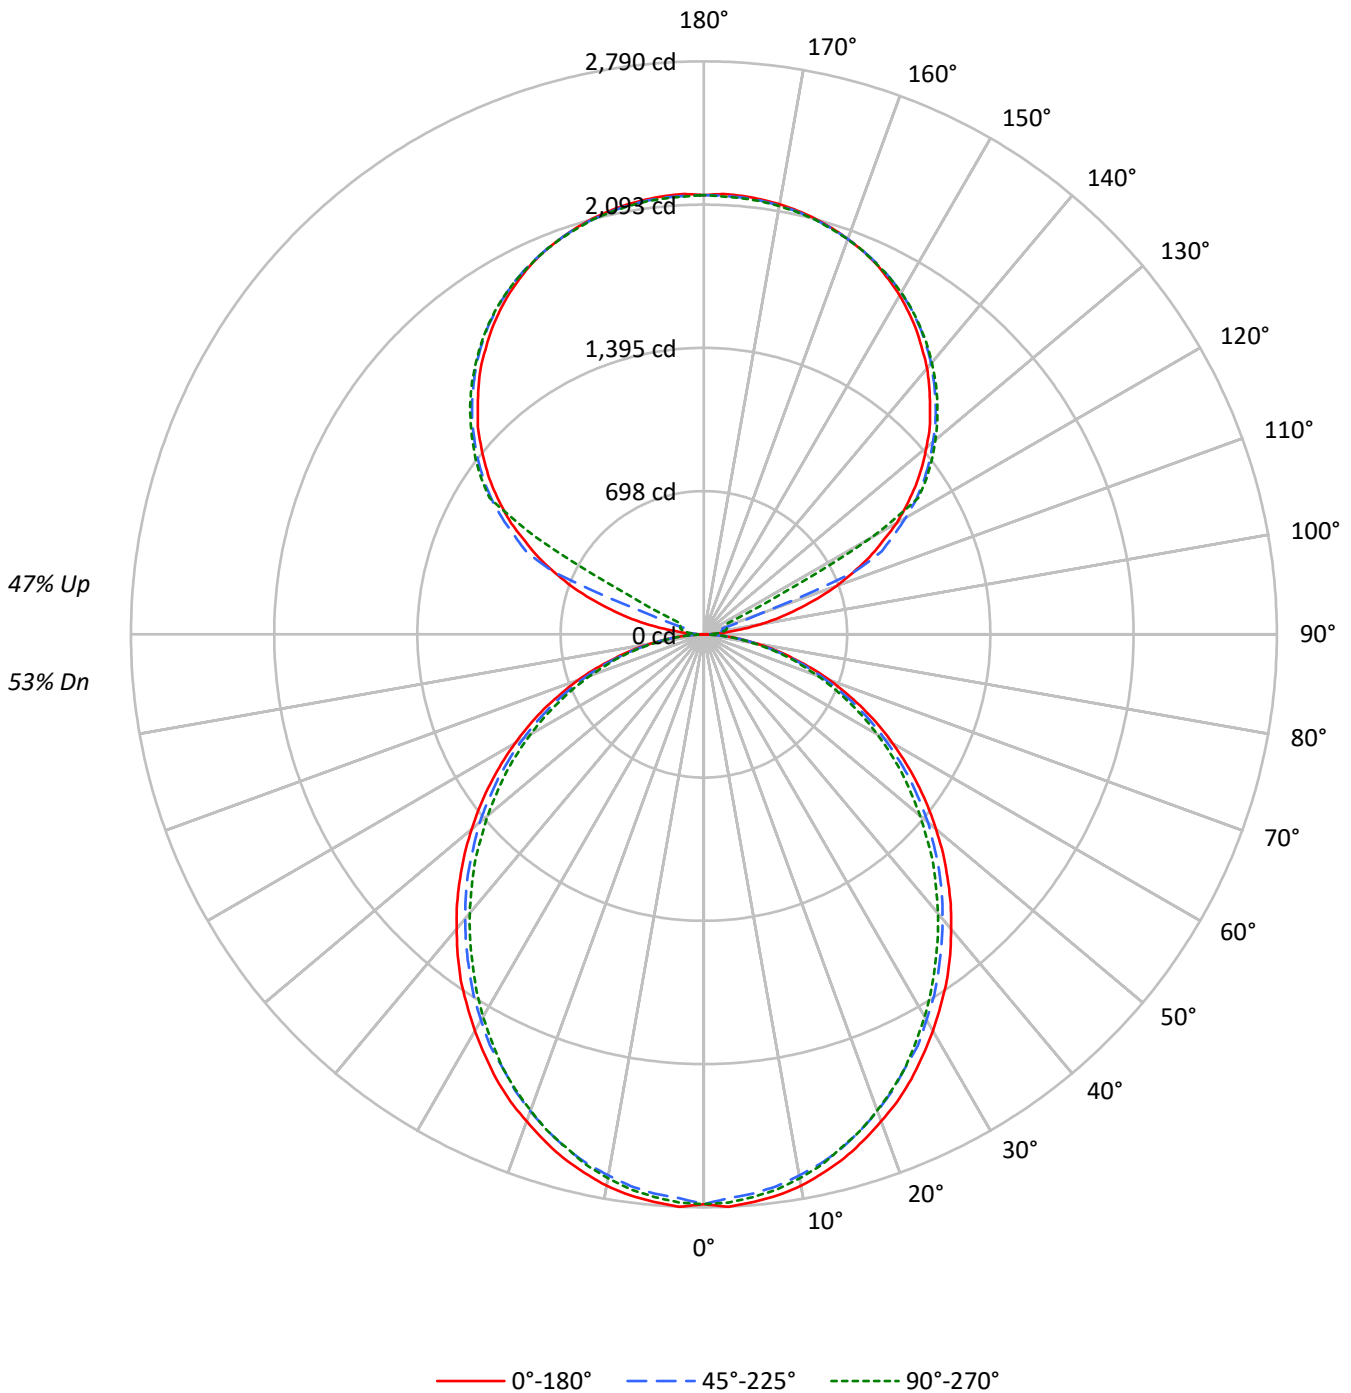



TEST NUMBER: P914049

CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59	59	59	59	53
1	98	94	90	87	91	87	84	81	75	72	70	63	61	59	52	51	50	52	51	50	45
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42	46	44	42	37
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36	41	38	36	32
4	75	64	56	50	69	60	53	47	51	46	41	43	39	36	36	33	31	36	33	31	27
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27	33	29	27	24
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24	30	26	24	21
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21	27	24	21	18
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19	25	21	19	16
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17	23	20	17	15
10	47	35	28	23	44	33	26	22	29	24	20	25	21	18	21	18	15	21	18	15	14

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	3243	3243	3243
5°	3246	3196	3218
10°	3218	3150	3173
15°	3169	3096	3104
20°	3103	3022	3032
25°	3037	2933	2951
30°	2956	2851	2847
35°	2878	2754	2737
40°	2783	2656	2632
45°	2688	2557	2526
50°	2584	2454	2402
55°	2475	2335	2287
60°	2351	2193	2157
65°	2216	2046	2002
70°	2044	1867	1836
75°	1807	1652	1680
80°	1520	1377	1386
85°	1071	912	904

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2688 cd/sqm



TEST NUMBER: P914049

CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	261.1	2.0
10°-20°	734.7	5.5
20°-30°	1079.6	8.1
30°-40°	1253.9	9.4
40°-50°	1252.4	9.4
50°-60°	1092.1	8.2
60°-70°	807.3	6.1
70°-80°	456.7	3.4
80°-90°	124.3	0.9
90°-100°	70.5	0.5
100°-110°	262.9	2.0
110°-120°	697.3	5.2
120°-130°	1156.5	8.7
130°-140°	1228.4	9.2
140°-150°	1141.7	8.6
150°-160°	917.9	6.9
160°-170°	591.5	4.4
170°-180°	203.6	1.5
0°-30°	2075.4	15.6
0°-40°	3329.4	25.0
0°-60°	5673.8	42.6
0°-90°	7062.1	53.0
90°-120°	1030.7	7.7
90°-150°	4557.3	34.2
90°-180°	6270.0	47.0
0°-180°	13332.4	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	2774	2774	2774	2774	2774	
5°	2774	2764	2734	2756	2750	263
15°	2641	2625	2590	2601	2588	744
25°	2390	2369	2324	2329	2324	1100
35°	2062	2036	1993	1977	1963	1288
45°	1678	1659	1619	1590	1579	1295
55°	1270	1254	1222	1190	1176	1135
65°	856	840	814	790	776	847
75°	448	443	429	414	419	478
85°	109	107	104	96	93	122
90°	2	18	31	39	42	12
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	



TEST NUMBER: P914049

CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	2774.1	2774.1	2774.1	2774.1	2774.1
2.5°	2790.3	2777.0	2747.6	2774.1	2769.1
5°	2774.1	2763.7	2734.3	2755.5	2750.4
7.5°	2755.5	2739.7	2710.2	2731.8	2726.4
10°	2726.4	2707.7	2675.7	2696.9	2689.0
12.5°	2686.1	2670.3	2638.4	2651.6	2646.3
15°	2640.9	2625.1	2590.2	2601.0	2587.7
17.5°	2584.8	2569.0	2534.2	2547.5	2534.2
20°	2523.4	2507.6	2470.2	2478.1	2467.6
22.5°	2462.3	2438.3	2403.4	2403.4	2398.0
25°	2390.1	2368.9	2323.6	2328.7	2323.6
27.5°	2310.0	2291.3	2256.8	2248.9	2235.6
30°	2230.2	2208.7	2168.8	2160.8	2150.1
32.5°	2144.8	2128.9	2086.1	2070.0	2059.3
35°	2062.1	2035.5	1992.7	1976.7	1963.3
37.5°	1968.7	1944.6	1901.9	1883.3	1869.9
40°	1872.7	1851.2	1808.5	1784.7	1774.0
42.5°	1779.3	1757.8	1715.4	1688.5	1672.7
45°	1678.0	1659.4	1619.1	1590.0	1579.3
47.5°	1579.3	1560.6	1517.8	1488.4	1472.6
50°	1475.1	1461.8	1424.4	1387.1	1373.8
52.5°	1373.8	1355.1	1320.6	1291.2	1272.5
55°	1269.9	1253.8	1221.8	1189.9	1176.5
57.5°	1165.8	1152.5	1117.7	1085.7	1074.9
60°	1061.6	1051.1	1013.8	984.4	976.4
62.5°	960.3	941.6	915.0	888.4	877.7
65°	856.4	840.3	813.6	789.6	776.3
67.5°	749.7	736.2	712.3	693.7	682.9
70°	650.9	640.2	616.2	597.5	587.0
72.5°	549.6	538.8	525.5	506.9	499.0
75°	448.1	442.9	429.4	413.5	418.9
77.5°	357.4	346.7	341.4	333.4	325.5
80°	266.9	264.0	258.6	250.7	245.4
82.5°	181.4	181.4	178.9	168.1	168.1
85°	109.2	106.7	104.2	95.9	93.4
87.5°	48.1	42.7	37.4	29.5	26.6
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2



TEST NUMBER: P914049

CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8



TEST NUMBER: P914049  
 CATALOG NUMBER: DFN2DIP-PN3F0-090D080US927-FLLONL

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.59	12.48	12.52	13.43	14.66	11.15	12.04	12.08	12.99	14.22
	3H	13.25	14.04	14.19	15.00	16.25	12.76	13.56	13.71	14.52	15.77
	4H	13.83	14.59	14.79	15.55	16.81	13.35	14.10	14.30	15.06	16.32
	6H	14.23	14.92	15.20	15.89	17.17	13.74	14.43	14.71	15.40	16.68
	8H	14.33	14.99	15.31	15.98	17.25	13.84	14.50	14.82	15.49	16.76
	12H	14.38	15.01	15.36	15.99	17.28	13.88	14.51	14.86	15.49	16.79
4H	2H	12.05	12.81	13.01	13.77	15.03	11.70	12.46	12.66	13.42	14.68
	3H	13.91	14.54	14.89	15.54	16.81	13.51	14.14	14.48	15.13	16.41
	4H	14.62	15.20	15.61	16.19	17.48	14.21	14.78	15.19	15.77	17.07
	6H	15.13	15.63	16.13	16.64	17.94	14.71	15.21	15.71	16.22	17.51
	8H	15.28	15.75	16.28	16.75	18.06	14.86	15.32	15.85	16.32	17.63
	12H	15.35	15.77	16.37	16.79	18.11	14.92	15.33	15.93	16.35	17.67
8H	4H	14.82	15.28	15.81	16.28	17.60	14.45	14.91	15.44	15.91	17.23
	6H	15.44	15.83	16.46	16.87	18.18	15.07	15.45	16.09	16.50	17.81
	8H	15.66	16.00	16.69	17.03	18.36	15.28	15.62	16.31	16.65	17.97
	12H	15.79	16.09	16.82	17.11	18.48	15.39	15.69	16.42	16.71	18.08
12H	4H	14.80	15.22	15.82	16.24	17.56	14.44	14.86	15.46	15.88	17.20
	6H	15.47	15.81	16.50	16.84	18.17	15.11	15.45	16.14	16.48	17.81
	8H	15.71	16.01	16.74	17.03	18.41	15.34	15.64	16.37	16.66	18.03