

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916753

Luminaire Tested: DFN2DIP-PN3F0-080D090US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916753
REPORT IS A COMBINATION OF REPORTS P901125 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D090US930-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13721.5 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLLONL

Luminous Intensity Polar Plot

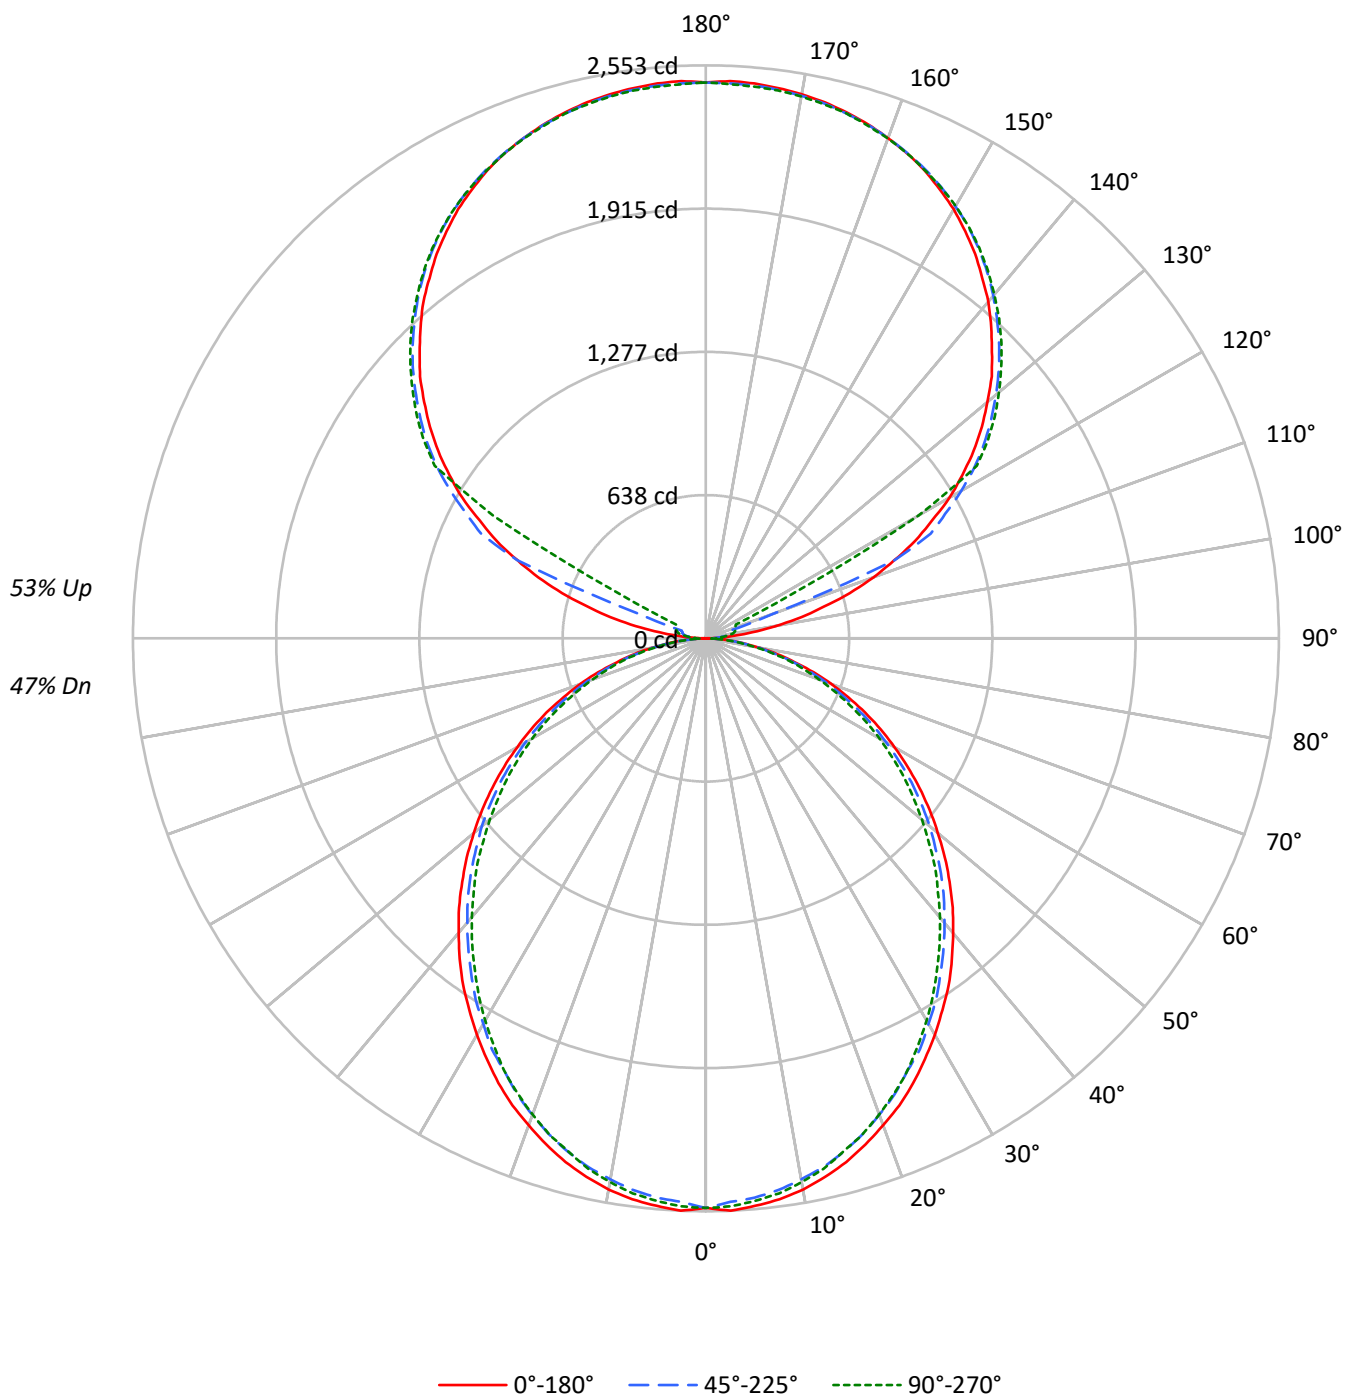

TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	53	53	53
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	34	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	32	29	30	27	24
6	62	50	42	36	57	47	39	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	53	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	34	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2967	2967	2967
5°	2970	2923	2944
10°	2944	2882	2903
15°	2899	2832	2839
20°	2839	2764	2774
25°	2779	2683	2699
30°	2704	2608	2604
35°	2633	2519	2504
40°	2546	2430	2408
45°	2459	2340	2310
50°	2364	2245	2197
55°	2264	2136	2093
60°	2151	2006	1973
65°	2027	1872	1832
70°	1870	1708	1679
75°	1653	1511	1537
80°	1390	1260	1268
85°	981	834	826

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2459 cd/sqm

TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.9	1.7
10°-20°	672.1	4.9
20°-30°	987.7	7.2
30°-40°	1147.1	8.4
40°-50°	1145.7	8.3
50°-60°	999.0	7.3
60°-70°	738.5	5.4
70°-80°	417.8	3.0
80°-90°	114.6	0.8
90°-100°	81.7	0.6
100°-110°	304.4	2.2
110°-120°	807.3	5.9
120°-130°	1339.0	9.8
130°-140°	1422.3	10.4
140°-150°	1321.9	9.6
150°-160°	1062.8	7.7
160°-170°	684.8	5.0
170°-180°	235.7	1.7
0°-30°	1898.6	13.8
0°-40°	3045.8	22.2
0°-60°	5190.5	37.8
0°-90°	6461.5	47.1
90°-120°	1193.4	8.7
90°-150°	5276.6	38.5
90°-180°	7260.0	52.9
0°-180°	13721.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2538	2538	2538	2538	2538	
5°	2538	2528	2501	2521	2516	241
15°	2416	2402	2370	2379	2367	680
25°	2186	2167	2126	2130	2126	1006
35°	1886	1862	1823	1808	1796	1178
45°	1535	1518	1481	1455	1445	1185
55°	1162	1147	1118	1088	1076	1039
65°	784	769	744	722	710	775
75°	410	405	393	378	383	438
85°	100	98	95	88	85	112
90°	2	22	36	45	48	13
95°	116	57	70	79	77	138
105°	545	599	109	129	136	582
115°	1030	1061	1106	276	147	1014
125°	1457	1480	1514	1527	1532	1299
135°	1803	1831	1847	1866	1862	1393
145°	2091	2089	2120	2132	2123	1308
155°	2303	2287	2308	2319	2304	1061
165°	2426	2416	2421	2433	2421	685
175°	2482	2469	2473	2485	2467	236
180°	2476	2476	2476	2476	2476	

TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2537.9	2537.9	2537.9	2537.9	2537.9
2.5°	2552.6	2540.5	2513.6	2537.9	2533.2
5°	2537.9	2528.3	2501.4	2520.8	2516.2
7.5°	2520.8	2506.3	2479.4	2499.1	2494.2
10°	2494.2	2477.0	2447.8	2467.2	2460.0
12.5°	2457.4	2442.9	2413.6	2425.8	2420.9
15°	2416.0	2401.5	2369.6	2379.4	2367.3
17.5°	2364.7	2350.2	2318.3	2330.5	2318.3
20°	2308.5	2294.0	2259.8	2267.1	2257.5
22.5°	2252.6	2230.6	2198.7	2198.7	2193.8
25°	2186.5	2167.1	2125.7	2130.4	2125.7
27.5°	2113.3	2096.2	2064.6	2057.3	2045.2
30°	2040.3	2020.6	1984.1	1976.9	1967.0
32.5°	1962.1	1947.6	1908.5	1893.7	1883.9
35°	1886.4	1862.1	1823.0	1808.2	1796.1
37.5°	1801.0	1779.0	1739.9	1722.8	1710.7
40°	1713.3	1693.5	1654.5	1632.7	1622.9
42.5°	1627.8	1608.1	1569.3	1544.7	1530.2
45°	1535.1	1518.0	1481.2	1454.6	1444.8
47.5°	1444.8	1427.7	1388.5	1361.6	1347.1
50°	1349.5	1337.3	1303.1	1268.9	1256.8
52.5°	1256.8	1239.7	1208.1	1181.2	1164.1
55°	1161.7	1147.0	1117.8	1088.5	1076.3
57.5°	1066.5	1054.3	1022.5	993.2	983.3
60°	971.2	961.6	927.4	900.5	893.2
62.5°	878.5	861.4	837.1	812.8	802.9
65°	783.5	768.7	744.4	722.4	710.2
67.5°	685.8	673.4	651.7	634.6	624.8
70°	595.5	585.6	563.7	546.6	537.0
72.5°	502.8	493.0	480.8	463.7	456.5
75°	409.9	405.2	392.8	378.3	383.2
77.5°	327.0	317.2	312.3	305.0	297.7
80°	244.2	241.6	236.7	229.4	224.5
82.5°	166.0	166.0	163.6	153.8	153.8
85°	100.0	97.6	95.3	87.8	85.4
87.5°	44.0	39.1	34.2	26.9	24.4
90°	1.7	21.5	35.7	44.9	48.3
92.5°	44.9	37.7	43.0	46.6	48.3
95°	116.4	57.2	69.8	78.9	77.0
97.5°	209.6	62.8	91.3	96.8	98.5
100°	317.2	71.7	102.2	116.4	120.0
102.5°	435.4	431.9	105.7	125.3	130.9
105°	544.7	598.6	109.3	129.0	136.2
107.5°	672.0	716.6	113.0	132.6	139.8
110°	793.9	831.4	313.6	134.4	141.5



TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	908.6	940.7	910.3	137.9	143.4
115°	1030.3	1060.7	1105.6	276.0	147.0
117.5°	1136.0	1171.8	1202.4	946.1	476.6
120°	1254.3	1281.2	1313.5	1335.0	1093.1
122.5°	1354.6	1383.3	1419.3	1429.9	1431.8
125°	1456.7	1480.1	1514.2	1526.7	1532.0
127.5°	1549.9	1575.0	1602.1	1619.9	1621.6
130°	1637.8	1666.6	1686.1	1705.8	1704.2
132.5°	1727.4	1750.8	1770.3	1786.6	1784.9
135°	1802.7	1831.4	1847.4	1865.5	1861.9
137.5°	1881.5	1902.9	1921.0	1938.9	1933.6
140°	1958.4	1972.9	1992.5	2008.7	1999.8
142.5°	2023.2	2035.7	2058.9	2073.1	2064.3
145°	2091.2	2089.3	2119.8	2132.3	2123.4
147.5°	2150.2	2144.9	2175.3	2184.3	2177.2
150°	2207.7	2195.1	2223.8	2234.4	2225.5
152.5°	2255.9	2241.7	2268.5	2279.3	2266.8
155°	2302.6	2286.6	2308.0	2318.7	2304.4
157.5°	2340.2	2326.0	2342.1	2354.7	2340.2
160°	2372.5	2361.7	2372.5	2383.2	2370.6
162.5°	2401.1	2390.4	2399.3	2411.9	2395.8
165°	2426.2	2415.5	2420.9	2433.4	2420.9
167.5°	2446.0	2435.1	2440.6	2453.2	2437.0
170°	2462.1	2451.3	2454.9	2467.4	2451.3
172.5°	2472.8	2462.1	2465.7	2478.3	2462.1
175°	2481.7	2469.1	2472.8	2485.3	2467.4
177.5°	2485.3	2472.8	2474.7	2487.2	2471.1
180°	2476.4	2476.4	2476.4	2476.4	2476.4

TEST NUMBER: P916753

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.74	11.57	11.72	12.57	13.88	10.30	11.13	11.28	12.13	13.44
	3H	12.39	13.14	13.38	14.14	15.47	11.91	12.65	12.90	13.66	14.99
	4H	12.97	13.68	13.98	14.69	16.03	12.49	13.20	13.49	14.20	15.54
	6H	13.36	14.02	14.38	15.03	16.38	12.88	13.53	13.89	14.54	15.89
	8H	13.47	14.09	14.49	15.12	16.47	12.98	13.60	14.00	14.63	15.98
	12H	13.51	14.10	14.54	15.13	16.50	13.01	13.61	14.04	14.63	16.00
4H	2H	11.19	11.90	12.20	12.91	14.25	10.84	11.55	11.85	12.56	13.90
	3H	13.05	13.64	14.07	14.67	16.03	12.65	13.24	13.67	14.27	15.63
	4H	13.76	14.30	14.78	15.33	16.70	13.34	13.88	14.37	14.91	16.29
	6H	14.26	14.73	15.30	15.78	17.16	13.84	14.31	14.88	15.36	16.73
	8H	14.41	14.85	15.45	15.89	17.28	13.98	14.42	15.02	15.46	16.85
	12H	14.48	14.87	15.54	15.93	17.33	14.04	14.43	15.10	15.49	16.89
8H	4H	13.95	14.38	14.99	15.43	16.81	13.58	14.01	14.62	15.06	16.44
	6H	14.57	14.93	15.63	16.01	17.40	14.19	14.55	15.26	15.64	17.03
	8H	14.79	15.10	15.86	16.17	17.58	14.40	14.72	15.47	15.79	17.19
	12H	14.91	15.19	15.99	16.26	17.70	14.51	14.79	15.59	15.86	17.30
12H	4H	13.93	14.32	14.99	15.38	16.78	13.57	13.96	14.63	15.02	16.41
	6H	14.60	14.91	15.67	15.98	17.39	14.23	14.55	15.30	15.62	17.03
	8H	14.83	15.11	15.91	16.18	17.62	14.46	14.74	15.54	15.81	17.25

END OF REPORT