

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916760

Luminaire Tested: DFN2DIP-PN3F0-090D040US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916760
REPORT IS A COMBINATION OF REPORTS P899537 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D040US930-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10150.5 lumens
Efficiency: N/A
Efficacy: 82.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 123
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFLL

Luminous Intensity Polar Plot

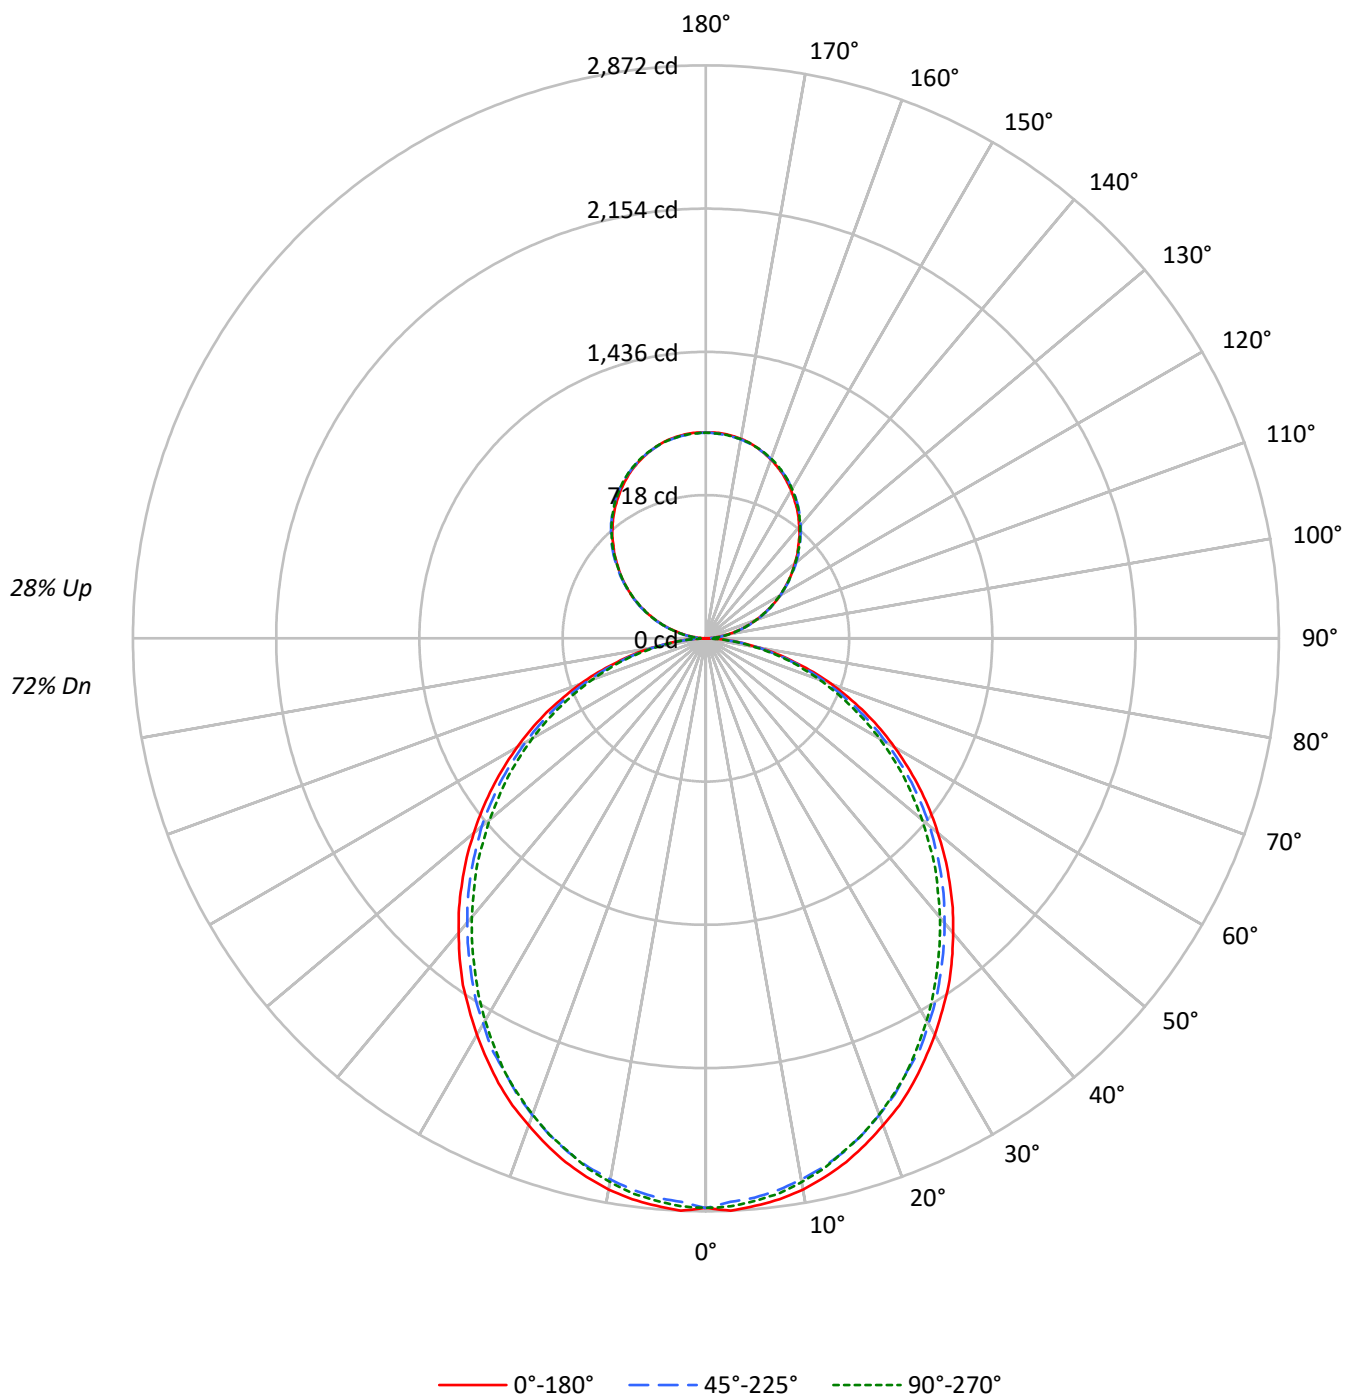

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	91	97	93	90	86	84	81	79	75	73	71	67	66	64
2	93	86	79	74	88	81	76	71	73	69	65	66	63	59	59	56	54
3	85	75	68	62	81	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	51	58	52	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	44	52	45	41	47	42	38	42	38	35
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	31
7	61	49	40	35	58	47	39	34	42	36	31	39	33	29	35	31	27
8	57	44	36	31	54	42	35	30	39	33	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	30	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3338	3338	3338
5°	3341	3289	3312
10°	3312	3242	3265
15°	3261	3186	3194
20°	3193	3110	3121
25°	3126	3019	3037
30°	3042	2934	2930
35°	2962	2834	2817
40°	2864	2733	2709
45°	2766	2632	2599
50°	2659	2526	2472
55°	2547	2403	2354
60°	2420	2257	2220
65°	2281	2106	2061
70°	2104	1921	1889
75°	1860	1700	1729
80°	1564	1417	1427
85°	1103	938	930

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2766 cd/sqm

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	2.6
10°-20°	756.1	7.4
20°-30°	1111.2	10.9
30°-40°	1290.5	12.7
40°-50°	1288.9	12.7
50°-60°	1123.9	11.1
60°-70°	830.8	8.2
70°-80°	470.1	4.6
80°-90°	127.0	1.3
90°-100°	63.8	0.6
100°-110°	202.8	2.0
110°-120°	347.0	3.4
120°-130°	456.4	4.5
130°-140°	512.3	5.0
140°-150°	502.4	4.9
150°-160°	421.4	4.2
160°-170°	279.5	2.8
170°-180°	97.7	1.0
0°-30°	2136.0	21.0
0°-40°	3426.5	33.8
0°-60°	5839.4	57.5
0°-90°	7267.3	71.6
90°-120°	613.6	6.0
90°-150°	2084.7	20.5
90°-180°	2883.0	28.4
0°-180°	10150.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	1	11	30	29	30	10
95°	45	54	56	56	54	51
105°	187	190	192	193	193	198
115°	348	353	352	351	348	344
125°	506	514	512	509	508	453
135°	655	665	667	666	663	506
145°	795	802	807	808	804	497
155°	910	912	915	919	916	419
165°	989	988	988	995	990	279
175°	1030	1027	1025	1031	1026	98
180°	1031	1031	1031	1031	1031	

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	0.9	11.2	30.5	28.6	29.5
92.5°	19.2	26.1	27.1	28.0	28.0
95°	45.4	54.1	55.7	55.7	54.1
97.5°	75.6	83.6	87.1	87.1	87.1
100°	110.4	117.6	120.0	120.0	119.1
102.5°	147.1	152.4	155.8	156.7	155.8
105°	187.2	189.6	191.5	193.1	193.1
107.5°	227.0	230.7	230.7	231.3	227.0
110°	265.5	270.5	270.5	270.5	268.1

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	307.2	312.5	311.5	309.1	307.2
115°	348.2	353.3	351.6	350.7	348.2
117.5°	389.0	395.8	391.5	389.0	386.5
120°	430.1	436.8	430.1	430.1	427.2
122.5°	467.3	476.1	471.7	469.2	467.3
125°	506.5	514.3	511.8	509.0	508.1
127.5°	544.8	554.4	551.0	547.2	544.8
130°	580.5	591.7	590.2	588.3	584.9
132.5°	620.6	629.3	630.0	625.6	623.1
135°	655.2	664.8	666.7	665.7	663.2
137.5°	693.7	701.5	703.0	702.4	698.7
140°	727.6	735.4	739.7	739.7	736.3
142.5°	762.5	770.2	772.7	773.6	770.2
145°	795.4	801.6	806.6	807.6	804.1
147.5°	824.9	832.7	836.4	838.0	834.5
150°	855.4	860.7	864.1	866.9	864.1
152.5°	882.5	887.7	892.1	895.5	892.1
155°	909.5	912.0	914.8	919.2	916.3
157.5°	932.9	934.7	936.2	942.5	938.1
160°	953.7	955.5	956.4	961.7	958.0
162.5°	972.9	972.9	973.9	979.7	975.4
165°	989.4	988.5	988.5	994.7	990.3
167.5°	1004.4	1001.5	1001.5	1007.8	1003.4
170°	1015.5	1013.0	1012.1	1018.3	1013.0
172.5°	1023.3	1020.8	1019.9	1026.1	1020.8
175°	1029.6	1027.0	1025.2	1031.4	1026.1
177.5°	1033.0	1030.5	1028.6	1033.9	1028.6
180°	1031.4	1031.4	1031.4	1031.4	1031.4

TEST NUMBER: P916760

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.21	14.31	13.96	15.07	16.00	12.77	13.87	13.52	14.64	15.56
	3H	14.88	15.87	15.64	16.65	17.60	14.40	15.38	15.16	16.16	17.12
	4H	15.48	16.41	16.25	17.19	18.16	14.99	15.92	15.77	16.71	17.68
	6H	15.88	16.74	16.67	17.54	18.52	15.39	16.25	16.18	17.05	18.03
	8H	15.99	16.81	16.79	17.63	18.61	15.50	16.32	16.30	17.14	18.12
	12H	16.05	16.83	16.85	17.63	18.64	15.55	16.33	16.36	17.14	18.15
4H	2H	13.70	14.63	14.48	15.41	16.38	13.35	14.27	14.13	15.06	16.03
	3H	15.58	16.35	16.37	17.17	18.16	15.17	15.95	15.97	16.77	17.76
	4H	16.29	17.00	17.10	17.82	18.83	15.88	16.58	16.69	17.41	18.42
	6H	16.82	17.43	17.64	18.27	19.29	16.39	17.01	17.22	17.85	18.87
	8H	16.97	17.54	17.80	18.38	19.41	16.54	17.11	17.37	17.96	18.99
	12H	17.05	17.57	17.90	18.43	19.46	16.61	17.13	17.46	17.99	19.03
8H	4H	16.51	17.08	17.33	17.92	18.95	16.14	16.71	16.96	17.55	18.58
	6H	17.14	17.61	18.00	18.50	19.53	16.76	17.24	17.62	18.12	19.15
	8H	17.36	17.78	18.23	18.66	19.71	16.98	17.40	17.84	18.27	19.32
	12H	17.50	17.87	18.37	18.74	19.84	17.10	17.47	17.97	18.34	19.44
12H	4H	16.50	17.02	17.35	17.88	18.91	16.14	16.66	16.99	17.52	18.55
	6H	17.17	17.59	18.04	18.47	19.52	16.81	17.23	17.67	18.11	19.15
	8H	17.42	17.79	18.29	18.66	19.76	17.05	17.42	17.92	18.29	19.39

END OF REPORT