

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919322

Luminaire Tested: DFN2DIP-PN3F0-030D040US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919322
REPORT IS A COMBINATION OF REPORTS P899526 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-030D040US935-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5243.4 lumens
Efficiency: N/A
Efficacy: 97.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 53.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLLFLL

Luminous Intensity Polar Plot

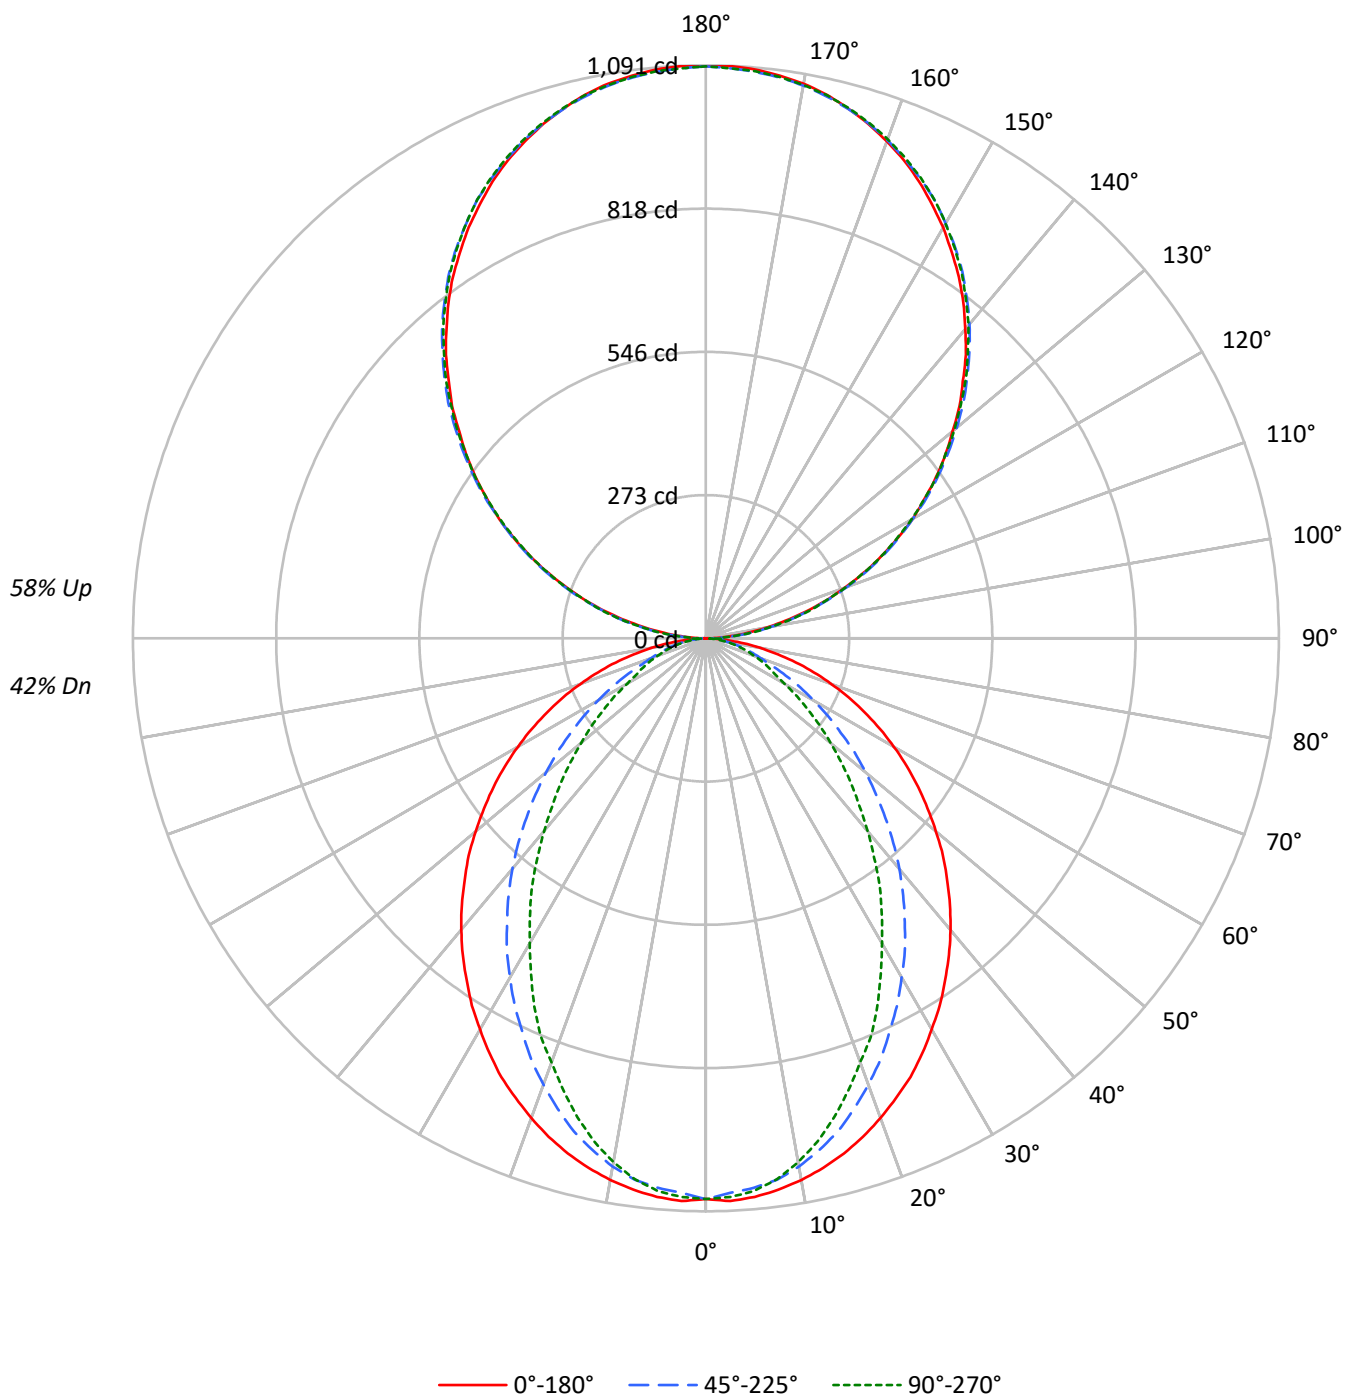

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1248	1248	1248
5°	1249	1227	1235
10°	1236	1202	1195
15°	1218	1162	1132
20°	1195	1106	1055
25°	1171	1044	981
30°	1140	980	888
35°	1108	912	805
40°	1077	841	711
45°	1040	763	626
50°	1002	684	542
55°	962	600	462
60°	916	512	380
65°	862	423	341
70°	798	339	308
75°	717	297	279
80°	600	247	240
85°	407	160	177

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1079 cd/sqm

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	100.1	1.9
10°-20°	274.7	5.2
20°-30°	385.6	7.4
30°-40°	420.3	8.0
40°-50°	386.3	7.4
50°-60°	303.4	5.8
60°-70°	197.5	3.8
70°-80°	101.7	1.9
80°-90°	29.0	0.6
90°-100°	67.4	1.3
100°-110°	214.2	4.1
110°-120°	366.5	7.0
120°-130°	482.0	9.2
130°-140°	541.0	10.3
140°-150°	530.5	10.1
150°-160°	445.0	8.5
160°-170°	295.1	5.6
170°-180°	103.2	2.0
0°-30°	760.3	14.5
0°-40°	1180.7	22.5
0°-60°	1870.4	35.7
0°-90°	2198.6	41.9
90°-120°	648.0	12.4
90°-150°	2201.5	42.0
90°-180°	3045.0	58.1
0°-180°	5243.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1068	1068	1068	1068	1068	
5°	1068	1063	1050	1059	1056	101
15°	1015	1005	972	954	944	286
25°	922	891	827	787	773	424
35°	794	745	660	599	578	497
45°	649	584	483	414	391	501
55°	494	418	314	256	238	441
65°	333	255	168	135	132	330
75°	178	110	77	70	70	188
85°	42	21	18	18	18	48
90°	1	12	32	30	31	5
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1067.6	1067.6	1067.6	1067.6	1067.6
2.5°	1072.4	1067.6	1056.9	1066.6	1064.7
5°	1067.6	1062.7	1050.2	1058.9	1055.9
7.5°	1058.9	1053.1	1039.6	1043.4	1038.5
10°	1047.2	1040.5	1021.2	1018.2	1012.5
12.5°	1032.8	1024.1	998.0	992.2	981.5
15°	1015.4	1004.7	971.9	953.6	943.9
17.5°	995.1	979.6	939.0	917.8	902.3
20°	971.9	952.5	904.2	880.2	858.8
22.5°	946.8	924.5	868.5	835.7	821.2
25°	921.7	890.7	827.0	787.4	772.8
27.5°	891.7	858.8	788.3	743.0	720.7
30°	859.9	823.1	745.8	696.6	670.5
32.5°	828.9	784.5	705.3	647.3	623.1
35°	794.2	744.8	659.9	599.0	577.7
37.5°	760.3	707.1	617.3	550.6	526.6
40°	724.6	666.7	572.9	504.3	479.2
42.5°	687.9	626.1	528.5	456.9	432.8
45°	649.3	584.4	483.1	414.4	391.2
47.5°	612.5	544.0	439.6	370.9	349.7
50°	572.0	503.3	397.1	330.4	310.1
52.5°	532.3	459.9	356.5	292.7	274.4
55°	493.6	418.3	313.9	256.1	237.7
57.5°	454.1	376.8	276.4	222.2	206.7
60°	413.5	336.2	236.7	187.4	172.0
62.5°	373.9	296.6	202.9	156.5	148.9
65°	333.3	255.0	168.1	135.3	132.3
67.5°	294.7	216.4	135.3	118.8	115.9
70°	254.1	178.7	112.0	102.4	98.5
72.5°	215.4	143.9	93.7	86.0	84.0
75°	177.7	110.1	77.3	70.5	69.6
77.5°	140.1	78.2	60.9	57.0	55.0
80°	105.3	56.1	46.3	42.5	42.5
82.5°	73.4	37.7	31.9	30.0	30.0
85°	41.5	21.2	18.3	18.3	18.3
87.5°	15.5	7.7	7.7	6.8	6.8
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P919322

CATALOG NUMBER: DFN2DIP-PN3F0-030D040US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.07	7.84	8.10	8.87	10.26	3.04	3.81	4.07	4.84	6.22
	3H	8.74	9.43	9.78	10.47	11.87	4.22	4.90	5.26	5.94	7.35
	4H	9.34	9.99	10.39	11.04	12.45	4.66	5.31	5.71	6.35	7.77
	6H	9.75	10.35	10.82	11.40	12.82	4.97	5.57	6.03	6.62	8.04
	8H	9.88	10.45	10.94	11.51	12.93	5.06	5.63	6.12	6.69	8.11
	12H	9.93	10.47	11.00	11.53	12.97	5.10	5.64	6.17	6.69	8.14
4H	2H	7.08	7.73	8.14	8.78	10.19	3.62	4.27	4.68	5.32	6.73
	3H	8.90	9.44	9.96	10.51	11.94	4.96	5.50	6.03	6.57	8.00
	4H	9.58	10.08	10.65	11.14	12.59	5.50	6.00	6.57	7.06	8.51
	6H	10.09	10.51	11.17	11.60	13.04	5.91	6.33	6.99	7.42	8.86
	8H	10.26	10.66	11.34	11.73	13.19	6.03	6.43	7.11	7.51	8.97
	12H	10.35	10.71	11.45	11.80	13.26	6.09	6.45	7.19	7.54	9.00
8H	4H	9.55	9.94	10.63	11.02	12.48	5.77	6.17	6.85	7.25	8.70
	6H	10.10	10.43	11.20	11.55	13.00	6.28	6.61	7.38	7.73	9.18
	8H	10.31	10.60	11.42	11.70	13.18	6.47	6.75	7.58	7.86	9.33
	12H	10.45	10.70	11.56	11.80	13.31	6.58	6.83	7.69	7.93	9.44
12H	4H	9.49	9.85	10.59	10.94	12.41	5.77	6.13	6.87	7.22	8.69
	6H	10.08	10.36	11.19	11.47	12.94	6.33	6.61	7.44	7.72	9.19
	8H	10.29	10.54	11.40	11.64	13.15	6.53	6.78	7.64	7.88	9.39

END OF REPORT