

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919363

Luminaire Tested: DFN2DIP-PN3F0-040D070US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919363
REPORT IS A COMBINATION OF REPORTS P901090 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D070US935-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8894.1 lumens
Efficiency: N/A
Efficacy: 99.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 89
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLLONL

Luminous Intensity Polar Plot

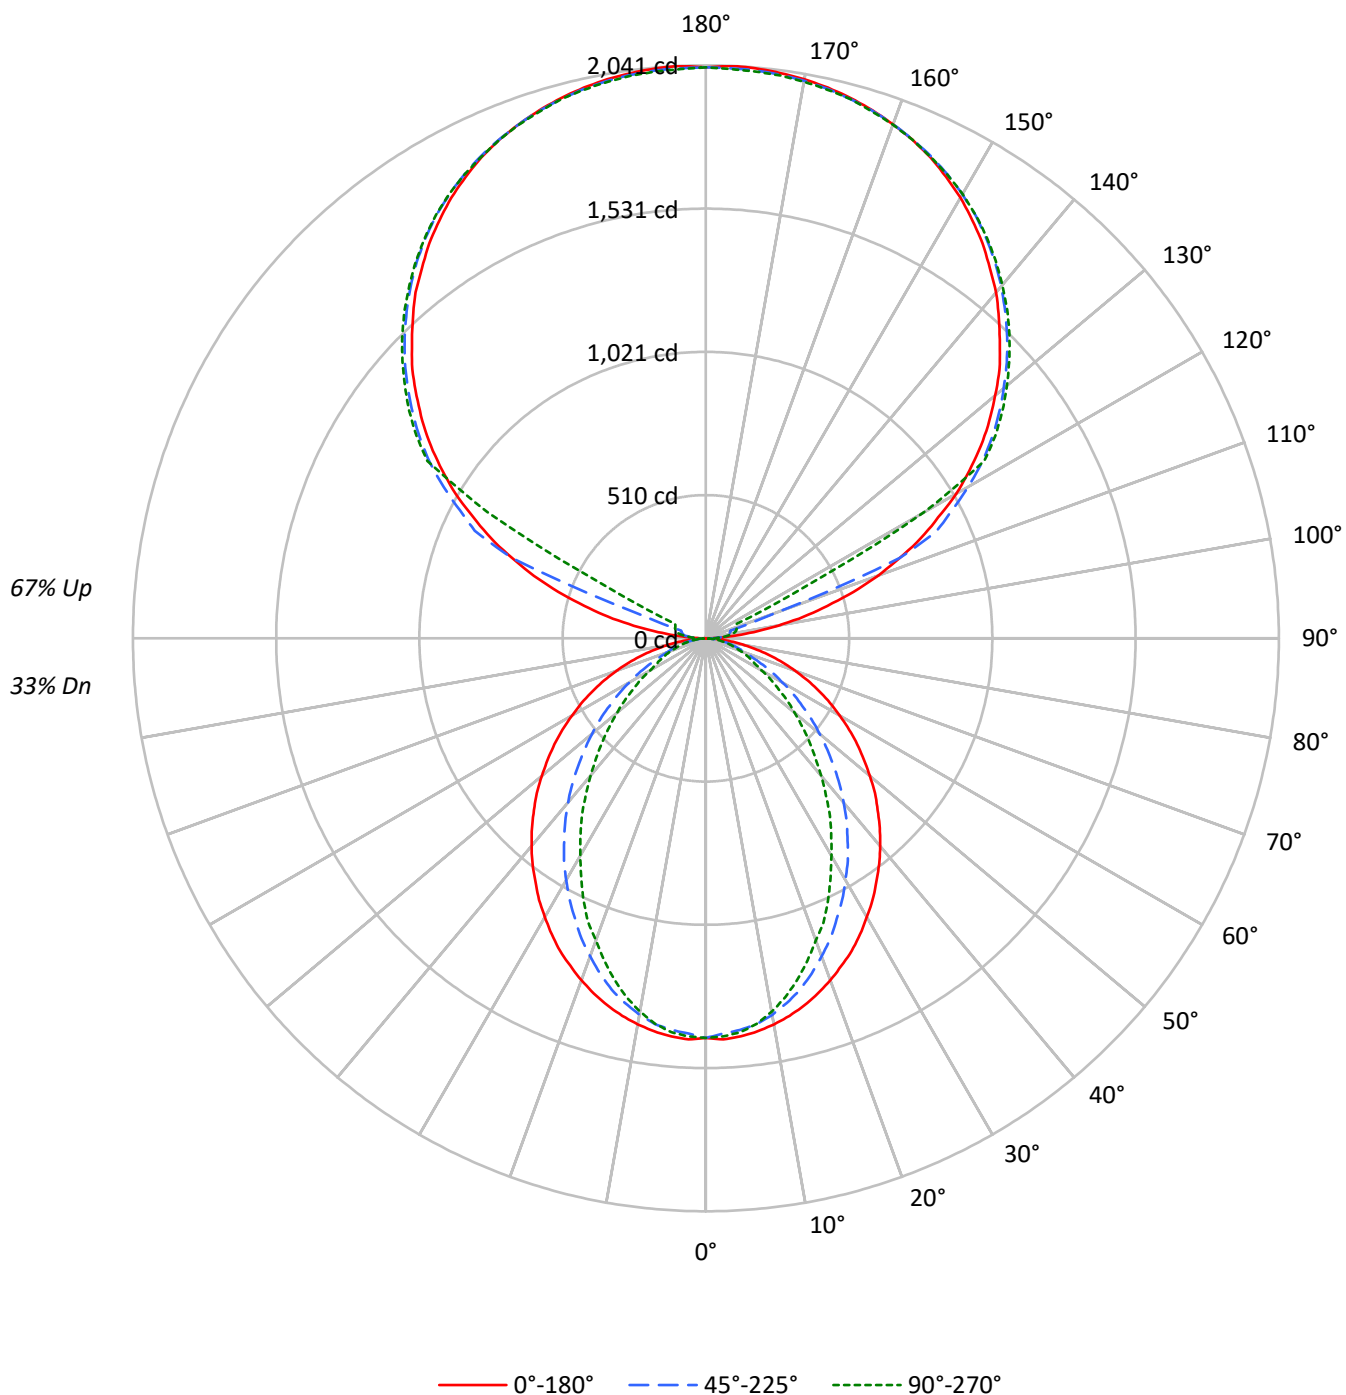

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	56	56	56	40	40	40
1	94	90	87	83	85	81	78	76	65	63	61	50	49	48	36	35	35
2	86	79	73	68	77	72	67	62	57	54	51	44	42	40	32	31	30
3	79	70	63	57	71	63	57	53	51	47	43	39	37	34	29	27	26
4	72	62	54	49	65	56	50	45	45	41	37	35	32	30	26	24	22
5	66	55	47	42	59	50	43	38	41	36	32	32	28	26	24	21	20
6	61	49	42	36	55	45	38	33	37	32	28	29	25	23	21	19	17
7	56	45	37	32	51	41	34	29	33	28	25	26	23	20	20	17	16
8	52	41	33	28	47	37	31	26	30	25	22	24	21	18	18	16	14
9	49	37	30	25	44	34	27	23	28	23	20	22	19	16	17	14	13
10	45	34	27	22	41	31	25	21	26	21	18	20	17	15	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1664	1664	1664
5°	1666	1636	1647
10°	1648	1603	1593
15°	1624	1549	1510
20°	1593	1475	1407
25°	1562	1392	1308
30°	1519	1307	1184
35°	1478	1216	1074
40°	1436	1122	948
45°	1386	1017	834
50°	1336	912	723
55°	1283	800	616
60°	1221	683	507
65°	1150	564	455
70°	1064	453	411
75°	955	397	372
80°	799	329	320
85°	543	214	237

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1386 cd/sqm

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	1.5
10°-20°	366.2	4.1
20°-30°	514.2	5.8
30°-40°	560.5	6.3
40°-50°	515.1	5.8
50°-60°	404.5	4.5
60°-70°	263.3	3.0
70°-80°	135.6	1.5
80°-90°	38.2	0.4
90°-100°	67.1	0.8
100°-110°	250.0	2.8
110°-120°	663.1	7.5
120°-130°	1099.8	12.4
130°-140°	1168.3	13.1
140°-150°	1085.8	12.2
150°-160°	872.9	9.8
160°-170°	562.5	6.3
170°-180°	193.6	2.2
0°-30°	1013.8	11.4
0°-40°	1574.2	17.7
0°-60°	2493.9	28.0
0°-90°	2931.0	33.0
90°-120°	980.2	11.0
90°-150°	4334.1	48.7
90°-180°	5963.0	67.0
0°-180°	8894.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	1	18	29	37	40	8
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P919363

CATALOG NUMBER: DFN2DIP-PN3F0-040D070US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.04	7.74	8.13	8.83	10.33	3.00	3.71	4.10	4.80	6.30
	3H	8.70	9.33	9.80	10.43	11.94	4.18	4.81	5.28	5.91	7.42
	4H	9.30	9.90	10.41	11.00	12.52	4.62	5.22	5.73	6.32	7.84
	6H	9.71	10.26	10.83	11.36	12.89	4.93	5.48	6.05	6.58	8.11
	8H	9.83	10.35	10.95	11.47	13.00	5.01	5.53	6.14	6.65	8.18
	12H	9.88	10.38	11.01	11.49	13.04	5.05	5.54	6.18	6.66	8.20
4H	2H	7.04	7.64	8.16	8.74	10.26	3.58	4.18	4.70	5.28	6.80
	3H	8.85	9.35	9.98	10.47	12.01	4.91	5.41	6.04	6.54	8.07
	4H	9.53	9.99	10.66	11.11	12.66	5.45	5.91	6.58	7.02	8.58
	6H	10.03	10.43	11.17	11.56	13.11	5.86	6.25	6.99	7.39	8.93
	8H	10.20	10.57	11.34	11.70	13.26	5.98	6.34	7.12	7.47	9.04
	12H	10.29	10.62	11.44	11.76	13.33	6.03	6.37	7.19	7.51	9.07
8H	4H	9.49	9.85	10.63	10.99	12.55	5.72	6.08	6.85	7.21	8.77
	6H	10.04	10.34	11.20	11.52	13.08	6.22	6.52	7.38	7.70	9.25
	8H	10.25	10.52	11.42	11.67	13.25	6.41	6.67	7.57	7.82	9.40
	12H	10.38	10.62	11.55	11.76	13.38	6.52	6.75	7.68	7.90	9.51
12H	4H	9.43	9.77	10.59	10.91	12.47	5.71	6.05	6.87	7.19	8.75
	6H	10.02	10.28	11.18	11.43	13.01	6.27	6.53	7.43	7.69	9.26
	8H	10.23	10.46	11.40	11.61	13.22	6.47	6.70	7.64	7.85	9.46

END OF REPORT