

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919432

Luminaire Tested: DFN2DIP-PN3F0-070D040US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919432
REPORT IS A COMBINATION OF REPORTS P899533 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D040US935-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9014.7 lumens
Efficiency: N/A
Efficacy: 90.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFLL

Luminous Intensity Polar Plot

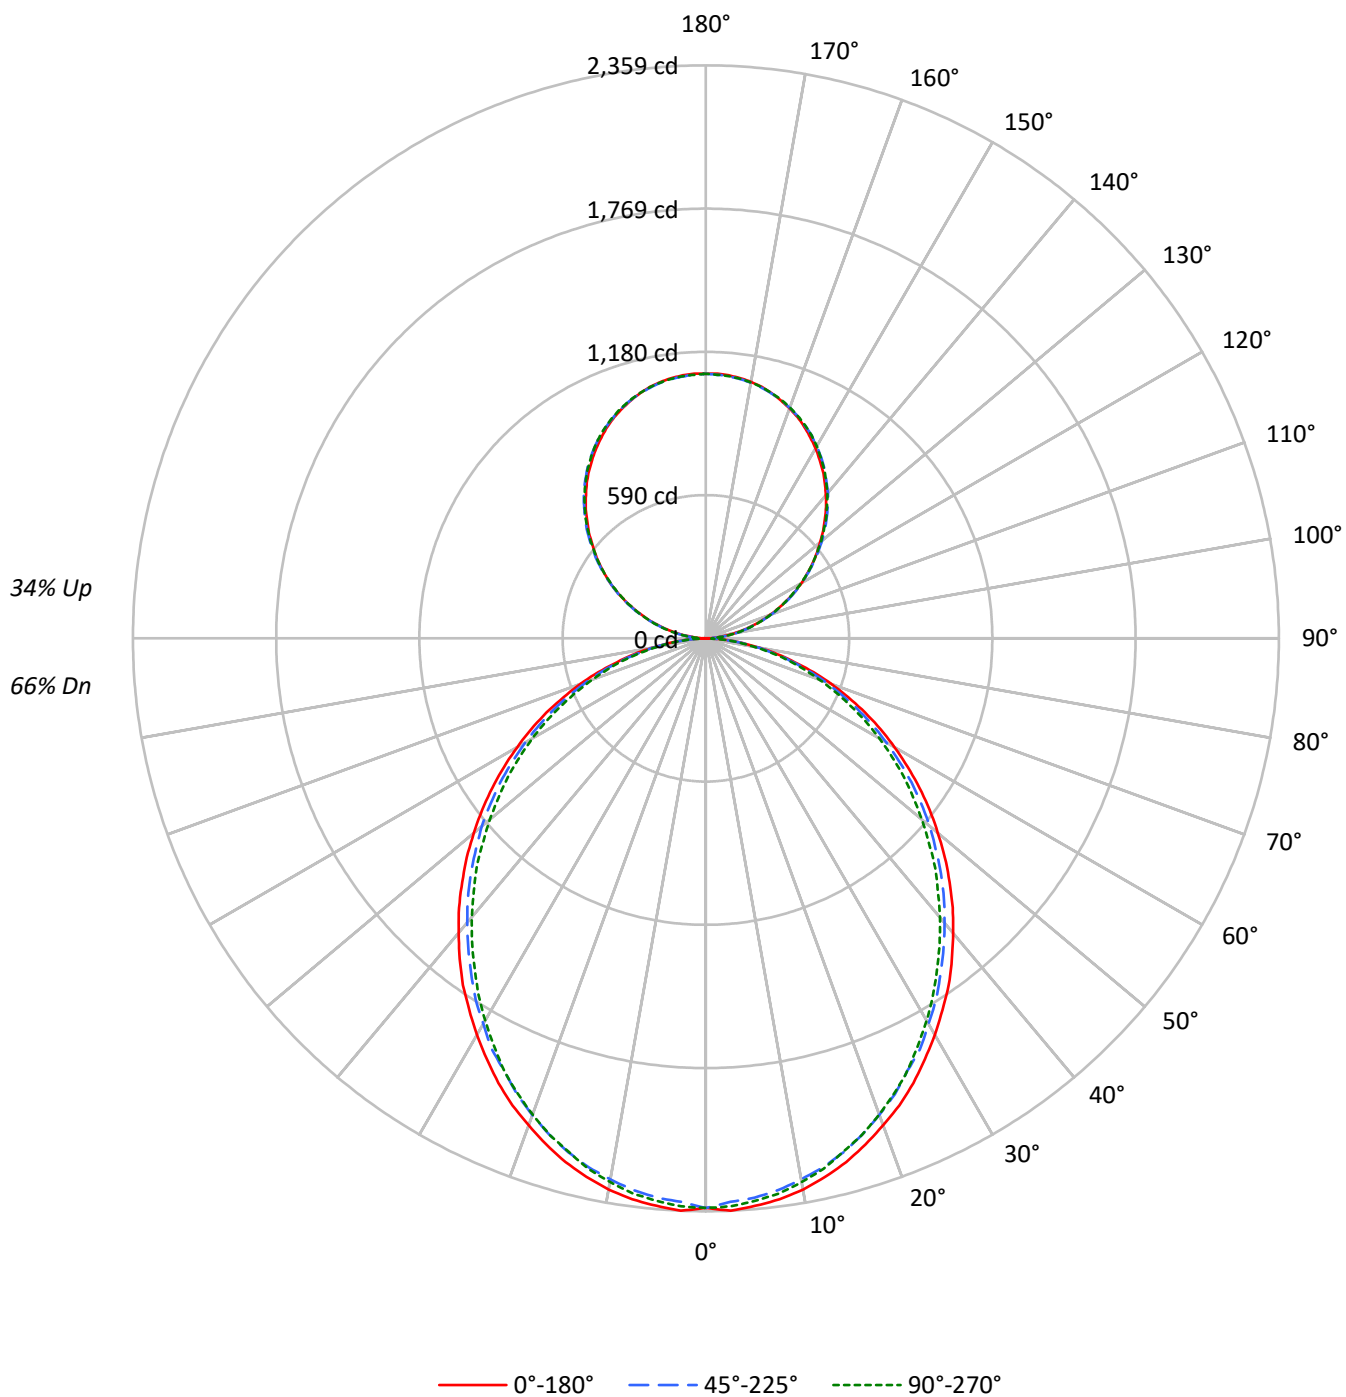

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	72	70	68	63	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	60	57	55	53	51
3	84	75	67	61	79	70	64	58	63	57	53	56	51	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	25
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2741	2741	2741
5°	2744	2701	2720
10°	2720	2663	2682
15°	2679	2617	2624
20°	2623	2554	2563
25°	2568	2480	2494
30°	2498	2410	2406
35°	2433	2328	2314
40°	2352	2245	2225
45°	2272	2162	2135
50°	2184	2075	2030
55°	2092	1974	1934
60°	1987	1854	1823
65°	1873	1730	1693
70°	1728	1578	1552
75°	1528	1396	1420
80°	1285	1164	1172
85°	906	771	764

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2272 cd/sqm

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	2.4
10°-20°	621.0	6.9
20°-30°	912.7	10.1
30°-40°	1060.0	11.8
40°-50°	1058.7	11.7
50°-60°	923.2	10.2
60°-70°	682.4	7.6
70°-80°	386.1	4.3
80°-90°	105.0	1.2
90°-100°	67.4	0.7
100°-110°	214.2	2.4
110°-120°	366.5	4.1
120°-130°	482.0	5.3
130°-140°	541.0	6.0
140°-150°	530.5	5.9
150°-160°	445.0	4.9
160°-170°	295.1	3.3
170°-180°	103.2	1.1
0°-30°	1754.4	19.5
0°-40°	2814.4	31.2
0°-60°	4796.3	53.2
0°-90°	5969.8	66.2
90°-120°	648.0	7.2
90°-150°	2201.5	24.4
90°-180°	3045.0	33.8
0°-180°	9014.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	1	12	32	30	31	9
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P919432

CATALOG NUMBER: DFN2DIP-PN3F0-070D040US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.11	13.14	12.92	13.97	14.99	11.67	12.70	12.48	13.53	14.55
	3H	13.78	14.70	14.60	15.54	16.59	13.30	14.22	14.11	15.06	16.10
	4H	14.37	15.24	15.20	16.09	17.15	13.89	14.76	14.72	15.60	16.66
	6H	14.77	15.58	15.62	16.43	17.50	14.28	15.09	15.13	15.94	17.01
	8H	14.88	15.65	15.74	16.52	17.59	14.39	15.16	15.25	16.03	17.10
	12H	14.93	15.66	15.79	16.53	17.63	14.44	15.17	15.30	16.03	17.13
4H	2H	12.59	13.46	13.43	14.31	15.37	12.24	13.11	13.08	13.96	15.01
	3H	14.46	15.19	15.31	16.07	17.14	14.06	14.79	14.91	15.67	16.74
	4H	15.18	15.84	16.04	16.72	17.82	14.76	15.43	15.63	16.30	17.40
	6H	15.70	16.27	16.58	17.17	18.28	15.28	15.85	16.16	16.75	17.85
	8H	15.85	16.39	16.73	17.28	18.40	15.42	15.96	16.30	16.85	17.97
	12H	15.93	16.41	16.83	17.32	18.45	15.49	15.97	16.39	16.89	18.01
8H	4H	15.39	15.92	16.27	16.82	17.93	15.02	15.55	15.90	16.45	17.56
	6H	16.02	16.46	16.93	17.40	18.51	15.64	16.09	16.55	17.02	18.14
	8H	16.24	16.63	17.15	17.56	18.69	15.85	16.25	16.77	17.17	18.31
	12H	16.37	16.72	17.29	17.64	18.82	15.97	16.32	16.89	17.24	18.42
12H	4H	15.38	15.86	16.28	16.78	17.90	15.02	15.50	15.92	16.41	17.54
	6H	16.05	16.44	16.97	17.37	18.50	15.68	16.08	16.60	17.00	18.14
	8H	16.29	16.64	17.21	17.56	18.74	15.92	16.27	16.84	17.19	18.37