

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919441

Luminaire Tested: DFN2DIP-PN3F0-070D060US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919441
REPORT IS A COMBINATION OF REPORTS P901081 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D060US935-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11081.1 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 115.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

Luminous Intensity Polar Plot

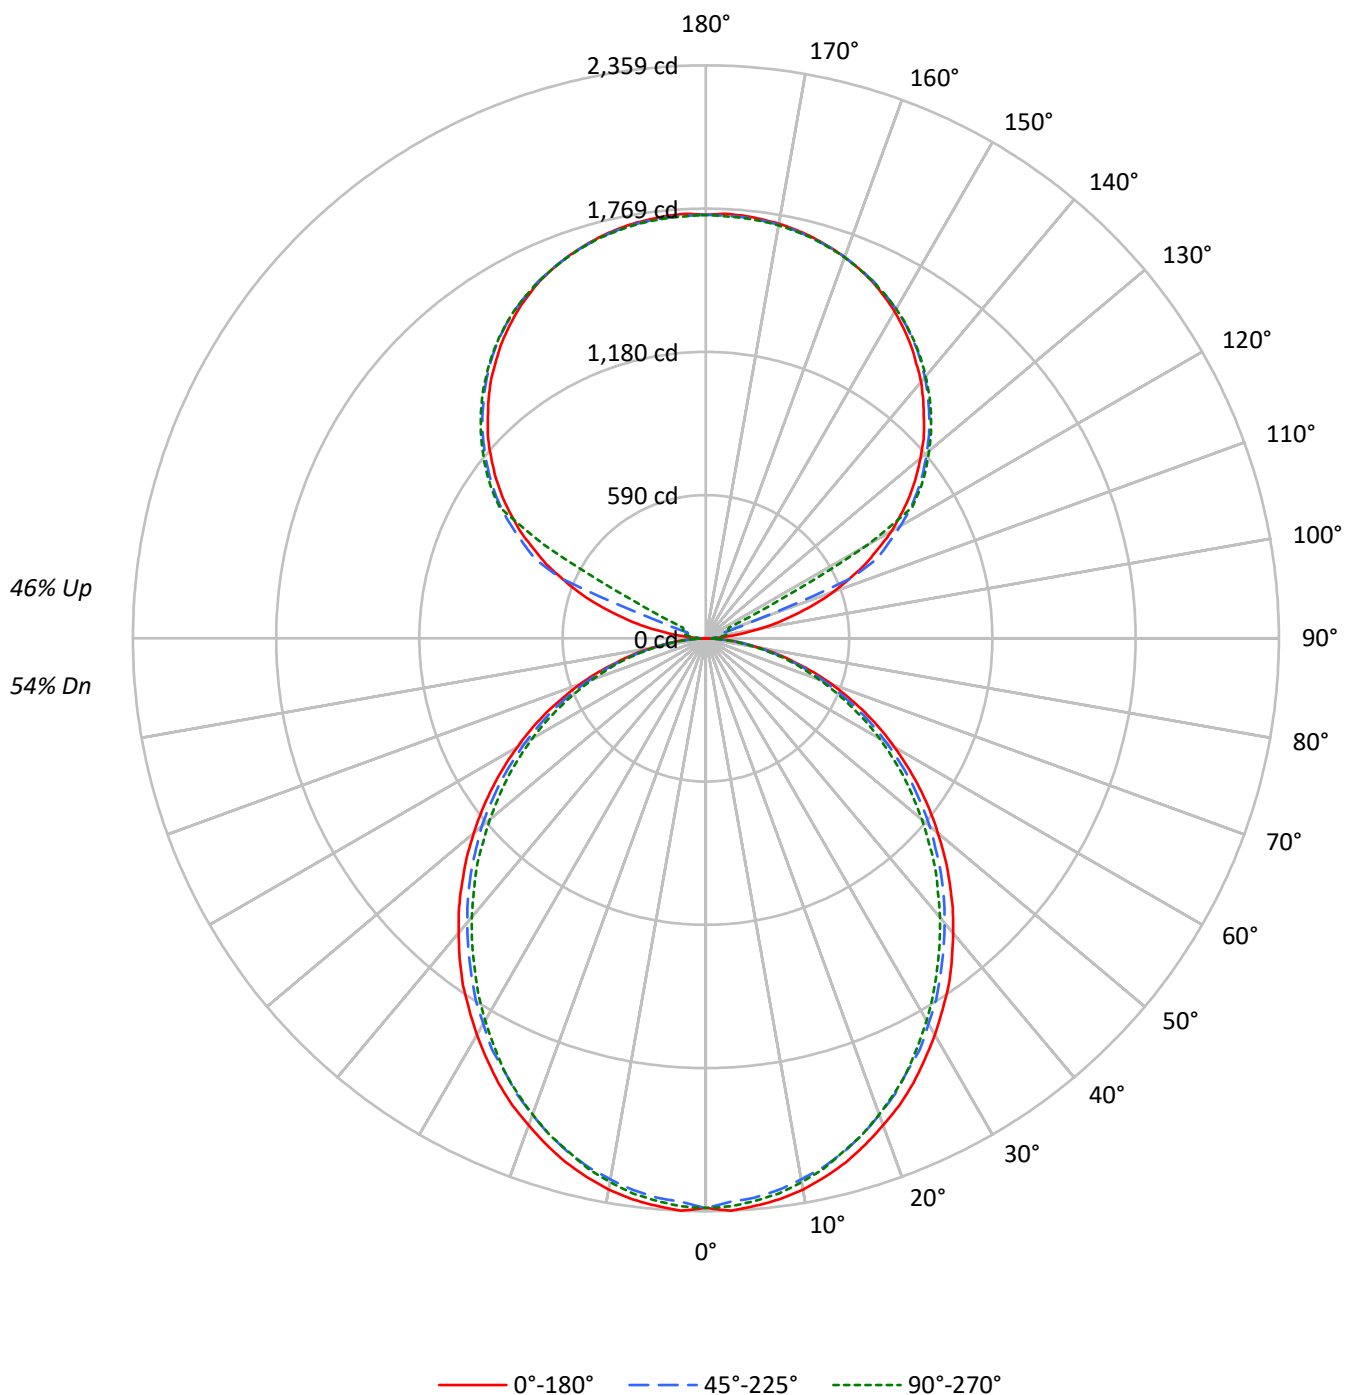

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	60	60	60
1	99	94	90	87	91	88	84	81	75	73	70	63	62	60	53	52	50
2	90	82	76	71	83	77	71	67	66	62	58	56	53	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	46	42	41	38	36
4	75	64	56	50	69	60	53	47	52	46	42	44	40	36	37	34	31
5	69	57	49	43	64	53	46	41	46	40	36	39	35	32	33	30	27
6	63	51	43	37	59	48	41	35	42	36	31	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	28	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	32	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2741	2741	2741
5°	2744	2701	2720
10°	2720	2663	2682
15°	2679	2617	2624
20°	2623	2554	2563
25°	2568	2480	2494
30°	2498	2410	2406
35°	2433	2328	2314
40°	2352	2245	2225
45°	2272	2162	2135
50°	2184	2075	2030
55°	2092	1974	1934
60°	1987	1854	1823
65°	1873	1730	1693
70°	1728	1578	1552
75°	1528	1396	1420
80°	1285	1164	1172
85°	906	771	764

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2272 cd/sqm

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	2.0
10°-20°	621.0	5.6
20°-30°	912.7	8.2
30°-40°	1060.0	9.6
40°-50°	1058.7	9.6
50°-60°	923.2	8.3
60°-70°	682.4	6.2
70°-80°	386.1	3.5
80°-90°	105.0	0.9
90°-100°	57.5	0.5
100°-110°	214.3	1.9
110°-120°	568.4	5.1
120°-130°	942.7	8.5
130°-140°	1001.4	9.0
140°-150°	930.7	8.4
150°-160°	748.2	6.8
160°-170°	482.1	4.4
170°-180°	165.9	1.5
0°-30°	1754.4	15.8
0°-40°	2814.4	25.4
0°-60°	4796.3	43.3
0°-90°	5969.8	53.9
90°-120°	840.2	7.6
90°-150°	3714.9	33.5
90°-180°	5111.0	46.1
0°-180°	11081.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	1	15	25	32	34	10
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P919441

CATALOG NUMBER: DFN2DIP-PN3F0-070D060US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.09	11.98	12.01	12.93	14.14	10.65	11.55	11.57	12.49	13.70
	3H	12.74	13.55	13.68	14.50	15.74	12.26	13.07	13.20	14.02	15.26
	4H	13.33	14.09	14.28	15.05	16.29	12.84	13.61	13.79	14.56	15.81
	6H	13.73	14.43	14.69	15.39	16.65	13.24	13.94	14.20	14.90	16.16
	8H	13.83	14.50	14.80	15.48	16.74	13.34	14.01	14.31	14.99	16.24
	12H	13.88	14.51	14.85	15.49	16.77	13.38	14.02	14.35	14.99	16.27
4H	2H	11.55	12.31	12.50	13.27	14.51	11.20	11.96	12.15	12.92	14.16
	3H	13.41	14.05	14.38	15.03	16.29	13.01	13.65	13.98	14.63	15.89
	4H	14.12	14.70	15.10	15.68	16.97	13.71	14.29	14.68	15.27	16.55
	6H	14.63	15.14	15.62	16.14	17.42	14.21	14.71	15.20	15.71	17.00
	8H	14.78	15.25	15.77	16.25	17.54	14.36	14.82	15.34	15.82	17.12
	12H	14.85	15.28	15.86	16.29	17.59	14.42	14.84	15.42	15.85	17.16
8H	4H	14.32	14.79	15.31	15.78	17.08	13.95	14.42	14.94	15.41	16.71
	6H	14.94	15.33	15.96	16.37	17.67	14.57	14.96	15.58	15.99	17.29
	8H	15.16	15.50	16.18	16.53	17.84	14.78	15.12	15.80	16.14	17.46
	12H	15.29	15.59	16.31	16.61	17.97	14.89	15.19	15.92	16.21	17.57
12H	4H	14.30	14.73	15.31	15.74	17.04	13.94	14.37	14.95	15.38	16.68
	6H	14.97	15.31	15.99	16.34	17.65	14.61	14.95	15.63	15.97	17.29
	8H	15.21	15.51	16.24	16.53	17.89	14.84	15.14	15.87	16.16	17.52