

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919456

Luminaire Tested: DFN2DIP-PN3F0-080D030US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919456
REPORT IS A COMBINATION OF REPORTS P899521 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D030US935-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9105.0 lumens
Efficiency: N/A
Efficacy: 88.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 103.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFLL

Luminous Intensity Polar Plot

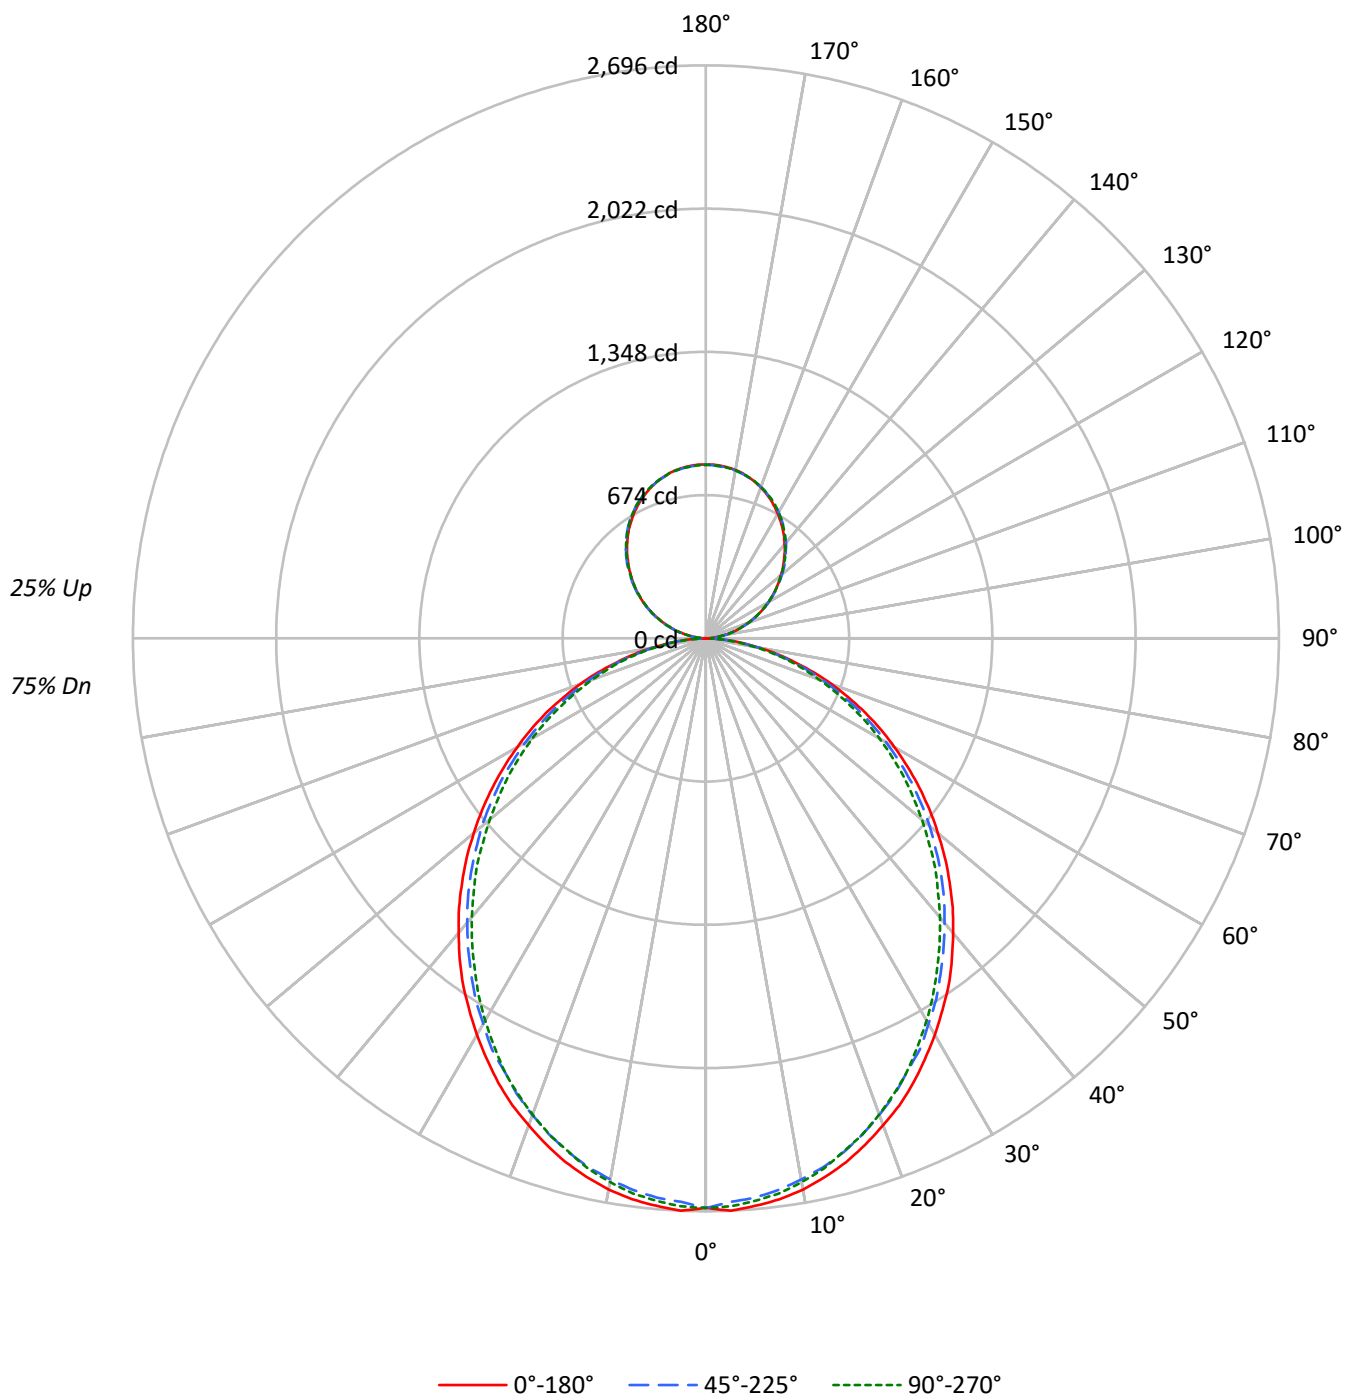

TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	45	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	36	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3133	3133	3133
5°	3136	3087	3109
10°	3109	3043	3065
15°	3061	2991	2998
20°	2998	2919	2930
25°	2934	2834	2851
30°	2855	2754	2750
35°	2780	2661	2644
40°	2688	2566	2543
45°	2597	2471	2440
50°	2496	2371	2320
55°	2391	2256	2210
60°	2271	2119	2083
65°	2141	1977	1934
70°	1975	1804	1774
75°	1745	1596	1623
80°	1469	1331	1339
85°	1036	881	873

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2597 cd/sqm

TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	2.8
10°-20°	709.8	7.8
20°-30°	1043.1	11.5
30°-40°	1211.4	13.3
40°-50°	1209.9	13.3
50°-60°	1055.0	11.6
60°-70°	779.9	8.6
70°-80°	441.2	4.8
80°-90°	118.8	1.3
90°-100°	50.6	0.6
100°-110°	160.6	1.8
110°-120°	274.9	3.0
120°-130°	361.5	4.0
130°-140°	405.7	4.5
140°-150°	397.9	4.4
150°-160°	333.8	3.7
160°-170°	221.3	2.4
170°-180°	77.4	0.8
0°-30°	2005.1	22.0
0°-40°	3216.5	35.3
0°-60°	5481.5	60.2
0°-90°	6821.4	74.9
90°-120°	486.0	5.3
90°-150°	1651.1	18.1
90°-180°	2284.0	25.1
0°-180°	9105.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	1	9	24	23	23	9
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	



TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3

TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P919456

CATALOG NUMBER: DFN2DIP-PN3F0-080D030US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.24	14.38	13.95	15.11	15.97	12.80	13.94	13.51	14.67	15.54
	3H	14.91	15.94	15.64	16.68	17.58	14.43	15.46	15.15	16.20	17.09
	4H	15.51	16.48	16.25	17.23	18.14	15.03	15.99	15.77	16.74	17.65
	6H	15.92	16.81	16.67	17.57	18.50	15.43	16.32	16.18	17.08	18.01
	8H	16.03	16.88	16.80	17.66	18.59	15.54	16.39	16.30	17.17	18.10
	12H	16.09	16.90	16.86	17.67	18.62	15.59	16.40	16.36	17.17	18.13
4H	2H	13.73	14.70	14.48	15.45	16.36	13.38	14.35	14.12	15.10	16.01
	3H	15.61	16.42	16.37	17.21	18.13	15.21	16.02	15.97	16.81	17.73
	4H	16.33	17.07	17.11	17.86	18.81	15.92	16.65	16.69	17.44	18.39
	6H	16.86	17.50	17.65	18.31	19.27	16.44	17.07	17.23	17.88	18.85
	8H	17.01	17.61	17.81	18.41	19.39	16.59	17.18	17.38	17.99	18.96
	12H	17.10	17.63	17.91	18.46	19.44	16.66	17.20	17.47	18.02	19.00
8H	4H	16.55	17.15	17.34	17.95	18.93	16.18	16.78	16.97	17.58	18.56
	6H	17.18	17.68	18.01	18.53	19.50	16.81	17.30	17.63	18.15	19.13
	8H	17.40	17.84	18.24	18.69	19.68	17.02	17.46	17.86	18.31	19.30
	12H	17.54	17.93	18.38	18.77	19.82	17.14	17.53	17.98	18.37	19.42
12H	4H	16.55	17.08	17.36	17.91	18.89	16.19	16.72	17.00	17.55	18.53
	6H	17.22	17.66	18.05	18.50	19.49	16.85	17.29	17.69	18.14	19.13
	8H	17.47	17.85	18.30	18.69	19.74	17.09	17.48	17.93	18.32	19.37