

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919483

Luminaire Tested: DFN2DIP-PN3F0-080D090US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919483
REPORT IS A COMBINATION OF REPORTS P901126 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D090US935-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13526.3 lumens
Efficiency: N/A
Efficacy: 89.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLLONL

Luminous Intensity Polar Plot

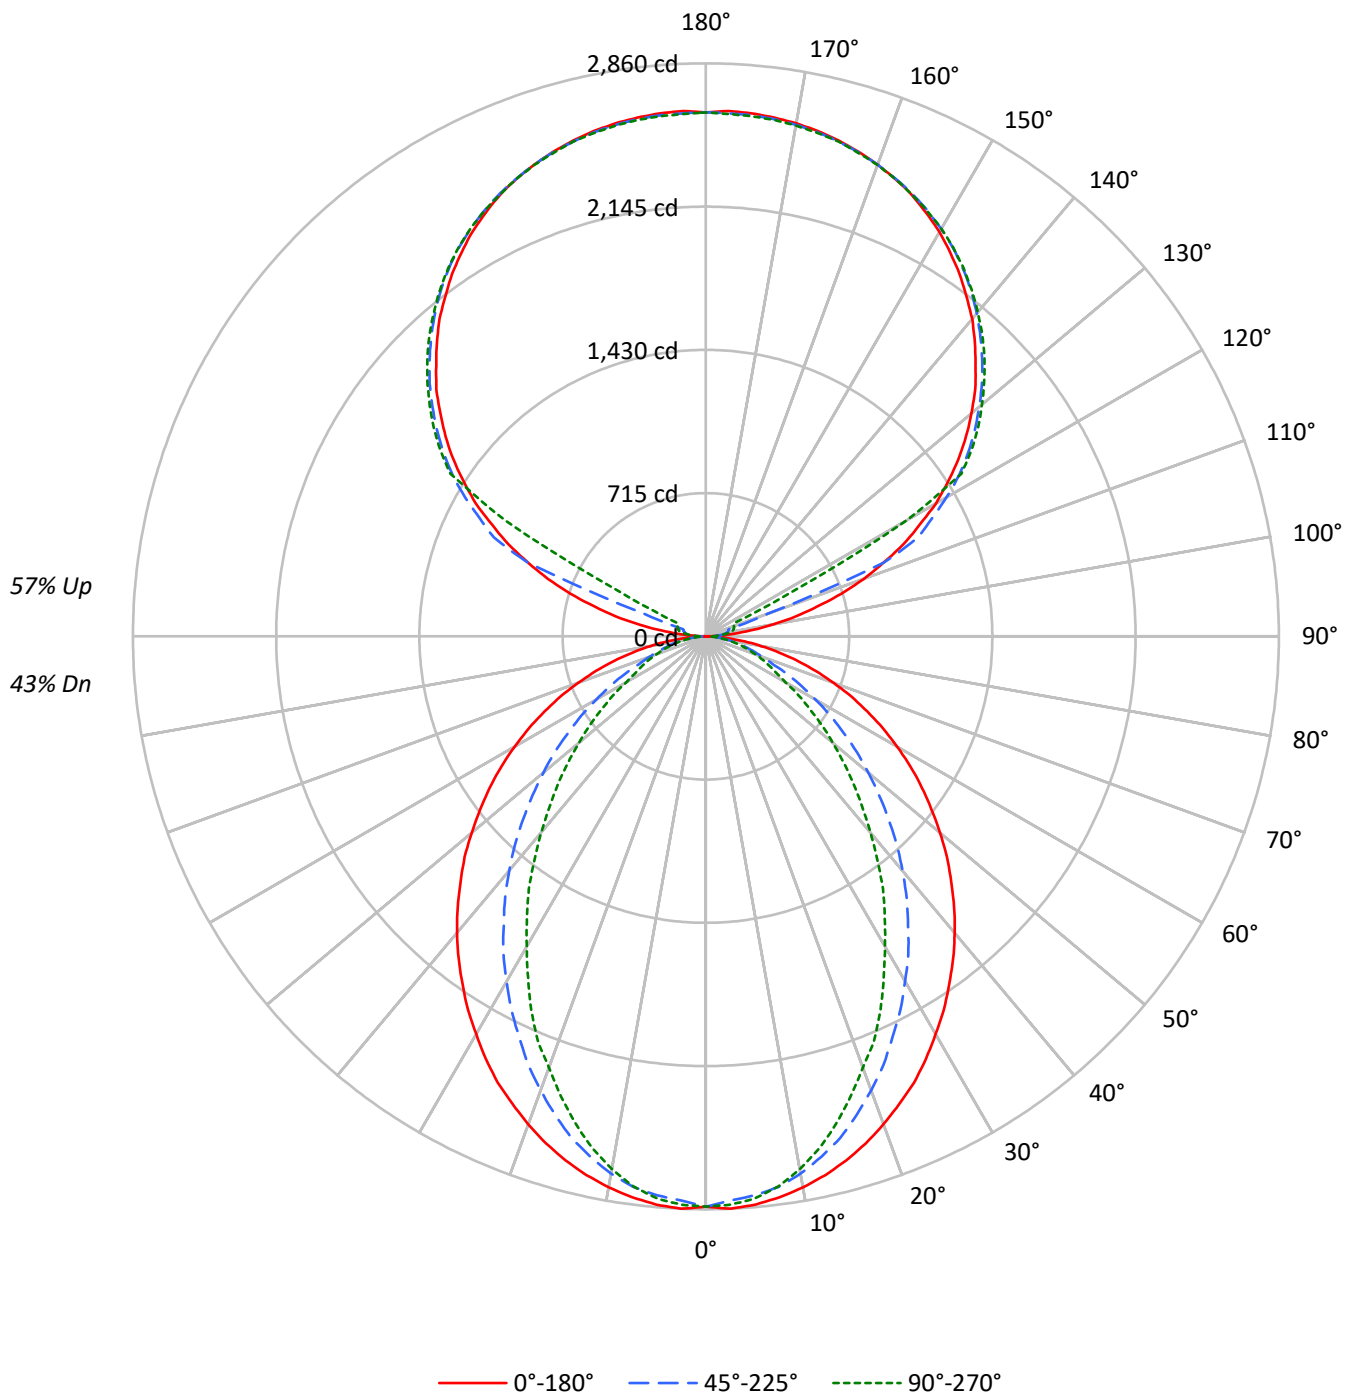

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	27	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	22	19
8	54	42	35	30	49	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3328	3328	3328
5°	3331	3273	3295
10°	3296	3206	3186
15°	3249	3098	3019
20°	3187	2950	2815
25°	3123	2784	2617
30°	3039	2614	2367
35°	2956	2432	2148
40°	2871	2244	1896
45°	2773	2035	1669
50°	2671	1824	1446
55°	2565	1600	1232
60°	2442	1365	1013
65°	2300	1127	910
70°	2128	905	822
75°	1912	793	744
80°	1598	658	641
85°	1086	428	473

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2773 cd/sqm

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	266.8	2.0
10°-20°	732.4	5.4
20°-30°	1028.3	7.6
30°-40°	1120.9	8.3
40°-50°	1030.3	7.6
50°-60°	809.1	6.0
60°-70°	526.6	3.9
70°-80°	271.1	2.0
80°-90°	73.8	0.5
90°-100°	86.2	0.6
100°-110°	321.5	2.4
110°-120°	852.6	6.3
120°-130°	1414.1	10.5
130°-140°	1502.1	11.1
140°-150°	1396.0	10.3
150°-160°	1122.4	8.3
160°-170°	723.2	5.3
170°-180°	248.9	1.8
0°-30°	2027.6	15.0
0°-40°	3148.5	23.3
0°-60°	4987.8	36.9
0°-90°	5859.4	43.3
90°-120°	1260.3	9.3
90°-150°	5572.4	41.2
90°-180°	7667.0	56.7
0°-180°	13526.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2847	2847	2847	2847	2847	
5°	2847	2834	2800	2824	2816	270
15°	2708	2679	2592	2543	2517	763
25°	2458	2375	2205	2100	2061	1130
35°	2118	1986	1760	1597	1540	1326
45°	1731	1559	1288	1105	1043	1337
55°	1316	1116	837	683	634	1176
65°	889	680	448	361	353	881
75°	474	294	206	188	186	501
85°	111	57	49	49	49	127
90°	2	23	38	47	51	13
95°	123	60	74	83	81	146
105°	575	632	116	136	144	615
115°	1088	1120	1168	291	155	1071
125°	1538	1563	1599	1612	1618	1372
135°	1904	1934	1951	1970	1966	1471
145°	2208	2206	2239	2252	2242	1381
155°	2432	2415	2437	2449	2434	1121
165°	2562	2551	2557	2570	2557	724
175°	2621	2608	2611	2625	2606	249
180°	2615	2615	2615	2615	2615	

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2846.8	2846.8	2846.8	2846.8	2846.8
2.5°	2859.6	2846.8	2818.4	2844.3	2839.1
5°	2846.8	2834.0	2800.3	2823.6	2815.9
7.5°	2823.6	2808.2	2772.2	2782.3	2769.4
10°	2792.6	2774.7	2723.3	2715.3	2700.0
12.5°	2754.2	2730.9	2661.2	2645.8	2617.4
15°	2707.7	2679.3	2591.8	2542.9	2517.1
17.5°	2653.5	2612.3	2504.0	2447.5	2406.1
20°	2591.8	2540.1	2411.4	2347.2	2290.3
22.5°	2524.8	2465.5	2316.0	2228.5	2189.9
25°	2457.8	2375.3	2205.3	2099.8	2061.0
27.5°	2378.0	2290.3	2102.2	1981.2	1921.8
30°	2293.0	2194.9	1988.8	1857.6	1787.9
32.5°	2210.4	2091.9	1880.8	1726.1	1661.6
35°	2117.8	1986.3	1759.7	1597.4	1540.5
37.5°	2027.6	1885.8	1646.3	1468.3	1404.1
40°	1932.3	1777.8	1527.7	1344.8	1277.8
42.5°	1834.4	1669.6	1409.3	1218.6	1154.3
45°	1731.3	1558.6	1288.2	1105.1	1043.4
47.5°	1633.5	1450.6	1172.3	989.2	932.6
50°	1525.2	1342.4	1058.9	881.0	827.1
52.5°	1419.4	1226.1	950.6	780.7	731.8
55°	1316.4	1115.5	837.2	682.8	633.9
57.5°	1210.9	1004.8	736.9	592.6	551.3
60°	1102.6	896.6	631.1	499.9	458.7
62.5°	997.1	791.0	541.0	417.4	396.9
65°	888.9	680.0	448.2	360.8	352.8
67.5°	785.8	577.0	360.8	316.8	309.2
70°	677.6	476.7	298.8	273.0	262.7
72.5°	574.5	383.7	249.9	229.4	224.1
75°	474.0	293.6	206.1	188.0	185.6
77.5°	373.7	208.5	162.4	152.0	146.8
80°	280.7	149.6	123.6	113.4	113.4
82.5°	195.7	100.6	85.0	79.8	79.8
85°	110.7	56.6	48.9	48.9	48.9
87.5°	41.2	20.5	20.5	18.1	18.1
90°	1.8	22.7	37.7	47.4	51.0
92.5°	47.4	39.8	45.4	49.2	51.0
95°	123.0	60.4	73.7	83.3	81.4
97.5°	221.4	66.3	96.4	102.2	104.0
100°	335.0	75.8	107.9	123.0	126.7
102.5°	459.8	456.2	111.7	132.3	138.2
105°	575.2	632.1	115.5	136.2	143.8
107.5°	709.6	756.8	119.3	140.0	147.7
110°	838.4	878.0	331.2	142.0	149.5

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	959.5	993.4	961.3	145.6	151.4
115°	1088.0	1120.2	1167.6	291.4	155.2
117.5°	1199.7	1237.5	1269.8	999.1	503.3
120°	1324.6	1353.0	1387.2	1409.8	1154.3
122.5°	1430.5	1460.9	1498.8	1510.0	1512.1
125°	1538.3	1563.1	1599.0	1612.3	1617.9
127.5°	1636.8	1663.3	1691.9	1710.7	1712.5
130°	1729.6	1760.0	1780.6	1801.5	1799.7
132.5°	1824.2	1848.9	1869.6	1886.7	1884.9
135°	1903.8	1934.1	1950.9	1970.0	1966.3
137.5°	1986.9	2009.6	2028.7	2047.5	2041.9
140°	2068.2	2083.5	2104.2	2121.2	2111.9
142.5°	2136.6	2149.8	2174.3	2189.3	2180.0
145°	2208.5	2206.4	2238.6	2251.9	2242.4
147.5°	2270.7	2265.1	2297.2	2306.7	2299.2
150°	2331.4	2318.2	2348.5	2359.7	2350.3
152.5°	2382.4	2367.3	2395.6	2407.1	2393.8
155°	2431.6	2414.8	2437.4	2448.7	2433.6
157.5°	2471.4	2456.3	2473.4	2486.6	2471.4
160°	2505.5	2494.1	2505.5	2516.8	2503.5
162.5°	2535.6	2524.4	2533.8	2547.1	2530.0
165°	2562.2	2550.9	2556.6	2569.8	2556.6
167.5°	2583.1	2571.6	2577.4	2590.7	2573.6
170°	2600.1	2588.7	2592.5	2605.7	2588.7
172.5°	2611.4	2600.1	2603.9	2617.2	2600.1
175°	2620.8	2607.5	2611.4	2624.6	2605.7
177.5°	2624.6	2611.4	2613.4	2626.6	2609.6
180°	2615.2	2615.2	2615.2	2615.2	2615.2

TEST NUMBER: P919483

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.63	11.41	11.65	12.43	13.80	6.59	7.37	7.61	8.40	9.76
	3H	12.30	12.99	13.32	14.02	15.41	7.77	8.47	8.80	9.50	10.89
	4H	12.90	13.56	13.94	14.59	15.99	8.22	8.88	9.26	9.91	11.30
	6H	13.31	13.92	14.36	14.96	16.36	8.53	9.14	9.58	10.17	11.58
	8H	13.43	14.01	14.49	15.07	16.47	8.62	9.19	9.67	10.25	11.65
	12H	13.49	14.04	14.55	15.09	16.51	8.65	9.20	9.72	10.25	11.68
4H	2H	10.64	11.30	11.69	12.33	13.73	7.18	7.84	8.23	8.87	10.27
	3H	12.46	13.00	13.51	14.07	15.47	8.52	9.07	9.57	10.13	11.54
	4H	13.14	13.64	14.20	14.70	16.13	9.06	9.56	10.12	10.61	12.04
	6H	13.65	14.08	14.72	15.16	16.58	9.47	9.90	10.54	10.98	12.40
	8H	13.82	14.22	14.89	15.29	16.73	9.59	10.00	10.66	11.06	12.50
	12H	13.91	14.27	15.00	15.35	16.80	9.65	10.02	10.74	11.10	12.54
8H	4H	13.10	13.51	14.18	14.57	16.01	9.33	9.73	10.40	10.80	12.24
	6H	13.66	13.99	14.76	15.10	16.54	9.84	10.17	10.93	11.28	12.72
	8H	13.87	14.16	14.97	15.26	16.71	10.03	10.32	11.13	11.41	12.87
	12H	14.01	14.26	15.11	15.35	16.85	10.14	10.39	11.24	11.48	12.98
12H	4H	13.05	13.42	14.14	14.50	15.94	9.33	9.70	10.42	10.78	12.22
	6H	13.64	13.93	14.74	15.02	16.48	9.89	10.18	10.99	11.27	12.73
	8H	13.85	14.11	14.95	15.20	16.69	10.09	10.35	11.19	11.44	12.93

END OF REPORT