

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919491

Luminaire Tested: DFN2DIP-PN3F0-090D040US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919491
REPORT IS A COMBINATION OF REPORTS P901058 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D040US935-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9996.2 lumens
Efficiency: N/A
Efficacy: 81.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 123
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLLONL

Luminous Intensity Polar Plot

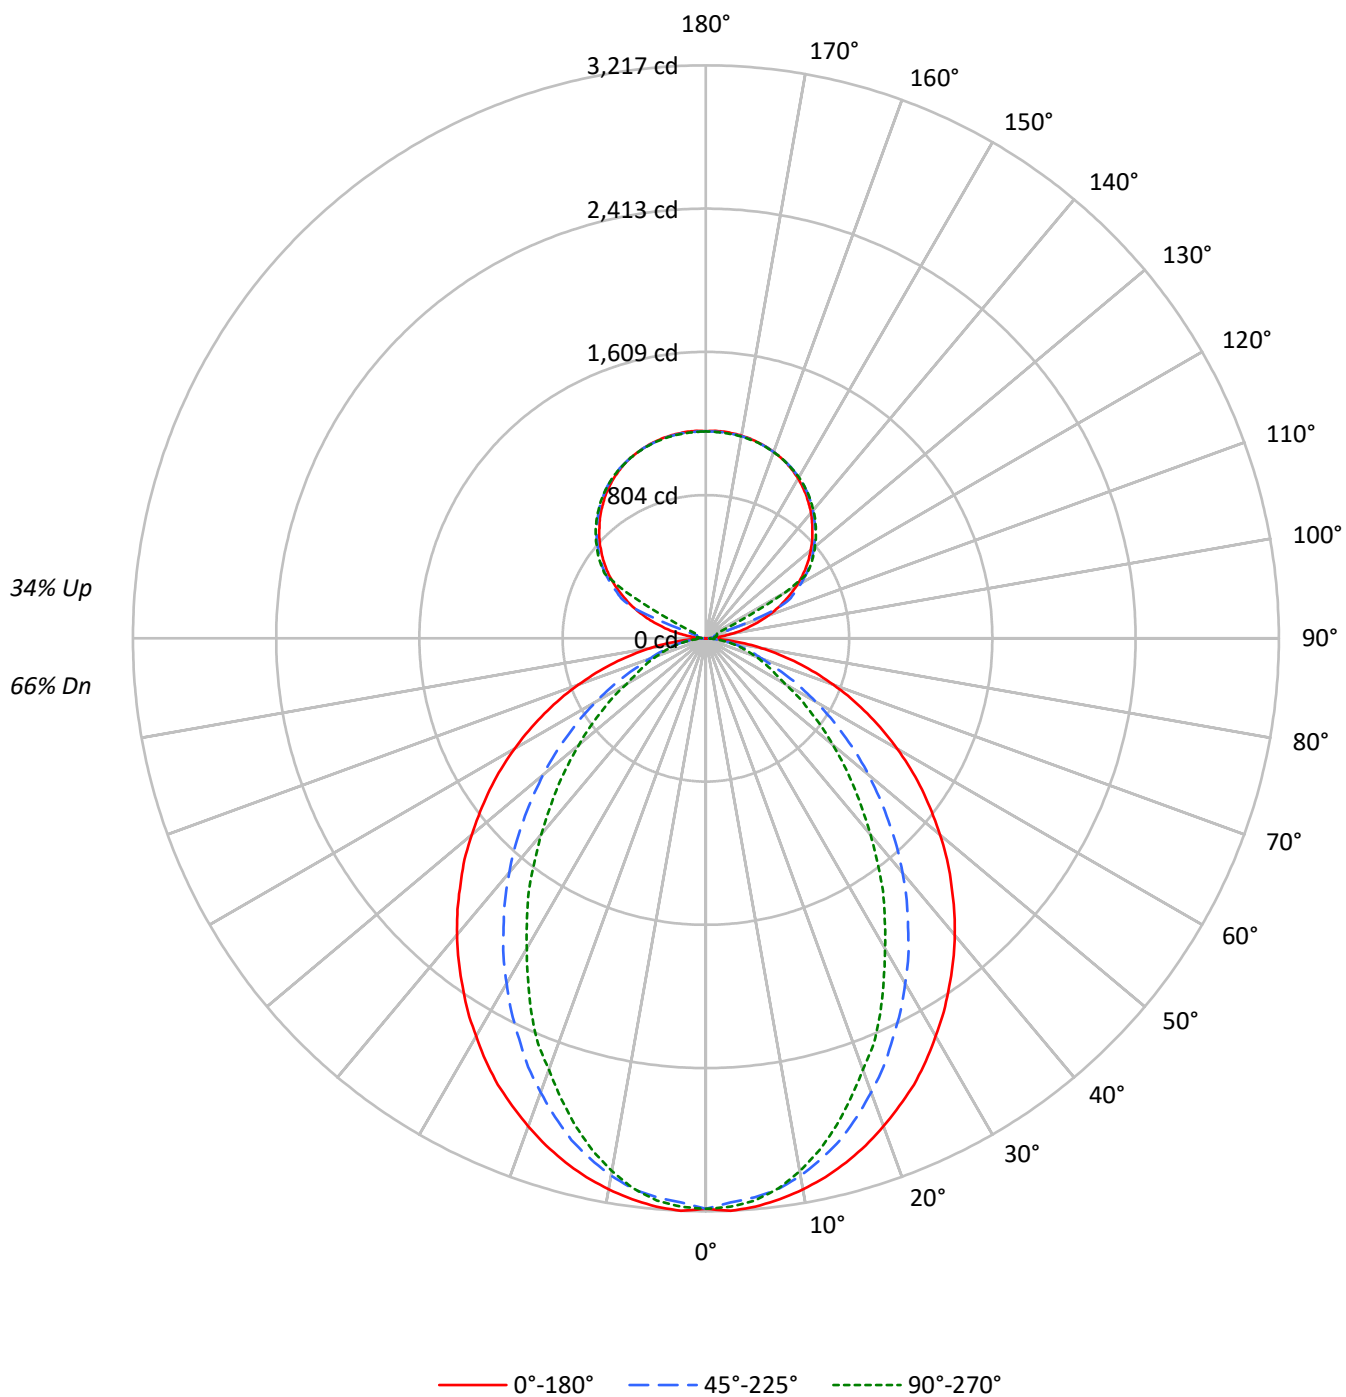

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	71	69	64	62	61
2	93	86	80	75	88	81	76	72	73	68	65	64	61	59	57	54	52
3	86	76	69	63	80	72	66	61	65	60	55	57	54	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	43	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	37	31	27	33	28	25	30	26	23
10	51	39	32	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3744	3744	3744
5°	3748	3682	3706
10°	3708	3607	3584
15°	3655	3485	3396
20°	3585	3318	3166
25°	3514	3132	2944
30°	3419	2941	2663
35°	3325	2736	2416
40°	3230	2524	2133
45°	3120	2289	1877
50°	3005	2052	1627
55°	2886	1800	1386
60°	2747	1536	1140
65°	2588	1268	1024
70°	2394	1018	924
75°	2150	892	837
80°	1798	740	721
85°	1221	481	532

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3120 cd/sqm

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	3.0
10°-20°	824.0	8.2
20°-30°	1156.9	11.6
30°-40°	1261.0	12.6
40°-50°	1159.0	11.6
50°-60°	910.3	9.1
60°-70°	592.5	5.9
70°-80°	305.0	3.1
80°-90°	79.9	0.8
90°-100°	38.3	0.4
100°-110°	142.9	1.4
110°-120°	378.9	3.8
120°-130°	628.5	6.3
130°-140°	667.6	6.7
140°-150°	620.4	6.2
150°-160°	498.8	5.0
160°-170°	321.4	3.2
170°-180°	110.6	1.1
0°-30°	2281.0	22.8
0°-40°	3542.0	35.4
0°-60°	5611.3	56.1
0°-90°	6588.7	65.9
90°-120°	560.1	5.6
90°-150°	2476.6	24.8
90°-180°	3407.0	34.1
0°-180°	9996.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	1	10	17	21	23	9
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.0
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.8	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.7	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.7
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.7	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P919491

CATALOG NUMBER: DFN2DIP-PN3F0-090D040US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.06	14.04	13.88	14.88	15.90	9.03	10.01	9.85	10.84	11.87
	3H	14.75	15.62	15.58	16.47	17.52	10.23	11.10	11.05	11.94	13.00
	4H	15.36	16.19	16.20	17.03	18.10	10.68	11.50	11.52	12.35	13.42
	6H	15.78	16.54	16.64	17.40	18.48	11.00	11.76	11.86	12.62	13.70
	8H	15.91	16.64	16.78	17.51	18.59	11.09	11.82	11.96	12.69	13.77
	12H	15.98	16.66	16.85	17.53	18.64	11.14	11.83	12.01	12.70	13.80
4H	2H	13.10	13.93	13.95	14.77	15.84	9.64	10.47	10.49	11.32	12.38
	3H	14.94	15.62	15.80	16.50	17.59	11.00	11.68	11.86	12.57	13.65
	4H	15.63	16.25	16.50	17.13	18.24	11.55	12.17	12.42	13.05	14.16
	6H	16.15	16.68	17.03	17.59	18.70	11.97	12.51	12.86	13.41	14.52
	8H	16.32	16.82	17.21	17.72	18.85	12.10	12.60	12.99	13.50	14.62
	12H	16.42	16.87	17.33	17.79	18.92	12.16	12.62	13.07	13.53	14.66
8H	4H	15.61	16.11	16.50	17.01	18.13	11.83	12.34	12.73	13.23	14.36
	6H	16.17	16.59	17.09	17.52	18.65	12.35	12.76	13.27	13.70	14.83
	8H	16.38	16.75	17.31	17.68	18.83	12.54	12.90	13.46	13.84	14.98
	12H	16.52	16.85	17.45	17.77	18.97	12.66	12.98	13.59	13.90	15.10
12H	4H	15.56	16.02	16.47	16.93	18.06	11.84	12.30	12.75	13.21	14.34
	6H	16.15	16.51	17.07	17.45	18.59	12.40	12.77	13.33	13.70	14.84
	8H	16.37	16.69	17.30	17.62	18.81	12.61	12.93	13.54	13.86	15.05