

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922085

Luminaire Tested: DFN2DIP-PN3F0-040D060US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922085
REPORT IS A COMBINATION OF REPORTS P901075 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D060US940-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8827.9 lumens
Efficiency: N/A
Efficacy: 109.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 80.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

Luminous Intensity Polar Plot

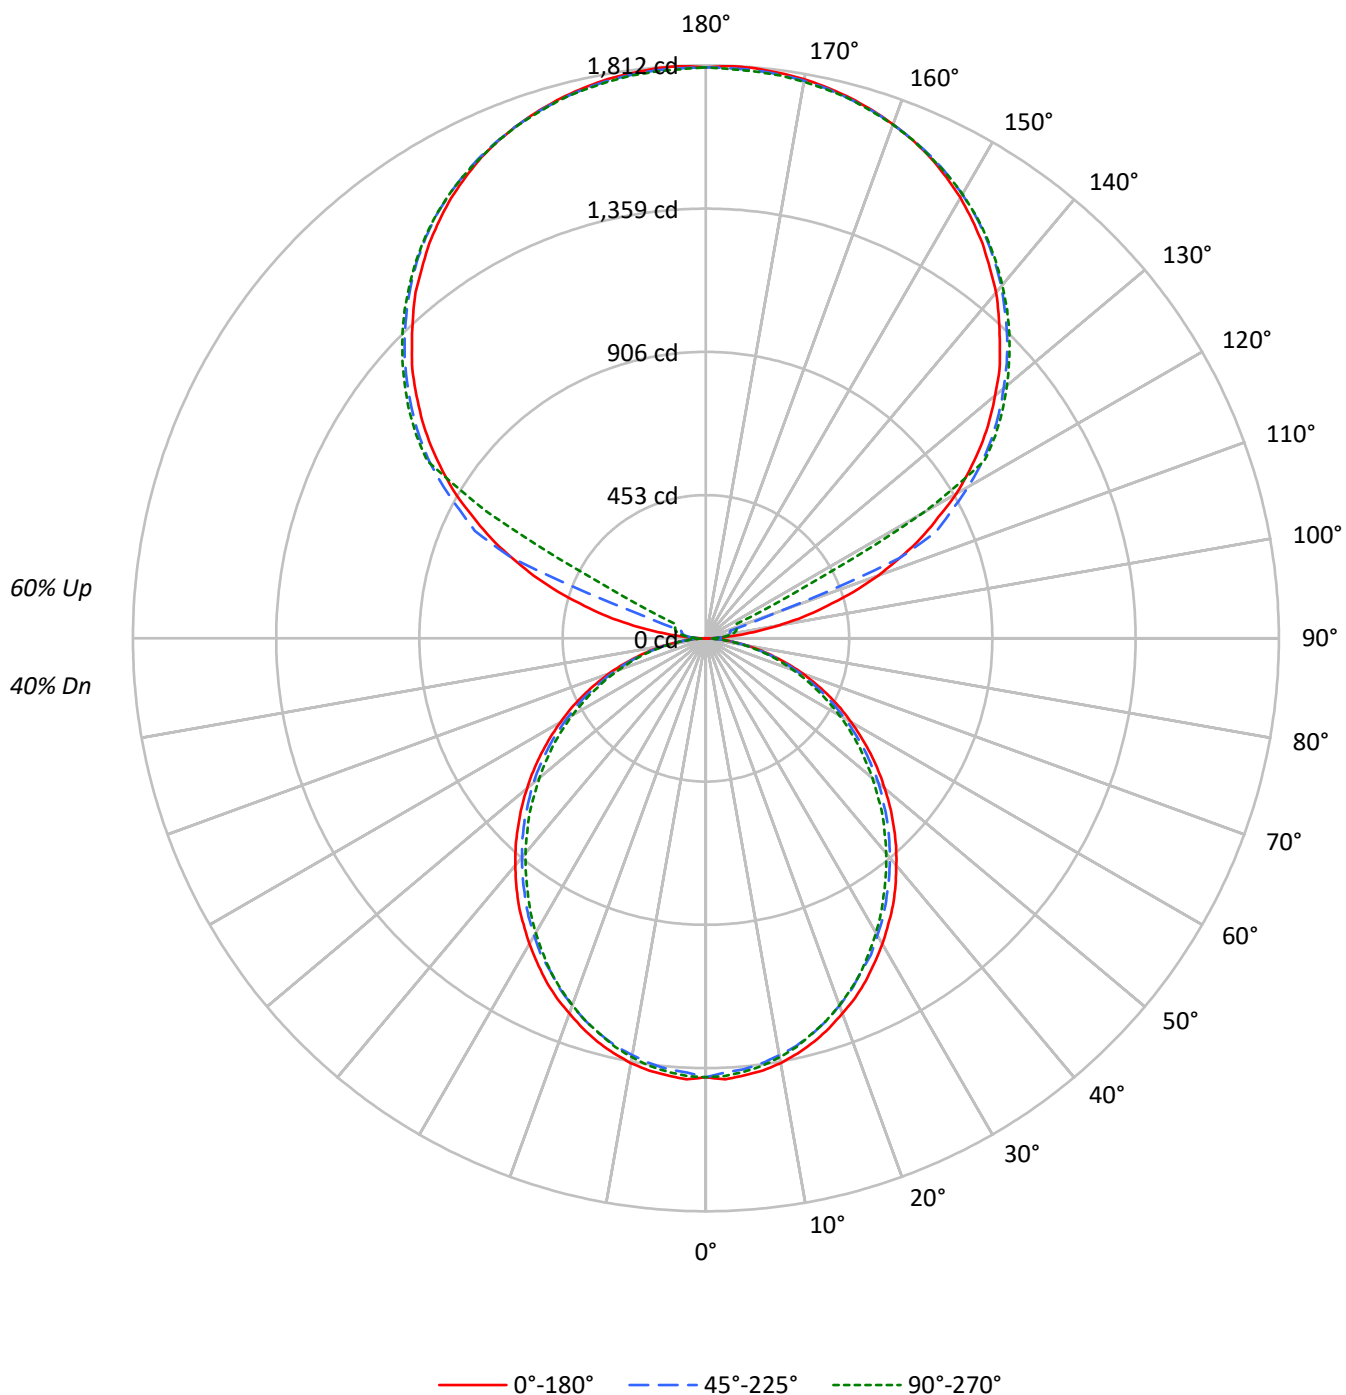

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1622	1622	1622
5°	1624	1599	1610
10°	1610	1576	1587
15°	1585	1549	1553
20°	1552	1512	1517
25°	1519	1467	1476
30°	1479	1426	1424
35°	1440	1378	1369
40°	1392	1329	1317
45°	1345	1279	1263
50°	1293	1228	1201
55°	1238	1168	1144
60°	1176	1097	1079
65°	1109	1024	1002
70°	1023	934	918
75°	904	826	841
80°	760	689	694
85°	537	456	452

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1345 cd/sqm

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.5
10°-20°	367.5	4.2
20°-30°	540.1	6.1
30°-40°	627.3	7.1
40°-50°	626.6	7.1
50°-60°	546.3	6.2
60°-70°	403.9	4.6
70°-80°	228.5	2.6
80°-90°	63.5	0.7
90°-100°	59.5	0.7
100°-110°	222.0	2.5
110°-120°	588.7	6.7
120°-130°	976.3	11.1
130°-140°	1037.1	11.7
140°-150°	963.9	10.9
150°-160°	774.9	8.8
160°-170°	499.3	5.7
170°-180°	171.9	1.9
0°-30°	1038.3	11.8
0°-40°	1665.6	18.9
0°-60°	2838.5	32.2
0°-90°	3534.4	40.0
90°-120°	870.2	9.9
90°-150°	3847.4	43.6
90°-180°	5294.0	60.0
0°-180°	8827.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	16	26	33	35	8
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P922085

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.92	8.70	8.96	9.74	11.15	7.48	8.26	8.52	9.30	10.71
	3H	9.57	10.26	10.61	11.32	12.74	9.08	9.78	10.13	10.83	12.26
	4H	10.15	10.81	11.21	11.86	13.30	9.66	10.32	10.72	11.38	12.81
	6H	10.54	11.15	11.61	12.20	13.65	10.05	10.66	11.12	11.71	13.16
	8H	10.64	11.22	11.71	12.29	13.73	10.15	10.73	11.22	11.80	13.24
	12H	10.68	11.23	11.76	12.30	13.76	10.18	10.73	11.26	11.80	13.27
4H	2H	8.36	9.03	9.43	10.08	11.51	8.01	8.68	9.08	9.73	11.16
	3H	10.22	10.77	11.29	11.85	13.30	9.81	10.37	10.89	11.45	12.89
	4H	10.92	11.43	12.00	12.50	13.97	10.51	11.01	11.59	12.09	13.55
	6H	11.43	11.86	12.52	12.96	14.42	11.00	11.44	12.09	12.54	14.00
	8H	11.57	11.98	12.66	13.07	14.54	11.14	11.55	12.23	12.64	14.12
	12H	11.64	12.01	12.74	13.11	14.59	11.20	11.57	12.31	12.67	14.15
8H	4H	11.11	11.51	12.20	12.60	14.08	10.74	11.14	11.83	12.23	13.71
	6H	11.73	12.06	12.84	13.19	14.67	11.35	11.69	12.46	12.82	14.29
	8H	11.94	12.24	13.06	13.35	14.84	11.56	11.85	12.68	12.97	14.46
	12H	12.07	12.33	13.19	13.43	14.97	11.67	11.93	12.79	13.03	14.57
12H	4H	11.09	11.46	12.20	12.56	14.04	10.73	11.09	11.83	12.20	13.68
	6H	11.76	12.05	12.87	13.16	14.66	11.39	11.69	12.51	12.80	14.29
	8H	11.99	12.25	13.11	13.36	14.89	11.62	11.88	12.74	12.98	14.52

END OF REPORT