

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922118

Luminaire Tested: DFN2DIP-PN3F0-050D070US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922118
REPORT IS A COMBINATION OF REPORTS P899572 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D070US940-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9314.0 lumens
Efficiency: N/A
Efficacy: 93.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 99.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLLFLL

Luminous Intensity Polar Plot

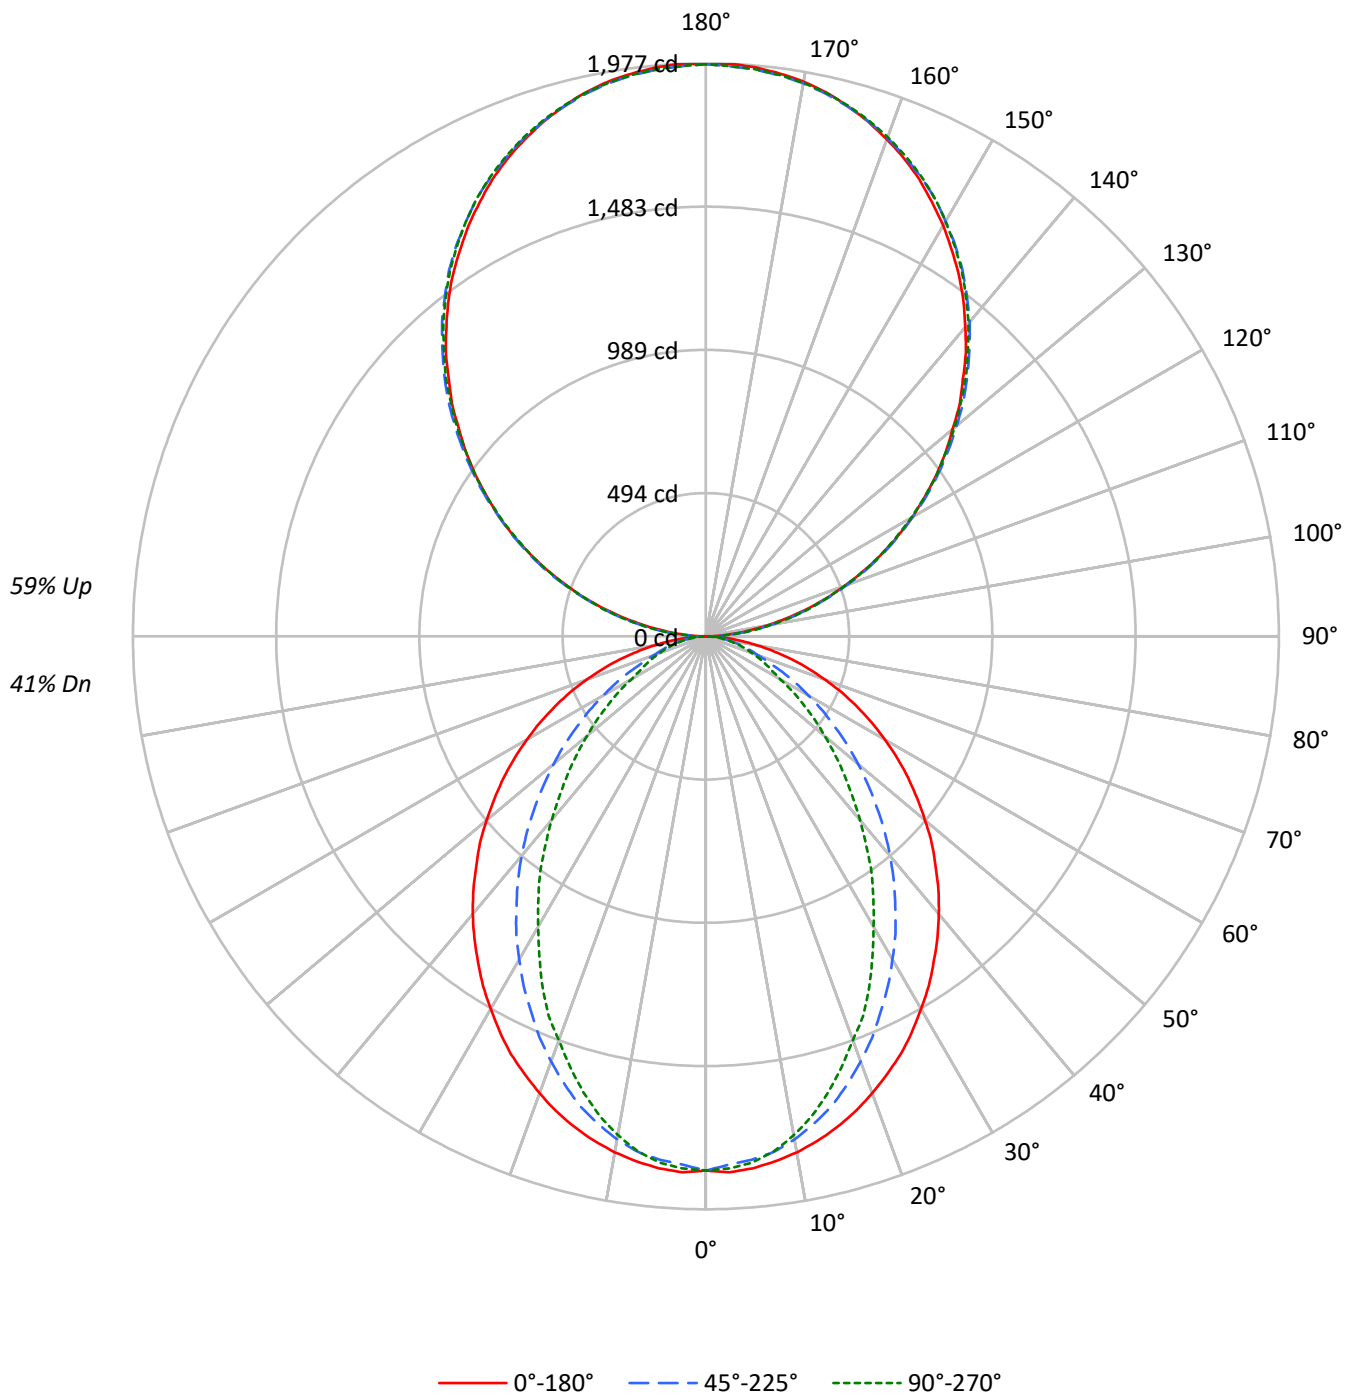

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	32	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	27	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2154	2154	2154
5°	2156	2118	2133
10°	2134	2075	2062
15°	2103	2005	1954
20°	2063	1909	1822
25°	2022	1802	1694
30°	1967	1692	1532
35°	1913	1574	1390
40°	1858	1452	1227
45°	1795	1317	1080
50°	1729	1181	936
55°	1660	1035	798
60°	1581	884	656
65°	1489	730	589
70°	1377	586	532
75°	1237	513	482
80°	1035	426	415
85°	703	277	307

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1954 cd/sqm

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	1.9
10°-20°	474.1	5.1
20°-30°	665.6	7.1
30°-40°	725.6	7.8
40°-50°	666.9	7.2
50°-60°	523.7	5.6
60°-70°	340.9	3.7
70°-80°	175.5	1.9
80°-90°	50.4	0.5
90°-100°	122.2	1.3
100°-110°	388.1	4.2
110°-120°	664.2	7.1
120°-130°	873.6	9.4
130°-140°	980.5	10.5
140°-150°	961.5	10.3
150°-160°	806.6	8.7
160°-170°	534.9	5.7
170°-180°	187.0	2.0
0°-30°	1312.4	14.1
0°-40°	2038.0	21.9
0°-60°	3228.6	34.7
0°-90°	3795.4	40.7
90°-120°	1174.5	12.6
90°-150°	3990.1	42.8
90°-180°	5519.0	59.3
0°-180°	9314.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	2	21	58	55	56	9
95°	87	104	107	107	104	97
105°	358	363	367	370	370	378
115°	667	676	673	671	667	659
125°	970	984	980	974	972	866
135°	1254	1272	1276	1274	1269	969
145°	1522	1534	1544	1546	1539	951
155°	1741	1746	1751	1759	1754	801
165°	1894	1892	1892	1904	1896	534
175°	1970	1966	1962	1974	1964	187
180°	1974	1974	1974	1974	1974	

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	1.8	21.4	58.3	54.8	56.5
92.5°	36.9	50.0	51.8	53.6	53.6
95°	86.9	103.5	106.6	106.6	103.5
97.5°	144.6	160.1	166.7	166.7	166.7
100°	211.2	225.0	229.7	229.7	227.9
102.5°	281.5	291.6	298.2	300.0	298.2
105°	358.3	363.0	366.6	369.6	369.6
107.5°	434.4	441.6	441.6	442.8	434.4
110°	508.3	517.8	517.8	517.8	513.0

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.0	598.2	596.4	591.6	588.0
115°	666.6	676.1	673.2	671.4	666.6
117.5°	744.5	757.6	749.3	744.5	739.8
120°	823.0	836.2	823.0	823.0	817.7
122.5°	894.5	911.1	902.9	898.0	894.5
125°	969.5	984.4	979.6	974.3	972.5
127.5°	1042.7	1061.1	1054.6	1047.5	1042.7
130°	1111.2	1132.6	1129.6	1126.1	1119.5
132.5°	1187.9	1204.6	1205.8	1197.5	1192.7
135°	1254.0	1272.4	1276.0	1274.2	1269.4
137.5°	1327.8	1342.6	1345.6	1344.4	1337.3
140°	1392.7	1407.6	1415.9	1415.9	1409.3
142.5°	1459.3	1474.2	1478.9	1480.7	1474.2
145°	1522.4	1534.3	1543.8	1545.6	1539.1
147.5°	1579.0	1593.8	1601.0	1603.9	1597.4
150°	1637.3	1647.3	1653.9	1659.3	1653.9
152.5°	1689.0	1699.2	1707.4	1714.0	1707.4
155°	1740.8	1745.5	1751.0	1759.3	1753.9
157.5°	1785.5	1789.0	1792.0	1803.9	1795.5
160°	1825.3	1828.9	1830.7	1840.8	1833.6
162.5°	1862.2	1862.2	1864.0	1875.3	1867.0
165°	1893.7	1891.9	1891.9	1903.9	1895.5
167.5°	1922.3	1917.0	1917.0	1928.9	1920.6
170°	1943.8	1939.0	1937.2	1949.1	1939.0
172.5°	1958.6	1953.8	1952.0	1964.0	1953.8
175°	1970.5	1965.8	1962.2	1974.1	1964.0
177.5°	1977.1	1972.3	1968.7	1978.9	1968.7
180°	1974.1	1974.1	1974.1	1974.1	1974.1

TEST NUMBER: P922118

CATALOG NUMBER: DFN2DIP-PN3F0-050D070US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.84	9.60	9.88	10.64	12.04	4.81	5.57	5.85	6.61	8.01
	3H	10.51	11.19	11.56	12.24	13.66	5.99	6.67	7.03	7.72	9.13
	4H	11.11	11.75	12.17	12.81	14.23	6.43	7.07	7.49	8.12	9.55
	6H	11.52	12.12	12.59	13.17	14.61	6.74	7.33	7.81	8.39	9.83
	8H	11.64	12.21	12.72	13.28	14.71	6.83	7.39	7.90	8.46	9.89
	12H	11.70	12.24	12.78	13.30	14.76	6.86	7.40	7.94	8.46	9.92
4H	2H	8.85	9.49	9.92	10.55	11.97	5.39	6.04	6.46	7.09	8.51
	3H	10.67	11.20	11.74	12.28	13.72	6.73	7.26	7.80	8.34	9.78
	4H	11.35	11.84	12.43	12.91	14.37	7.27	7.76	8.35	8.83	10.29
	6H	11.86	12.28	12.94	13.37	14.83	7.68	8.10	8.77	9.19	10.65
	8H	12.03	12.42	13.12	13.50	14.98	7.80	8.19	8.89	9.28	10.75
	12H	12.12	12.47	13.22	13.57	15.04	7.86	8.22	8.97	9.31	10.79
8H	4H	11.31	11.70	12.40	12.79	14.26	7.54	7.93	8.63	9.02	10.49
	6H	11.87	12.19	12.98	13.32	14.79	8.05	8.37	9.16	9.50	10.97
	8H	12.08	12.36	13.20	13.47	14.96	8.23	8.52	9.35	9.63	11.11
	12H	12.21	12.46	13.33	13.57	15.09	8.34	8.59	9.47	9.70	11.23
12H	4H	11.26	11.62	12.37	12.71	14.19	7.54	7.90	8.65	9.00	10.47
	6H	11.84	12.13	12.96	13.24	14.72	8.10	8.38	9.21	9.49	10.98
	8H	12.06	12.31	13.18	13.41	14.94	8.30	8.55	9.42	9.65	11.18

END OF REPORT