

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922133

Luminaire Tested: DFN2DIP-PN3F0-060D040US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922133
REPORT IS A COMBINATION OF REPORTS P901051 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D040US940-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8827.9 lumens
Efficiency: N/A
Efficacy: 101.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 87
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLLONL

Luminous Intensity Polar Plot

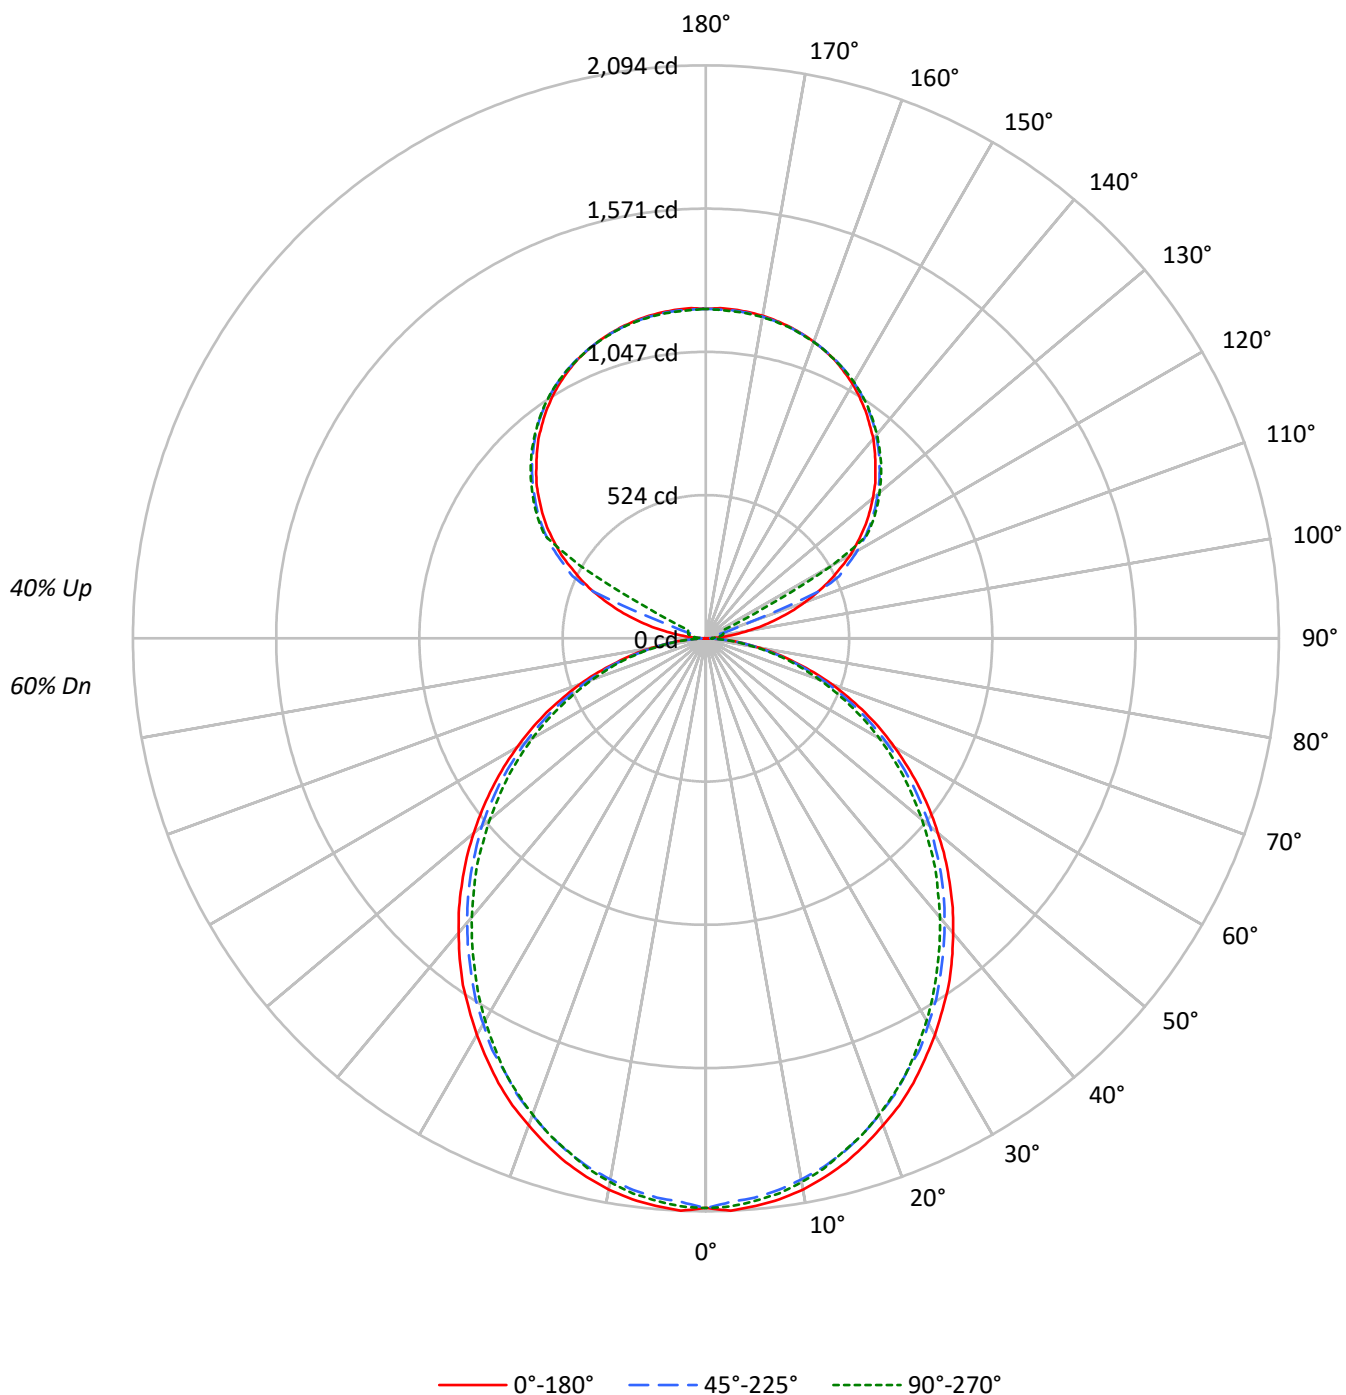

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2434	2434	2434
5°	2436	2398	2415
10°	2415	2364	2381
15°	2378	2323	2329
20°	2328	2268	2276
25°	2279	2201	2214
30°	2218	2139	2136
35°	2160	2067	2054
40°	2088	1993	1975
45°	2017	1919	1895
50°	1939	1842	1802
55°	1857	1752	1717
60°	1764	1646	1618
65°	1663	1535	1503
70°	1534	1401	1378
75°	1356	1240	1261
80°	1141	1033	1040
85°	803	683	678

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2017 cd/sqm

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	2.2
10°-20°	551.3	6.2
20°-30°	810.2	9.2
30°-40°	941.0	10.7
40°-50°	939.8	10.6
50°-60°	819.5	9.3
60°-70°	605.8	6.9
70°-80°	342.7	3.9
80°-90°	92.6	1.0
90°-100°	39.7	0.4
100°-110°	148.0	1.7
110°-120°	392.4	4.4
120°-130°	650.9	7.4
130°-140°	691.4	7.8
140°-150°	642.6	7.3
150°-160°	516.6	5.9
160°-170°	332.9	3.8
170°-180°	114.6	1.3
0°-30°	1557.4	17.6
0°-40°	2498.4	28.3
0°-60°	4257.8	48.2
0°-90°	5298.9	60.0
90°-120°	580.1	6.6
90°-150°	2565.0	29.1
90°-180°	3529.0	40.0
0°-180°	8827.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	1	10	17	22	24	8
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P922133

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.20	12.16	12.07	13.05	14.17	10.76	11.72	11.63	12.61	13.73
	3H	12.86	13.72	13.74	14.62	15.77	12.38	13.24	13.26	14.14	15.28
	4H	13.45	14.26	14.34	15.17	16.32	12.96	13.78	13.86	14.68	15.84
	6H	13.85	14.60	14.76	15.51	16.68	13.36	14.11	14.27	15.02	16.19
	8H	13.96	14.67	14.87	15.60	16.77	13.46	14.18	14.38	15.11	16.28
	12H	14.00	14.69	14.92	15.61	16.80	13.51	14.19	14.43	15.11	16.30
4H	2H	11.67	12.48	12.57	13.39	14.54	11.32	12.13	12.22	13.04	14.19
	3H	13.54	14.22	14.45	15.15	16.32	13.14	13.82	14.05	14.75	15.92
	4H	14.25	14.87	15.17	15.80	17.00	13.83	14.45	14.76	15.38	16.58
	6H	14.77	15.30	15.70	16.25	17.45	14.34	14.88	15.28	15.83	17.03
	8H	14.91	15.41	15.85	16.36	17.57	14.49	14.99	15.43	15.94	17.15
	12H	14.99	15.44	15.95	16.41	17.62	14.55	15.00	15.51	15.97	17.19
8H	4H	14.45	14.95	15.39	15.90	17.11	14.08	14.58	15.02	15.53	16.74
	6H	15.08	15.49	16.04	16.48	17.69	14.70	15.12	15.67	16.11	17.32
	8H	15.30	15.66	16.27	16.64	17.87	14.91	15.28	15.89	16.26	17.49
	12H	15.43	15.75	16.40	16.72	18.00	15.03	15.35	16.01	16.32	17.60
12H	4H	14.44	14.89	15.40	15.86	17.07	14.08	14.53	15.04	15.49	16.71
	6H	15.11	15.47	16.08	16.45	17.68	14.74	15.11	15.72	16.09	17.32
	8H	15.35	15.67	16.33	16.64	17.92	14.98	15.30	15.95	16.27	17.55