

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922135

Luminaire Tested: DFN2DIP-PN3F0-060D040US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922135
REPORT IS A COMBINATION OF REPORTS P901052 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D040US940-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8078.9 lumens
Efficiency: N/A
Efficacy: 92.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 87
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLLONL

Luminous Intensity Polar Plot

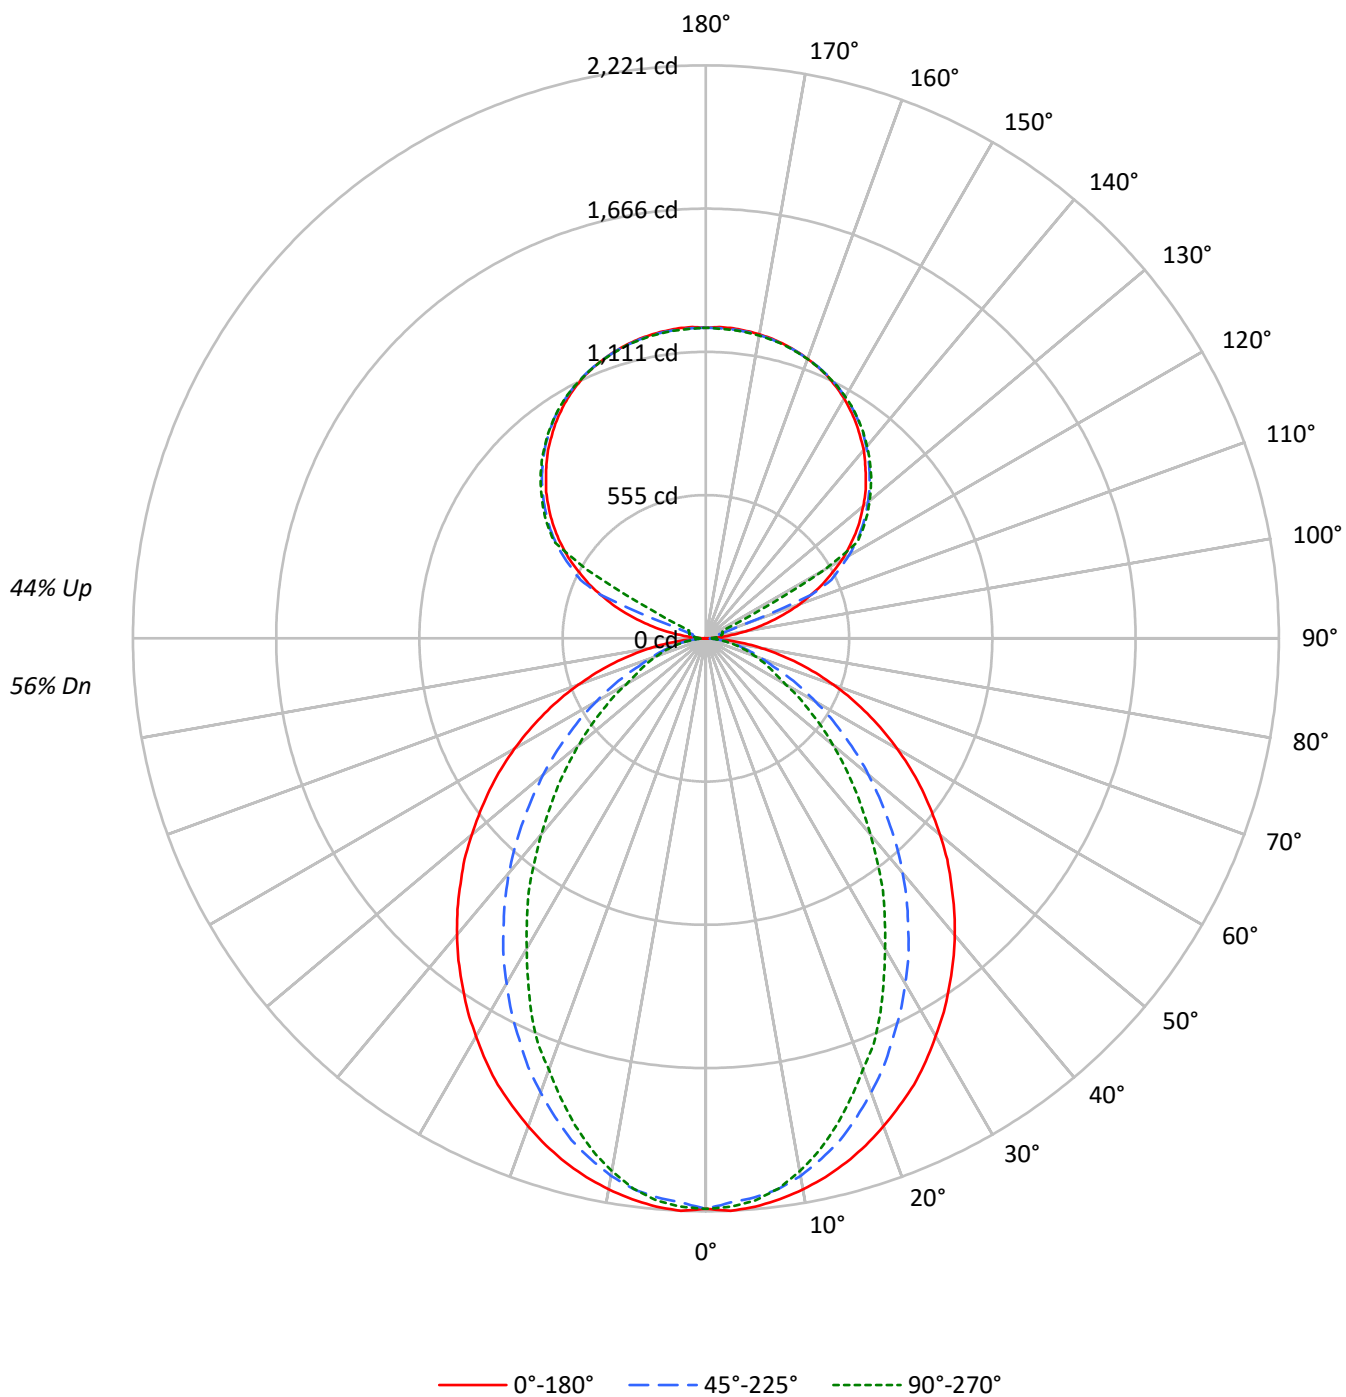

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	56	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	50	48	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	31
6	65	54	46	40	61	50	43	38	44	39	34	39	34	31	33	30	27
7	61	49	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2585	2585	2585
5°	2588	2542	2559
10°	2560	2490	2475
15°	2524	2406	2345
20°	2475	2291	2186
25°	2426	2162	2033
30°	2360	2031	1839
35°	2296	1889	1668
40°	2230	1743	1473
45°	2154	1581	1296
50°	2075	1417	1123
55°	1992	1243	957
60°	1897	1061	787
65°	1787	876	707
70°	1653	703	638
75°	1485	616	578
80°	1241	511	498
85°	844	332	368

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2154 cd/sqm

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.6
10°-20°	568.9	7.0
20°-30°	798.7	9.9
30°-40°	870.7	10.8
40°-50°	800.3	9.9
50°-60°	628.5	7.8
60°-70°	409.1	5.1
70°-80°	210.6	2.6
80°-90°	55.9	0.7
90°-100°	39.7	0.5
100°-110°	148.0	1.8
110°-120°	392.4	4.9
120°-130°	650.9	8.1
130°-140°	691.4	8.6
140°-150°	642.6	8.0
150°-160°	516.6	6.4
160°-170°	332.9	4.1
170°-180°	114.6	1.4
0°-30°	1574.9	19.5
0°-40°	2445.6	30.3
0°-60°	3874.3	48.0
0°-90°	4549.9	56.3
90°-120°	580.1	7.2
90°-150°	2565.0	31.7
90°-180°	3529.0	43.7
0°-180°	8078.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	10	17	22	24	8
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P922135

CATALOG NUMBER: DFN2DIP-PN3F0-060D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.98	11.86	11.89	12.78	13.97	6.94	7.83	7.85	8.75	9.93
	3H	12.65	13.44	13.57	14.38	15.58	8.13	8.92	9.05	9.85	11.06
	4H	13.26	14.01	14.20	14.94	16.16	8.58	9.33	9.52	10.26	11.48
	6H	13.68	14.37	14.63	15.31	16.54	8.90	9.59	9.84	10.53	11.76
	8H	13.81	14.46	14.76	15.42	16.65	8.99	9.64	9.94	10.60	11.83
	12H	13.87	14.49	14.83	15.44	16.69	9.03	9.65	9.99	10.61	11.86
4H	2H	11.00	11.75	11.94	12.68	13.90	7.54	8.29	8.48	9.23	10.44
	3H	12.83	13.45	13.78	14.42	15.65	8.89	9.51	9.84	10.48	11.71
	4H	13.52	14.08	14.48	15.05	16.30	9.44	10.00	10.40	10.96	12.22
	6H	14.03	14.52	15.00	15.50	16.76	9.85	10.34	10.83	11.32	12.58
	8H	14.20	14.66	15.18	15.64	16.90	9.98	10.43	10.95	11.41	12.68
	12H	14.30	14.71	15.29	15.70	16.97	10.04	10.45	11.04	11.45	12.72
8H	4H	13.49	13.94	14.46	14.92	16.19	9.72	10.17	10.69	11.15	12.42
	6H	14.05	14.43	15.05	15.45	16.71	10.23	10.60	11.23	11.63	12.89
	8H	14.26	14.59	15.27	15.60	16.89	10.42	10.75	11.42	11.76	13.04
	12H	14.40	14.69	15.41	15.69	17.02	10.53	10.82	11.54	11.83	13.16
12H	4H	13.44	13.85	14.44	14.85	16.12	9.72	10.13	10.72	11.13	12.40
	6H	14.02	14.36	15.03	15.36	16.65	10.28	10.61	11.29	11.62	12.90
	8H	14.24	14.53	15.25	15.54	16.87	10.48	10.78	11.50	11.78	13.11

END OF REPORT