

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922137

Luminaire Tested: DFN2DIP-PN3F0-060D050US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922137
REPORT IS A COMBINATION OF REPORTS P901065 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D050US940-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9710.8 lumens
Efficiency: N/A
Efficacy: 102.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLLONL

Luminous Intensity Polar Plot

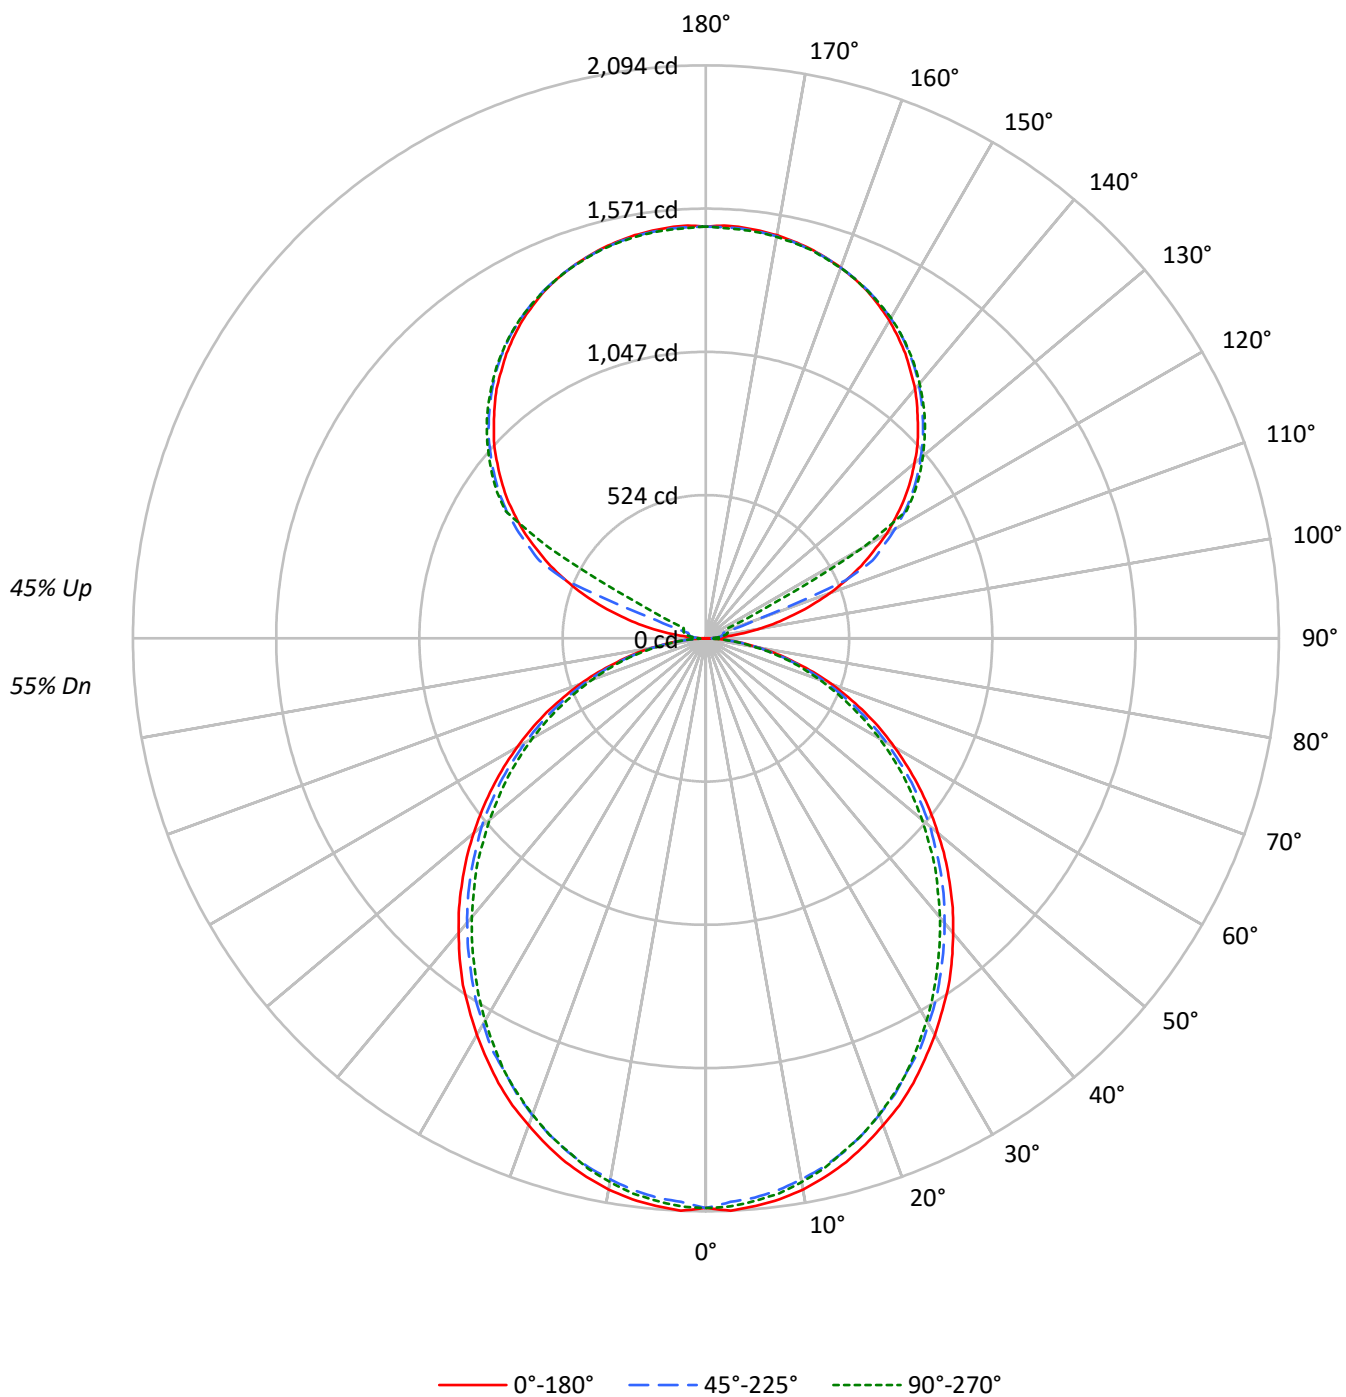

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2434	2434	2434
5°	2436	2398	2415
10°	2415	2364	2381
15°	2378	2323	2329
20°	2328	2268	2276
25°	2279	2201	2214
30°	2218	2139	2136
35°	2160	2067	2054
40°	2088	1993	1975
45°	2017	1919	1895
50°	1939	1842	1802
55°	1857	1752	1717
60°	1764	1646	1618
65°	1663	1535	1503
70°	1534	1401	1378
75°	1356	1240	1261
80°	1141	1033	1040
85°	803	683	678

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2017 cd/sqm

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	2.0
10°-20°	551.3	5.7
20°-30°	810.2	8.3
30°-40°	941.0	9.7
40°-50°	939.8	9.7
50°-60°	819.5	8.4
60°-70°	605.8	6.2
70°-80°	342.7	3.5
80°-90°	93.1	1.0
90°-100°	49.6	0.5
100°-110°	185.0	1.9
110°-120°	490.6	5.1
120°-130°	813.6	8.4
130°-140°	864.3	8.9
140°-150°	803.2	8.3
150°-160°	645.8	6.6
160°-170°	416.1	4.3
170°-180°	143.2	1.5
0°-30°	1557.4	16.0
0°-40°	2498.4	25.7
0°-60°	4257.8	43.8
0°-90°	5299.4	54.6
90°-120°	725.2	7.5
90°-150°	3206.2	33.0
90°-180°	4411.0	45.4
0°-180°	9710.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	1	13	22	27	29	9
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P922137

CATALOG NUMBER: DFN2DIP-PN3F0-060D050US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.74	11.64	11.65	12.58	13.78	10.30	11.20	11.21	12.14	13.34
	3H	12.39	13.20	13.32	14.15	15.38	11.91	12.72	12.84	13.67	14.89
	4H	12.98	13.75	13.92	14.70	15.93	12.49	13.26	13.44	14.21	15.45
	6H	13.38	14.08	14.33	15.04	16.29	12.89	13.59	13.84	14.55	15.80
	8H	13.48	14.15	14.44	15.13	16.37	12.99	13.66	13.95	14.64	15.88
	12H	13.53	14.17	14.49	15.13	16.41	13.03	13.67	14.00	14.64	15.91
4H	2H	11.20	11.97	12.15	12.92	14.15	10.85	11.62	11.80	12.56	13.80
	3H	13.06	13.70	14.02	14.68	15.93	12.66	13.30	13.62	14.28	15.53
	4H	13.77	14.36	14.74	15.33	16.61	13.36	13.94	14.32	14.91	16.19
	6H	14.28	14.79	15.27	15.79	17.06	13.86	14.37	14.84	15.36	16.64
	8H	14.43	14.90	15.41	15.89	17.18	14.01	14.48	14.99	15.47	16.76
	12H	14.50	14.93	15.51	15.94	17.23	14.07	14.49	15.07	15.50	16.79
8H	4H	13.97	14.44	14.95	15.43	16.72	13.60	14.07	14.58	15.06	16.35
	6H	14.59	14.98	15.60	16.02	17.30	14.22	14.61	15.23	15.64	16.93
	8H	14.81	15.15	15.83	16.17	17.48	14.43	14.77	15.44	15.79	17.10
	12H	14.94	15.24	15.96	16.26	17.61	14.54	14.84	15.56	15.86	17.21
12H	4H	13.96	14.38	14.96	15.39	16.68	13.59	14.02	14.60	15.03	16.32
	6H	14.62	14.97	15.64	15.99	17.29	14.26	14.60	15.27	15.62	16.93
	8H	14.86	15.16	15.88	16.18	17.53	14.49	14.79	15.51	15.81	17.16

END OF REPORT