

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922144

Luminaire Tested: DFN2DIP-PN3F0-060D070US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922144
REPORT IS A COMBINATION OF REPORTS P899573 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D070US940-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10821.0 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 111.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFLL

Luminous Intensity Polar Plot

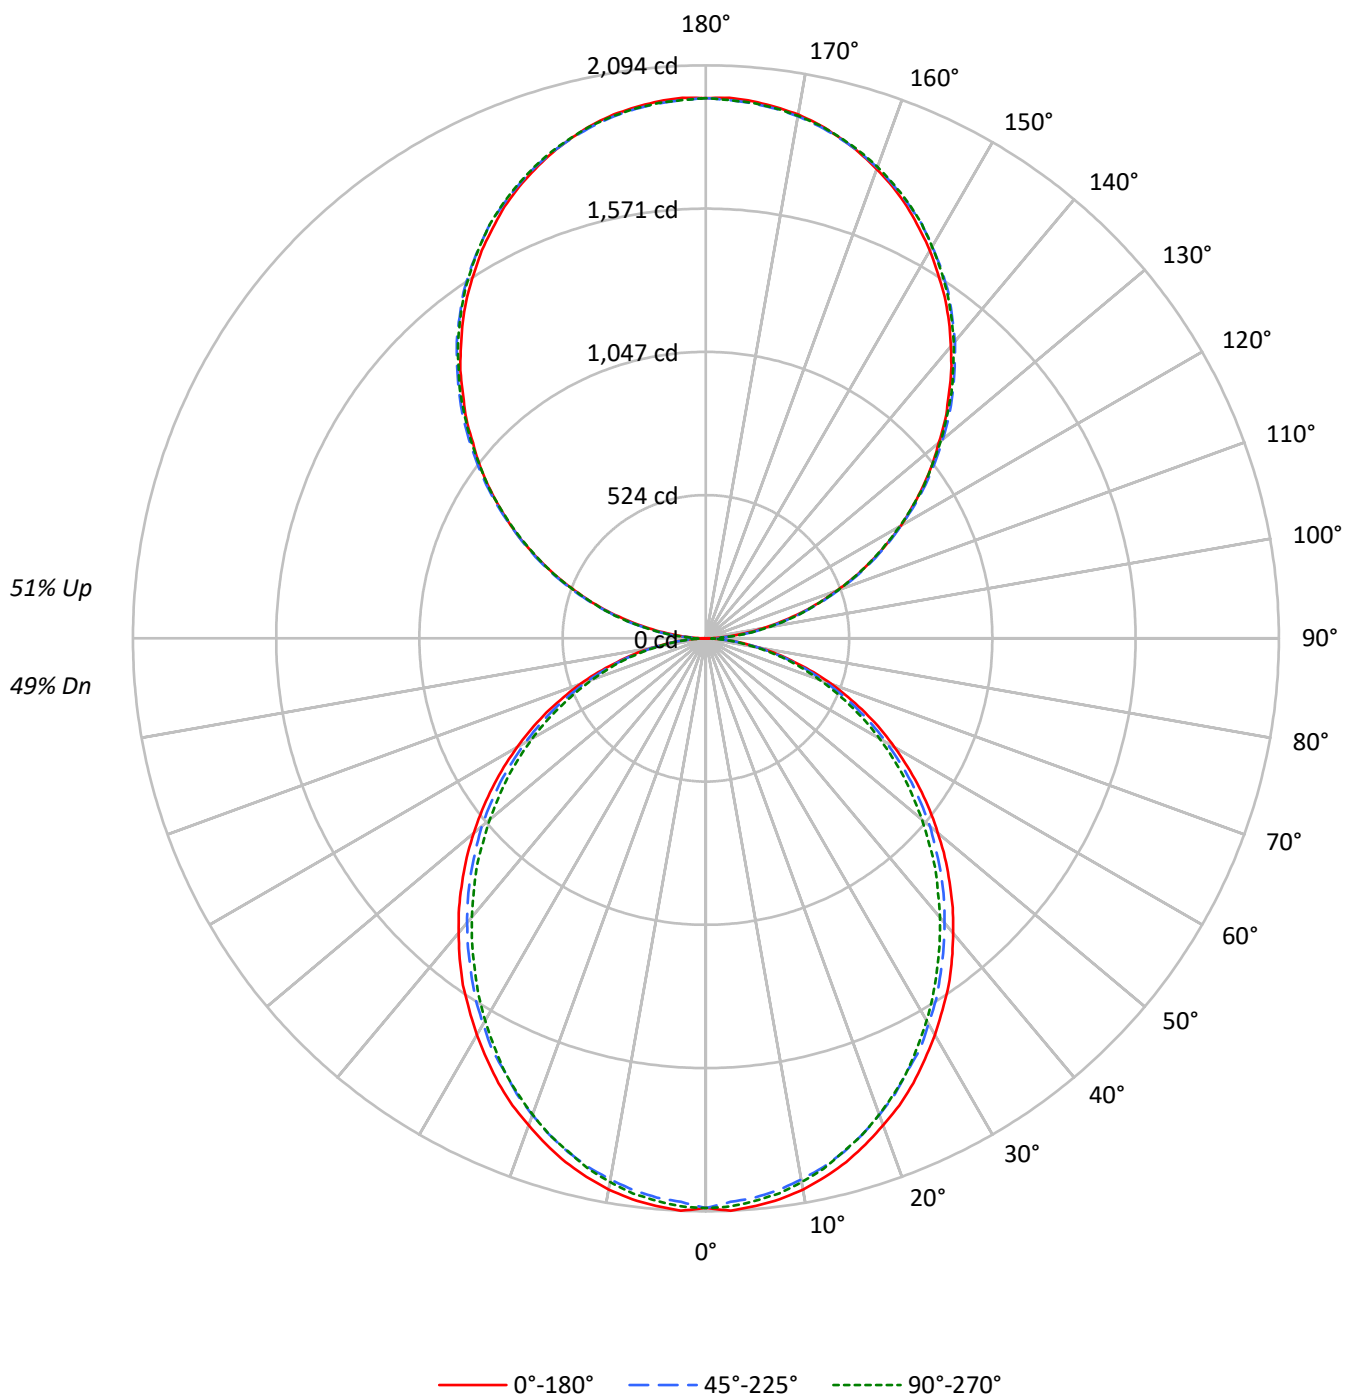

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2434	2434	2434
5°	2436	2398	2415
10°	2415	2364	2381
15°	2378	2323	2329
20°	2328	2268	2276
25°	2279	2201	2214
30°	2218	2139	2136
35°	2160	2067	2054
40°	2088	1993	1975
45°	2017	1919	1895
50°	1939	1842	1802
55°	1857	1752	1717
60°	1764	1646	1618
65°	1663	1535	1503
70°	1534	1401	1378
75°	1356	1240	1261
80°	1141	1033	1040
85°	803	683	678

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2017 cd/sqm

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.8
10°-20°	551.3	5.1
20°-30°	810.2	7.5
30°-40°	941.0	8.7
40°-50°	939.8	8.7
50°-60°	819.5	7.6
60°-70°	605.8	5.6
70°-80°	342.7	3.2
80°-90°	96.1	0.9
90°-100°	122.2	1.1
100°-110°	388.1	3.6
110°-120°	664.2	6.1
120°-130°	873.6	8.1
130°-140°	980.5	9.1
140°-150°	961.5	8.9
150°-160°	806.6	7.5
160°-170°	534.9	4.9
170°-180°	187.0	1.7
0°-30°	1557.4	14.4
0°-40°	2498.4	23.1
0°-60°	4257.8	39.3
0°-90°	5302.4	49.0
90°-120°	1174.5	10.9
90°-150°	3990.1	36.9
90°-180°	5519.0	51.0
0°-180°	10821.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	2	21	58	55	56	10
95°	87	104	107	107	104	97
105°	358	363	367	370	370	378
115°	667	676	673	671	667	659
125°	970	984	980	974	972	866
135°	1254	1272	1276	1274	1269	969
145°	1522	1534	1544	1546	1539	951
155°	1741	1746	1751	1759	1754	801
165°	1894	1892	1892	1904	1896	534
175°	1970	1966	1962	1974	1964	187
180°	1974	1974	1974	1974	1974	

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.8	21.4	58.3	54.8	56.5
92.5°	36.9	50.0	51.8	53.6	53.6
95°	86.9	103.5	106.6	106.6	103.5
97.5°	144.6	160.1	166.7	166.7	166.7
100°	211.2	225.0	229.7	229.7	227.9
102.5°	281.5	291.6	298.2	300.0	298.2
105°	358.3	363.0	366.6	369.6	369.6
107.5°	434.4	441.6	441.6	442.8	434.4
110°	508.3	517.8	517.8	517.8	513.0

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.0	598.2	596.4	591.6	588.0
115°	666.6	676.1	673.2	671.4	666.6
117.5°	744.5	757.6	749.3	744.5	739.8
120°	823.0	836.2	823.0	823.0	817.7
122.5°	894.5	911.1	902.9	898.0	894.5
125°	969.5	984.4	979.6	974.3	972.5
127.5°	1042.7	1061.1	1054.6	1047.5	1042.7
130°	1111.2	1132.6	1129.6	1126.1	1119.5
132.5°	1187.9	1204.6	1205.8	1197.5	1192.7
135°	1254.0	1272.4	1276.0	1274.2	1269.4
137.5°	1327.8	1342.6	1345.6	1344.4	1337.3
140°	1392.7	1407.6	1415.9	1415.9	1409.3
142.5°	1459.3	1474.2	1478.9	1480.7	1474.2
145°	1522.4	1534.3	1543.8	1545.6	1539.1
147.5°	1579.0	1593.8	1601.0	1603.9	1597.4
150°	1637.3	1647.3	1653.9	1659.3	1653.9
152.5°	1689.0	1699.2	1707.4	1714.0	1707.4
155°	1740.8	1745.5	1751.0	1759.3	1753.9
157.5°	1785.5	1789.0	1792.0	1803.9	1795.5
160°	1825.3	1828.9	1830.7	1840.8	1833.6
162.5°	1862.2	1862.2	1864.0	1875.3	1867.0
165°	1893.7	1891.9	1891.9	1903.9	1895.5
167.5°	1922.3	1917.0	1917.0	1928.9	1920.6
170°	1943.8	1939.0	1937.2	1949.1	1939.0
172.5°	1958.6	1953.8	1952.0	1964.0	1953.8
175°	1970.5	1965.8	1962.2	1974.1	1964.0
177.5°	1977.1	1972.3	1968.7	1978.9	1968.7
180°	1974.1	1974.1	1974.1	1974.1	1974.1

TEST NUMBER: P922144

CATALOG NUMBER: DFN2DIP-PN3F0-060D070US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.23	11.08	11.19	12.06	13.35	9.79	10.64	10.76	11.62	12.91
	3H	11.88	12.65	12.86	13.64	14.94	11.40	12.16	12.38	13.15	14.46
	4H	12.47	13.19	13.46	14.18	15.50	11.98	12.70	12.97	13.70	15.01
	6H	12.86	13.53	13.86	14.52	15.85	12.37	13.04	13.37	14.04	15.36
	8H	12.96	13.60	13.97	14.61	15.94	12.47	13.11	13.48	14.12	15.45
	12H	13.01	13.61	14.02	14.62	15.97	12.51	13.11	13.52	14.12	15.47
4H	2H	10.69	11.41	11.68	12.40	13.72	10.33	11.06	11.33	12.05	13.37
	3H	12.54	13.15	13.55	14.17	15.50	12.14	12.75	13.15	13.77	15.10
	4H	13.25	13.80	14.27	14.82	16.17	12.84	13.39	13.85	14.40	15.76
	6H	13.76	14.24	14.79	15.27	16.62	13.34	13.81	14.36	14.85	16.20
	8H	13.91	14.35	14.93	15.38	16.75	13.48	13.93	14.51	14.96	16.32
	12H	13.98	14.38	15.02	15.43	16.79	13.54	13.94	14.58	14.99	16.36
8H	4H	13.44	13.89	14.47	14.92	16.28	13.07	13.52	14.10	14.55	15.91
	6H	14.07	14.43	15.12	15.51	16.87	13.69	14.06	14.74	15.13	16.49
	8H	14.28	14.61	15.34	15.67	17.05	13.90	14.22	14.96	15.28	16.66
	12H	14.41	14.70	15.47	15.75	17.17	14.01	14.30	15.07	15.35	16.77
12H	4H	13.43	13.83	14.47	14.88	16.25	13.07	13.47	14.11	14.51	15.88
	6H	14.10	14.42	15.15	15.48	16.86	13.73	14.06	14.79	15.11	16.49
	8H	14.33	14.62	15.39	15.67	17.09	13.96	14.25	15.02	15.30	16.72

END OF REPORT