

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922176

Luminaire Tested: DFN2DIP-PN3F0-070D080US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922176
REPORT IS A COMBINATION OF REPORTS P899589 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-070D080US940-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12492.9 lumens
Efficiency: N/A
Efficacy: 95.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFLL

Luminous Intensity Polar Plot

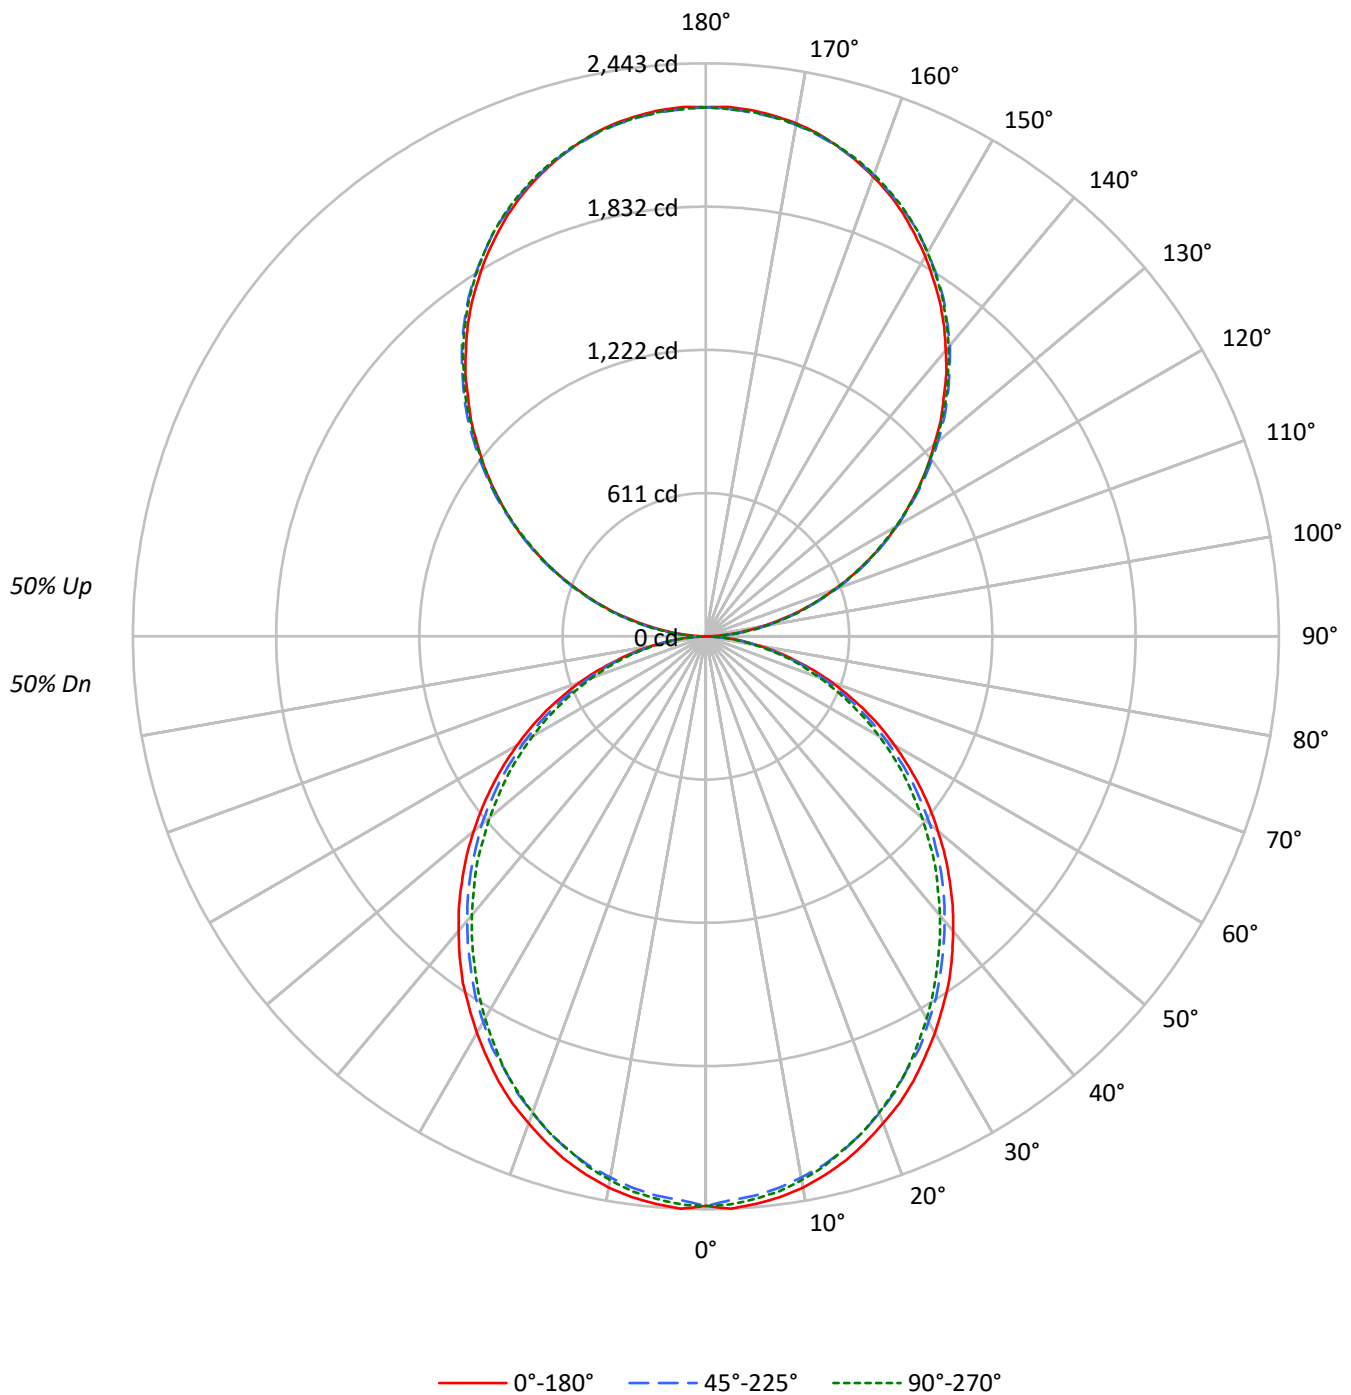

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	89	86	90	86	83	80	73	70	68	61	59	57	49	48	47
2	89	82	75	70	82	75	70	66	64	60	56	53	50	48	43	41	40
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	34
4	74	63	56	49	68	59	52	46	50	45	40	42	38	35	34	31	29
5	68	57	48	42	63	52	45	40	45	39	35	38	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	30	26	28	25	22
7	58	46	38	32	53	43	35	30	37	31	27	31	27	23	26	22	20
8	54	42	34	28	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	18	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2839	2839	2839
5°	2842	2798	2817
10°	2817	2758	2778
15°	2774	2711	2717
20°	2716	2646	2655
25°	2659	2568	2583
30°	2588	2496	2492
35°	2520	2411	2396
40°	2436	2325	2305
45°	2353	2239	2211
50°	2262	2149	2103
55°	2166	2044	2003
60°	2058	1920	1888
65°	1940	1791	1753
70°	1790	1634	1607
75°	1582	1446	1471
80°	1330	1206	1213
85°	939	798	791

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2353 cd/sqm

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.6	1.8
10°-20°	643.2	5.1
20°-30°	945.2	7.6
30°-40°	1097.8	8.8
40°-50°	1096.5	8.8
50°-60°	956.1	7.7
60°-70°	706.8	5.7
70°-80°	399.9	3.2
80°-90°	112.0	0.9
90°-100°	139.6	1.1
100°-110°	443.6	3.6
110°-120°	759.1	6.1
120°-130°	998.3	8.0
130°-140°	1120.6	9.0
140°-150°	1098.9	8.8
150°-160°	921.8	7.4
160°-170°	611.3	4.9
170°-180°	213.7	1.7
0°-30°	1817.0	14.5
0°-40°	2914.9	23.3
0°-60°	4967.4	39.8
0°-90°	6186.0	49.5
90°-120°	1342.3	10.7
90°-150°	4560.1	36.5
90°-180°	6307.0	50.5
0°-180°	12492.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2429	2429	2429	2429	2429	
5°	2429	2420	2394	2412	2408	231
15°	2312	2298	2268	2277	2266	651
25°	2093	2074	2034	2039	2034	963
35°	1805	1782	1745	1730	1719	1127
45°	1469	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	712	691	680	741
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	2	24	67	63	65	12
95°	99	118	122	122	118	111
105°	410	415	419	422	422	432
115°	762	773	769	767	762	753
125°	1108	1125	1120	1113	1111	990
135°	1433	1454	1458	1456	1451	1108
145°	1740	1754	1764	1766	1759	1087
155°	1990	1995	2001	2010	2004	916
165°	2164	2162	2162	2176	2166	611
175°	2252	2247	2242	2256	2244	214
180°	2256	2256	2256	2256	2256	

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2428.8	2428.8	2428.8	2428.8	2428.8
2.5°	2442.9	2431.2	2405.5	2428.8	2424.3
5°	2428.8	2419.7	2393.9	2412.4	2408.0
7.5°	2412.4	2398.5	2372.8	2391.7	2386.9
10°	2386.9	2370.5	2342.5	2361.2	2354.2
12.5°	2351.7	2337.9	2309.9	2321.5	2316.8
15°	2312.1	2298.2	2267.7	2277.2	2265.5
17.5°	2263.0	2249.2	2218.7	2230.3	2218.7
20°	2209.2	2195.4	2162.7	2169.6	2160.4
22.5°	2155.7	2134.7	2104.2	2104.2	2099.4
25°	2092.6	2073.9	2034.3	2038.8	2034.3
27.5°	2022.4	2006.1	1975.9	1968.9	1957.2
30°	1952.6	1933.7	1898.8	1891.9	1882.4
32.5°	1877.7	1863.9	1826.4	1812.3	1802.9
35°	1805.4	1782.1	1744.6	1730.5	1718.9
37.5°	1723.6	1702.5	1665.1	1648.8	1637.1
40°	1639.6	1620.8	1583.3	1562.5	1553.1
42.5°	1557.8	1539.0	1501.8	1478.3	1464.4
45°	1469.1	1452.8	1417.6	1392.0	1382.6
47.5°	1382.6	1366.3	1328.8	1303.1	1289.2
50°	1291.5	1279.8	1247.1	1214.4	1202.7
52.5°	1202.7	1186.4	1156.2	1130.4	1114.0
55°	1111.8	1097.7	1069.7	1041.7	1030.0
57.5°	1020.7	1009.0	978.5	950.5	941.1
60°	929.4	920.2	887.6	861.8	854.9
62.5°	840.7	824.4	801.1	777.8	768.4
65°	749.8	735.7	712.4	691.3	679.7
67.5°	656.4	644.5	623.7	607.3	597.9
70°	569.9	560.5	539.4	523.1	513.9
72.5°	481.2	471.8	460.1	443.8	436.8
75°	392.3	387.8	375.9	362.0	366.8
77.5°	313.0	303.5	298.8	291.9	285.0
80°	233.6	231.2	226.5	219.5	214.8
82.5°	158.8	158.8	156.6	147.2	147.2
85°	95.7	93.5	91.2	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	2.1	24.5	66.7	62.6	64.6
92.5°	42.2	57.2	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.3	183.0	190.5	190.5	190.5
100°	241.5	257.1	262.5	262.5	260.5
102.5°	321.7	333.3	340.7	342.8	340.7
105°	409.5	414.9	419.0	422.4	422.4
107.5°	496.5	504.7	504.7	506.0	496.5
110°	580.9	591.7	591.7	591.7	586.3

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	672.0	683.6	681.5	676.1	672.0
115°	761.8	772.7	769.3	767.2	761.8
117.5°	850.9	865.9	856.3	850.9	845.4
120°	940.7	955.6	940.7	940.7	934.5
122.5°	1022.3	1041.3	1031.8	1026.4	1022.3
125°	1108.0	1125.0	1119.5	1113.4	1111.4
127.5°	1191.7	1212.7	1205.2	1197.1	1191.7
130°	1269.9	1294.3	1290.9	1286.9	1279.4
132.5°	1357.6	1376.6	1378.0	1368.5	1363.1
135°	1433.1	1454.2	1458.3	1456.3	1450.8
137.5°	1517.4	1534.5	1537.8	1536.5	1528.3
140°	1591.6	1608.6	1618.1	1618.1	1610.6
142.5°	1667.8	1684.8	1690.2	1692.3	1684.8
145°	1739.9	1753.5	1764.3	1766.4	1758.9
147.5°	1804.5	1821.5	1829.6	1833.1	1825.6
150°	1871.2	1882.7	1890.2	1896.3	1890.2
152.5°	1930.3	1941.9	1951.4	1958.9	1951.4
155°	1989.5	1994.9	2001.1	2010.5	2004.5
157.5°	2040.5	2044.6	2048.0	2061.5	2052.1
160°	2086.1	2090.2	2092.2	2103.7	2095.6
162.5°	2128.2	2128.2	2130.3	2143.2	2133.7
165°	2164.3	2162.2	2162.2	2175.9	2166.3
167.5°	2196.9	2190.8	2190.8	2204.4	2194.9
170°	2221.4	2216.0	2213.9	2227.6	2216.0
172.5°	2238.5	2233.0	2231.0	2244.5	2233.0
175°	2252.0	2246.6	2242.5	2256.1	2244.5
177.5°	2259.5	2254.1	2250.0	2261.6	2250.0
180°	2256.1	2256.1	2256.1	2256.1	2256.1

TEST NUMBER: P922176

CATALOG NUMBER: DFN2DIP-PN3F0-070D080US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.81	11.67	11.77	12.65	13.92	10.37	11.23	11.33	12.21	13.48
	3H	12.47	13.23	13.44	14.22	15.52	11.98	12.75	12.96	13.74	15.04
	4H	13.05	13.78	14.04	14.77	16.08	12.56	13.29	13.55	14.28	15.59
	6H	13.44	14.12	14.44	15.11	16.43	12.95	13.63	13.95	14.62	15.94
	8H	13.55	14.19	14.55	15.20	16.51	13.06	13.69	14.06	14.71	16.02
	12H	13.59	14.20	14.60	15.20	16.55	13.10	13.70	14.10	14.71	16.05
4H	2H	11.27	12.00	12.26	12.99	14.29	10.92	11.65	11.91	12.64	13.94
	3H	13.13	13.74	14.13	14.75	16.08	12.73	13.33	13.73	14.35	15.67
	4H	13.84	14.39	14.85	15.40	16.75	13.42	13.98	14.43	14.99	16.33
	6H	14.35	14.82	15.37	15.86	17.20	13.92	14.40	14.94	15.44	16.78
	8H	14.49	14.94	15.51	15.97	17.32	14.07	14.51	15.09	15.54	16.90
	12H	14.56	14.97	15.60	16.01	17.37	14.13	14.53	15.17	15.57	16.93
8H	4H	14.03	14.48	15.05	15.50	16.86	13.66	14.11	14.68	15.13	16.49
	6H	14.65	15.02	15.70	16.09	17.45	14.28	14.65	15.32	15.72	17.07
	8H	14.87	15.19	15.92	16.25	17.62	14.49	14.81	15.54	15.87	17.24
	12H	15.00	15.28	16.05	16.33	17.75	14.60	14.88	15.65	15.93	17.35
12H	4H	14.01	14.42	15.05	15.46	16.82	13.65	14.06	14.69	15.10	16.46
	6H	14.68	15.01	15.73	16.06	17.44	14.32	14.64	15.37	15.70	17.07
	8H	14.92	15.20	15.98	16.25	17.67	14.55	14.83	15.60	15.88	17.30

END OF REPORT