

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922211

Luminaire Tested: DFN2DIP-PN3F0-080D090US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922211
REPORT IS A COMBINATION OF REPORTS P901126 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-080D090US940-RLLONL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14008.8 lumens
Efficiency: N/A
Efficacy: 92.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLLONL

Luminous Intensity Polar Plot

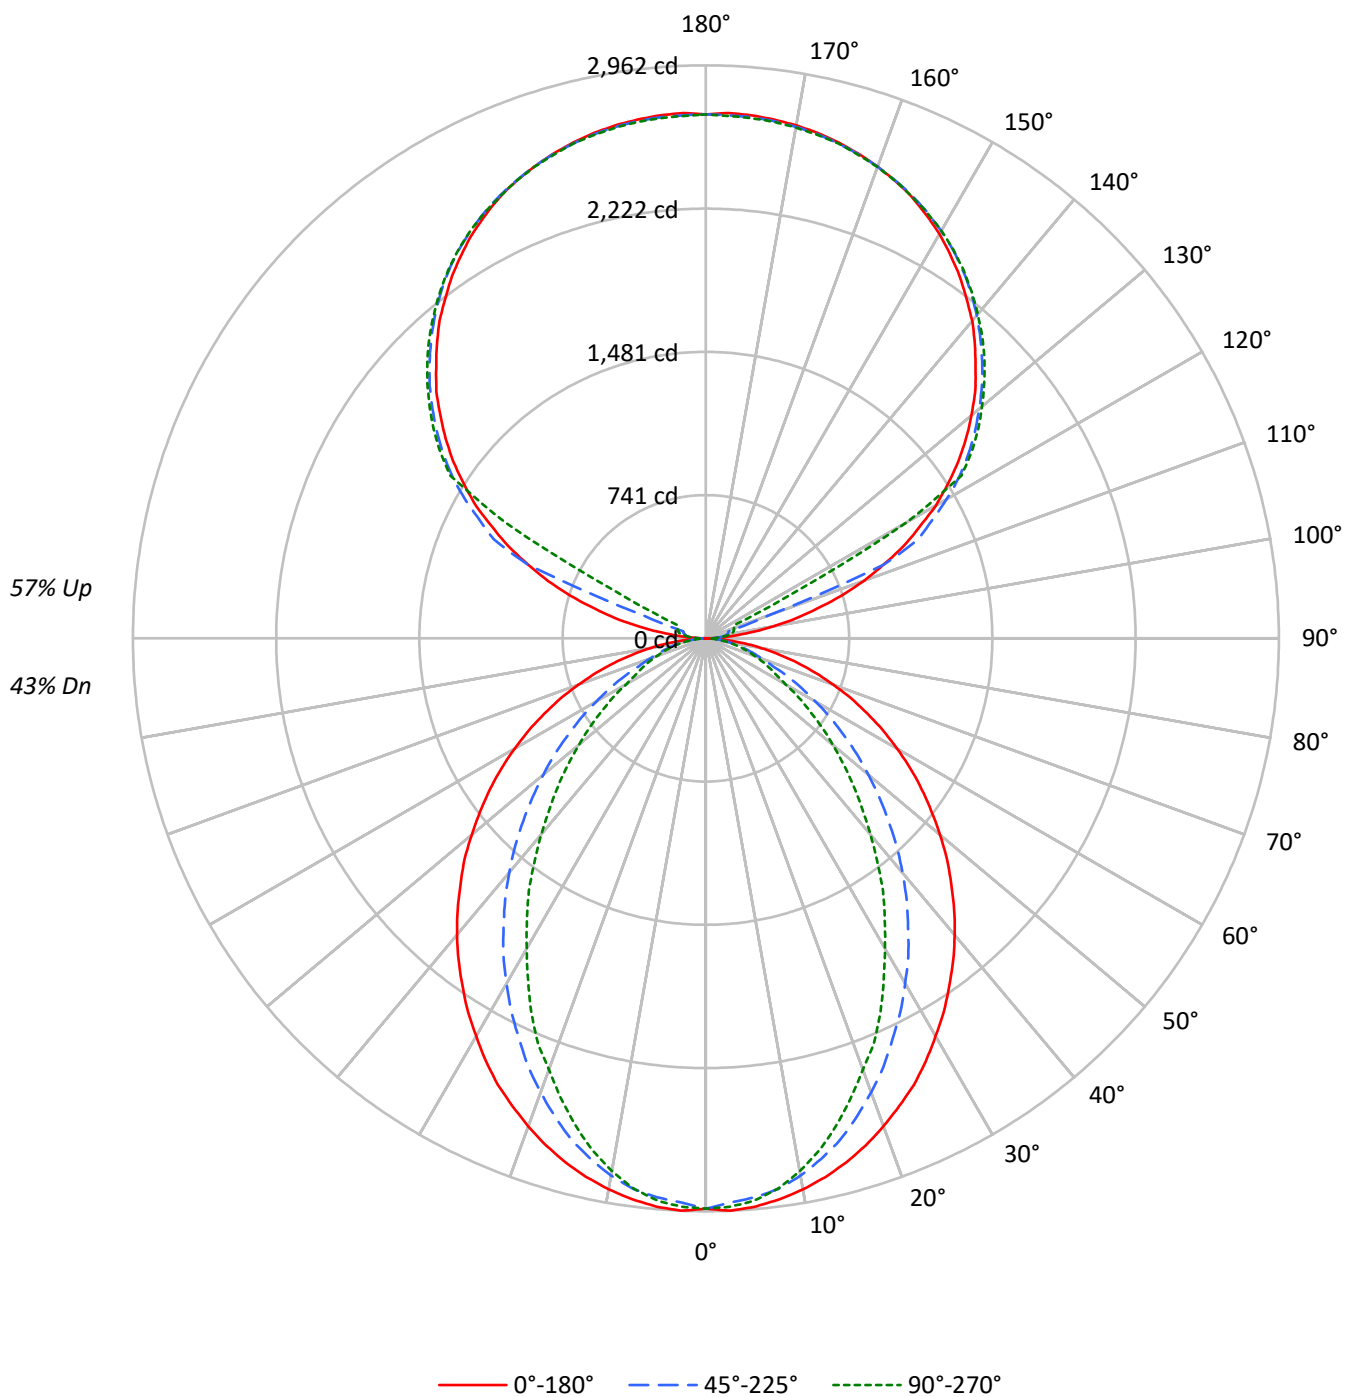

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	27	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	22	19
8	54	42	35	30	49	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3447	3447	3447
5°	3450	3389	3412
10°	3414	3321	3300
15°	3365	3208	3127
20°	3301	3055	2915
25°	3235	2883	2710
30°	3147	2707	2452
35°	3061	2519	2224
40°	2974	2324	1964
45°	2872	2107	1728
50°	2767	1889	1498
55°	2657	1657	1276
60°	2529	1414	1049
65°	2382	1167	942
70°	2204	937	851
75°	1980	821	771
80°	1655	681	663
85°	1125	443	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2872 cd/sqm

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.3	2.0
10°-20°	758.6	5.4
20°-30°	1065.0	7.6
30°-40°	1160.9	8.3
40°-50°	1067.0	7.6
50°-60°	838.0	6.0
60°-70°	545.4	3.9
70°-80°	280.8	2.0
80°-90°	76.4	0.5
90°-100°	89.3	0.6
100°-110°	332.9	2.4
110°-120°	883.0	6.3
120°-130°	1464.5	10.5
130°-140°	1555.6	11.1
140°-150°	1445.8	10.3
150°-160°	1162.4	8.3
160°-170°	749.0	5.3
170°-180°	257.8	1.8
0°-30°	2099.9	15.0
0°-40°	3260.8	23.3
0°-60°	5165.8	36.9
0°-90°	6068.4	43.3
90°-120°	1305.2	9.3
90°-150°	5771.2	41.2
90°-180°	7940.0	56.7
0°-180°	14008.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2948	2948	2948	2948	2948	
5°	2948	2935	2900	2924	2916	280
15°	2804	2775	2684	2634	2607	790
25°	2546	2460	2284	2175	2134	1171
35°	2193	2057	1822	1654	1595	1373
45°	1793	1614	1334	1144	1081	1385
55°	1363	1155	867	707	656	1218
65°	921	704	464	374	365	913
75°	491	304	214	195	192	519
85°	115	59	51	51	51	132
90°	2	24	39	49	53	13
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2948.4	2948.4	2948.4	2948.4	2948.4
2.5°	2961.6	2948.4	2918.9	2945.8	2940.4
5°	2948.4	2935.1	2900.2	2924.3	2916.3
7.5°	2924.3	2908.4	2871.0	2881.6	2868.2
10°	2892.3	2873.6	2820.4	2812.2	2796.3
12.5°	2852.4	2828.3	2756.1	2740.2	2710.8
15°	2804.3	2774.8	2684.2	2633.6	2606.9
17.5°	2748.2	2705.4	2593.4	2534.8	2492.0
20°	2684.2	2630.7	2497.4	2430.9	2371.9
22.5°	2614.9	2553.4	2398.6	2308.0	2268.1
25°	2545.5	2460.1	2283.9	2174.7	2134.5
27.5°	2462.8	2371.9	2177.2	2051.8	1990.4
30°	2374.8	2273.1	2059.8	1923.9	1851.6
32.5°	2289.3	2166.5	1947.9	1787.7	1720.9
35°	2193.3	2057.2	1822.5	1654.4	1595.4
37.5°	2099.9	1953.0	1705.0	1520.7	1454.2
40°	2001.2	1841.2	1582.2	1392.8	1323.4
42.5°	1899.8	1729.1	1459.6	1262.0	1195.4
45°	1793.1	1614.2	1334.2	1144.5	1080.6
47.5°	1691.8	1502.4	1214.2	1024.5	965.9
50°	1579.6	1390.3	1096.7	912.4	856.6
52.5°	1470.1	1269.9	984.5	808.5	757.9
55°	1363.3	1155.3	867.1	707.1	656.5
57.5°	1254.1	1040.6	763.2	613.8	571.0
60°	1141.9	928.5	653.6	517.7	475.0
62.5°	1032.7	819.2	560.3	432.3	411.1
65°	920.6	704.3	464.2	373.7	365.4
67.5°	813.9	597.6	373.7	328.1	320.2
70°	701.8	493.7	309.4	282.8	272.1
72.5°	595.0	397.4	258.8	237.6	232.1
75°	490.9	304.1	213.5	194.7	192.3
77.5°	387.0	216.0	168.2	157.4	152.0
80°	290.7	154.9	128.0	117.4	117.4
82.5°	202.7	104.2	88.0	82.7	82.7
85°	114.7	58.6	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P922211

CATALOG NUMBER: DFN2DIP-PN3F0-080D090US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.75	11.53	11.77	12.55	13.92	6.72	7.49	7.74	8.52	9.88
	3H	12.42	13.11	13.45	14.15	15.53	7.90	8.59	8.92	9.62	11.01
	4H	13.02	13.68	14.06	14.71	16.11	8.34	9.00	9.38	10.03	11.43
	6H	13.43	14.04	14.48	15.08	16.48	8.65	9.26	9.70	10.30	11.70
	8H	13.56	14.13	14.61	15.19	16.59	8.74	9.31	9.79	10.37	11.77
	12H	13.61	14.16	14.67	15.21	16.63	8.78	9.32	9.84	10.37	11.80
4H	2H	10.76	11.42	11.81	12.45	13.85	7.30	7.96	8.35	9.00	10.39
	3H	12.58	13.13	13.63	14.19	15.59	8.64	9.19	9.70	10.25	11.66
	4H	13.26	13.76	14.32	14.82	16.25	9.18	9.68	10.24	10.74	12.17
	6H	13.77	14.20	14.84	15.28	16.70	9.59	10.02	10.66	11.10	12.52
	8H	13.94	14.34	15.01	15.41	16.85	9.72	10.12	10.79	11.19	12.63
	12H	14.03	14.39	15.12	15.48	16.92	9.77	10.14	10.86	11.22	12.66
8H	4H	13.23	13.63	14.30	14.70	16.14	9.45	9.86	10.53	10.93	12.36
	6H	13.78	14.11	14.88	15.23	16.66	9.96	10.29	11.06	11.41	12.84
	8H	14.00	14.29	15.10	15.38	16.84	10.15	10.44	11.25	11.53	12.99
	12H	14.13	14.38	15.23	15.47	16.97	10.26	10.52	11.36	11.61	13.10
12H	4H	13.17	13.54	14.26	14.62	16.06	9.46	9.82	10.54	10.90	12.35
	6H	13.76	14.05	14.86	15.14	16.60	10.01	10.30	11.11	11.40	12.85
	8H	13.97	14.23	15.08	15.32	16.81	10.21	10.47	11.32	11.56	13.05

END OF REPORT