

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922221

Luminaire Tested: DFN2DIP-PN3F0-090D050US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922221
REPORT IS A COMBINATION OF REPORTS P901071 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D050US940-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12359.1 lumens
Efficiency: N/A
Efficacy: 94.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 130.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLLONL

Luminous Intensity Polar Plot

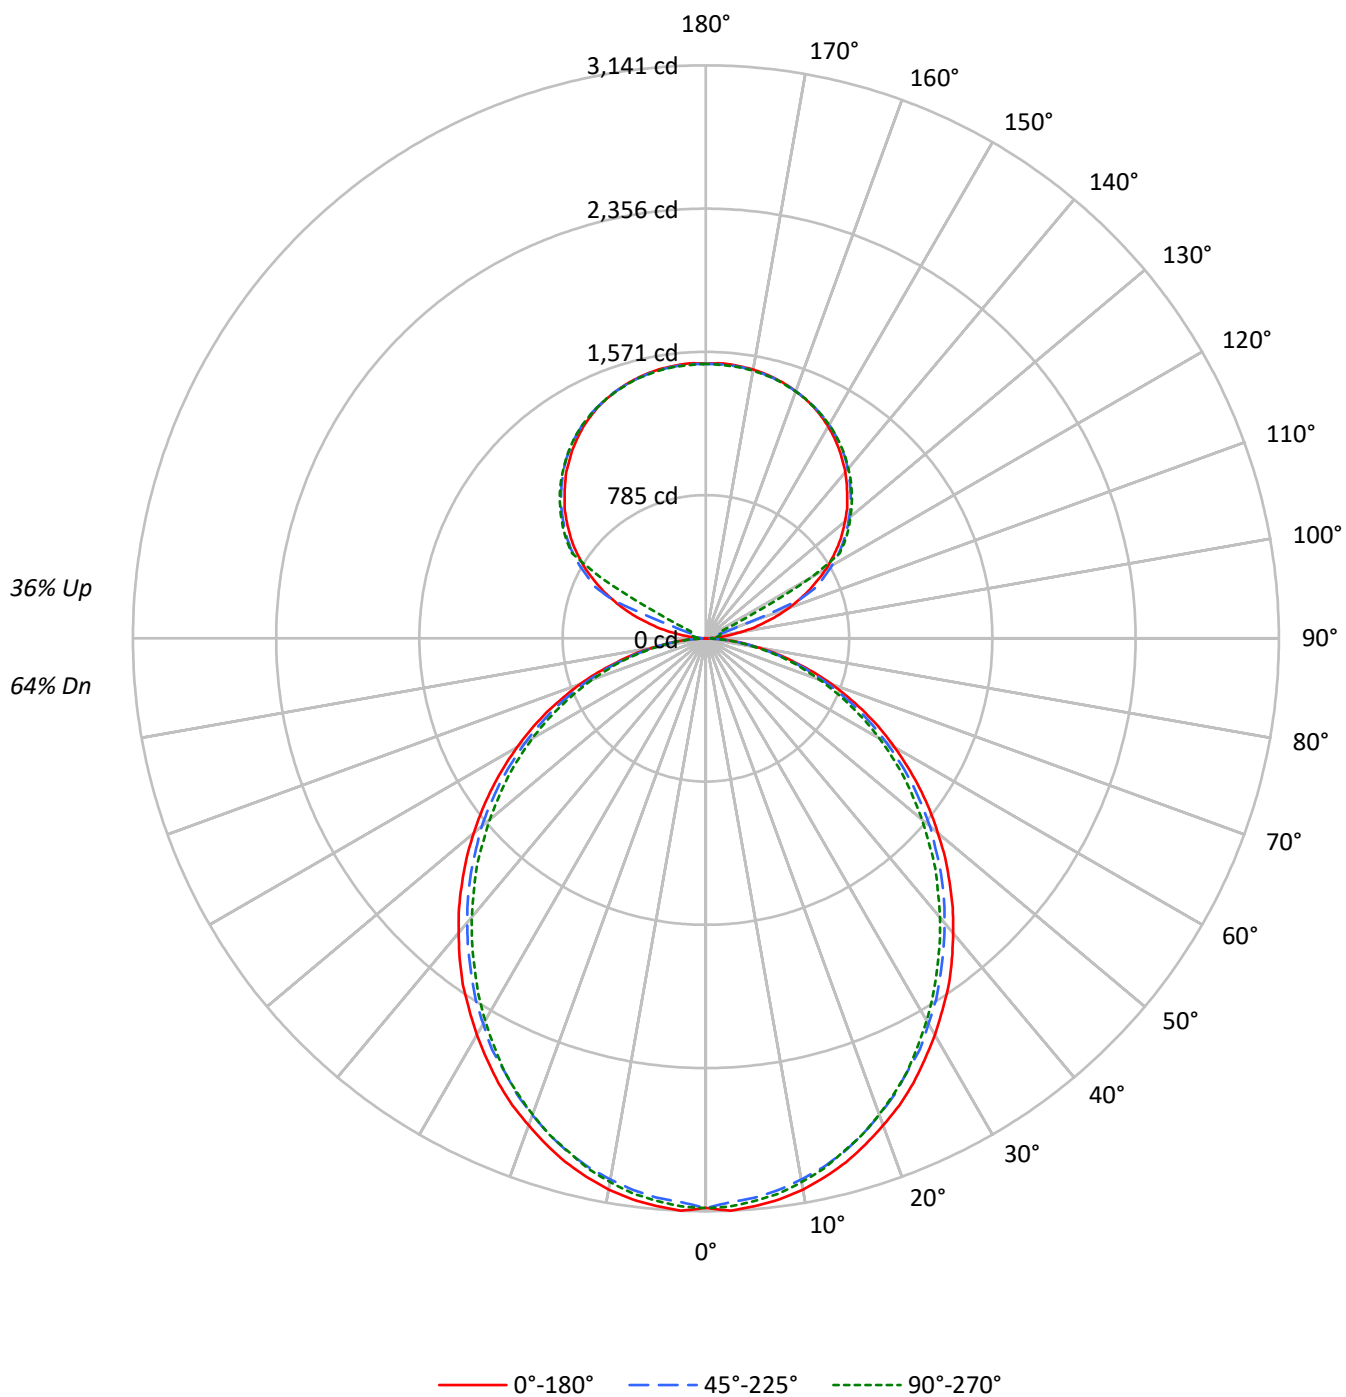

TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	91	91	91	80	80	80	69	69	69
1	101	97	93	89	95	91	87	84	80	78	75	70	68	67	61	60	59
2	92	84	78	73	86	79	74	69	70	66	62	62	59	56	54	51	49
3	84	74	67	61	79	70	63	58	62	57	52	55	51	47	48	45	42
4	77	66	58	51	72	62	55	49	55	49	45	49	44	40	43	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	39	35	32
6	65	53	44	38	61	50	42	37	45	38	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	34	30	36	31	27	32	28	25
8	56	43	35	30	53	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	26	22	27	23	20
10	49	37	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3650	3650	3650
5°	3654	3597	3622
10°	3622	3546	3572
15°	3567	3485	3493
20°	3493	3401	3413
25°	3419	3302	3321
30°	3327	3209	3204
35°	3240	3100	3081
40°	3132	2990	2963
45°	3025	2879	2843
50°	2908	2762	2703
55°	2786	2628	2575
60°	2647	2469	2428
65°	2495	2303	2254
70°	2301	2101	2067
75°	2034	1859	1891
80°	1711	1550	1561
85°	1207	1026	1017

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3025 cd/sqm

TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	2.4
10°-20°	827.0	6.7
20°-30°	1215.3	9.8
30°-40°	1411.5	11.4
40°-50°	1409.7	11.4
50°-60°	1229.3	9.9
60°-70°	908.7	7.4
70°-80°	514.1	4.2
80°-90°	138.3	1.1
90°-100°	49.6	0.4
100°-110°	185.0	1.5
110°-120°	490.6	4.0
120°-130°	813.6	6.6
130°-140°	864.3	7.0
140°-150°	803.2	6.5
150°-160°	645.8	5.2
160°-170°	416.1	3.4
170°-180°	143.2	1.2
0°-30°	2336.2	18.9
0°-40°	3747.7	30.3
0°-60°	6386.7	51.7
0°-90°	7947.8	64.3
90°-120°	725.2	5.9
90°-150°	3206.2	25.9
90°-180°	4411.0	35.7
0°-180°	12359.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	1	13	22	27	29	11
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0



TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P922221

CATALOG NUMBER: DFN2DIP-PN3F0-090D050US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.96	13.96	13.78	14.81	15.86	12.52	13.52	13.34	14.37	15.42
	3H	14.62	15.53	15.46	16.38	17.46	14.14	15.04	14.98	15.90	16.98
	4H	15.21	16.07	16.07	16.93	18.02	14.73	15.58	15.58	16.44	17.53
	6H	15.61	16.40	16.48	17.27	18.38	15.13	15.91	15.99	16.78	17.89
	8H	15.72	16.47	16.60	17.36	18.46	15.23	15.98	16.10	16.87	17.97
	12H	15.77	16.49	16.65	17.37	18.50	15.28	15.99	16.15	16.87	18.00
4H	2H	13.43	14.29	14.29	15.15	16.24	13.08	13.93	13.94	14.80	15.89
	3H	15.30	16.02	16.17	16.91	18.02	14.90	15.61	15.77	16.51	17.62
	4H	16.02	16.67	16.90	17.56	18.69	15.60	16.25	16.48	17.14	18.28
	6H	16.54	17.10	17.43	18.01	19.15	16.11	16.68	17.01	17.59	18.73
	8H	16.69	17.21	17.59	18.12	19.27	16.26	16.78	17.16	17.70	18.84
	12H	16.76	17.24	17.68	18.17	19.32	16.33	16.80	17.25	17.73	18.88
8H	4H	16.22	16.75	17.12	17.66	18.81	15.85	16.38	16.75	17.29	18.44
	6H	16.85	17.29	17.78	18.24	19.39	16.48	16.91	17.40	17.86	19.01
	8H	17.07	17.46	18.01	18.40	19.56	16.69	17.07	17.62	18.02	19.18
	12H	17.20	17.54	18.14	18.48	19.70	16.81	17.14	17.74	18.08	19.30
12H	4H	16.21	16.69	17.13	17.62	18.77	15.85	16.33	16.77	17.26	18.41
	6H	16.88	17.27	17.82	18.21	19.38	16.52	16.90	17.45	17.85	19.01
	8H	17.13	17.47	18.07	18.40	19.62	16.76	17.09	17.69	18.03	19.25

END OF REPORT