

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922224

Luminaire Tested: DFN2DIP-PN3F0-090D060US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922224
REPORT IS A COMBINATION OF REPORTS P899565 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D060US940-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12680.1 lumens
Efficiency: N/A
Efficacy: 91.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 139
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFLL

Luminous Intensity Polar Plot

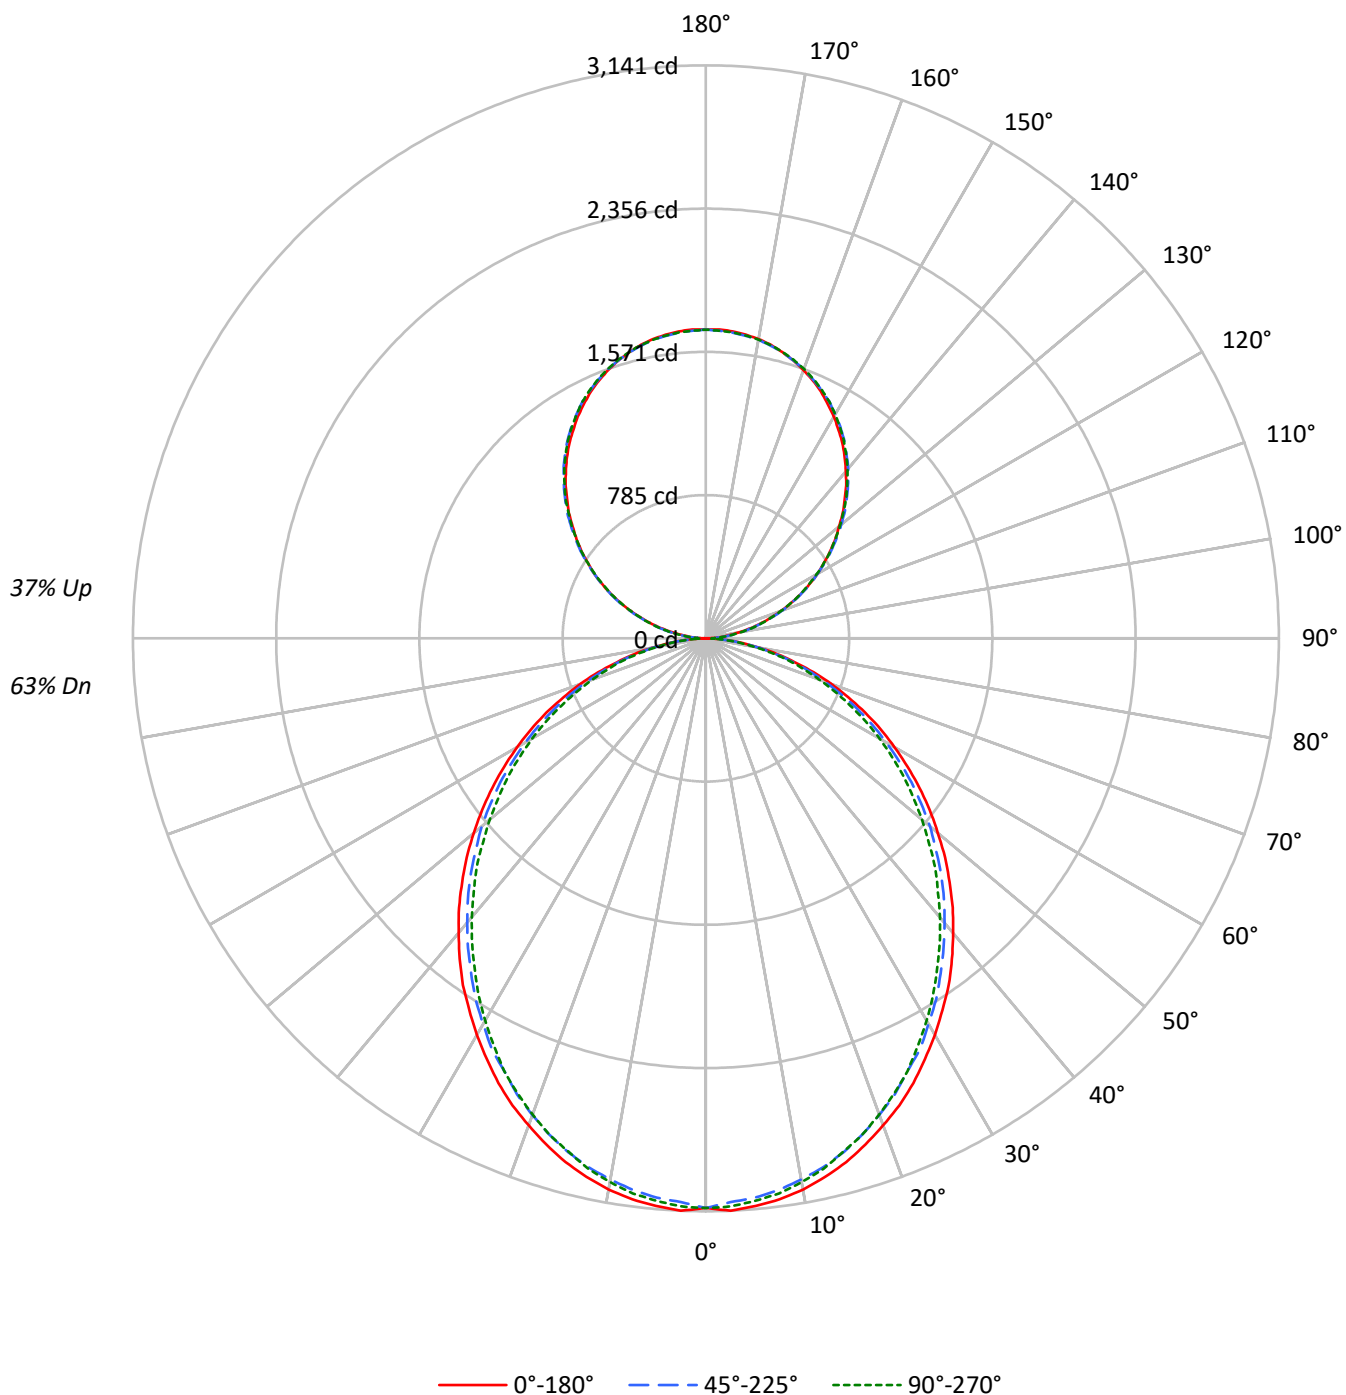

TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3650	3650	3650
5°	3654	3597	3622
10°	3622	3546	3572
15°	3567	3485	3493
20°	3493	3401	3413
25°	3419	3302	3321
30°	3327	3209	3204
35°	3240	3100	3081
40°	3132	2990	2963
45°	3025	2879	2843
50°	2908	2762	2703
55°	2786	2628	2575
60°	2647	2469	2428
65°	2495	2303	2254
70°	2301	2101	2067
75°	2034	1859	1891
80°	1711	1550	1561
85°	1207	1026	1017

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3025 cd/sqm

TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	2.3
10°-20°	827.0	6.5
20°-30°	1215.3	9.6
30°-40°	1411.5	11.1
40°-50°	1409.7	11.1
50°-60°	1229.3	9.7
60°-70°	908.7	7.2
70°-80°	514.1	4.1
80°-90°	140.5	1.1
90°-100°	104.7	0.8
100°-110°	332.7	2.6
110°-120°	569.3	4.5
120°-130°	748.8	5.9
130°-140°	840.5	6.6
140°-150°	824.2	6.5
150°-160°	691.4	5.5
160°-170°	458.5	3.6
170°-180°	160.3	1.3
0°-30°	2336.2	18.4
0°-40°	3747.7	29.6
0°-60°	6386.7	50.4
0°-90°	7950.0	62.7
90°-120°	1006.7	7.9
90°-150°	3420.1	27.0
90°-180°	4730.0	37.3
0°-180°	12680.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	2	18	50	47	48	12
95°	74	89	91	91	89	83
105°	307	311	314	317	317	324
115°	571	580	577	575	571	565
125°	831	844	840	835	834	743
135°	1075	1091	1094	1092	1088	831
145°	1305	1315	1323	1325	1319	815
155°	1492	1496	1501	1508	1503	687
165°	1623	1622	1622	1632	1625	458
175°	1689	1685	1682	1692	1683	160
180°	1692	1692	1692	1692	1692	

TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	1.5	18.4	50.0	46.9	48.4
92.5°	31.7	42.9	44.4	45.9	45.9
95°	74.5	88.7	91.3	91.3	88.7
97.5°	123.9	137.2	142.9	142.9	142.9
100°	181.1	192.8	196.9	196.9	195.4
102.5°	241.3	249.9	255.6	257.1	255.6
105°	307.1	311.2	314.2	316.8	316.8
107.5°	372.4	378.5	378.5	379.5	372.4
110°	435.7	443.8	443.8	443.8	439.7



TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.0	512.6	511.1	507.0	504.0
115°	571.3	579.5	576.9	575.4	571.3
117.5°	638.2	649.4	642.2	638.2	634.1
120°	705.5	716.8	705.5	705.5	700.9
122.5°	766.7	781.0	773.8	769.8	766.7
125°	831.0	843.7	839.6	835.1	833.6
127.5°	893.8	909.5	903.9	897.9	893.8
130°	952.4	970.8	968.2	965.2	959.6
132.5°	1018.2	1032.5	1033.5	1026.4	1022.3
135°	1074.9	1090.7	1093.7	1092.2	1088.1
137.5°	1138.1	1150.8	1153.4	1152.4	1146.3
140°	1193.7	1206.5	1213.6	1213.6	1208.0
142.5°	1250.8	1263.6	1267.7	1269.2	1263.6
145°	1304.9	1315.1	1323.3	1324.8	1319.2
147.5°	1353.3	1366.1	1372.3	1374.7	1369.1
150°	1403.4	1412.0	1417.6	1422.2	1417.6
152.5°	1447.7	1456.4	1463.6	1469.2	1463.6
155°	1492.1	1496.2	1500.7	1508.0	1503.3
157.5°	1530.4	1533.5	1536.0	1546.2	1539.1
160°	1564.6	1567.6	1569.1	1577.8	1571.7
162.5°	1596.2	1596.2	1597.7	1607.4	1600.3
165°	1623.2	1621.7	1621.7	1631.9	1624.8
167.5°	1647.7	1643.2	1643.2	1653.3	1646.2
170°	1666.1	1662.0	1660.5	1670.6	1662.0
172.5°	1678.8	1674.7	1673.2	1683.4	1674.7
175°	1689.0	1685.0	1681.9	1692.1	1683.4
177.5°	1694.6	1690.6	1687.5	1696.1	1687.5
180°	1692.1	1692.1	1692.1	1692.1	1692.1

TEST NUMBER: P922224

CATALOG NUMBER: DFN2DIP-PN3F0-090D060US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.83	13.81	13.67	14.68	15.75	12.39	13.38	13.23	14.24	15.32
	3H	14.49	15.38	15.34	16.25	17.35	14.01	14.89	14.86	15.77	16.87
	4H	15.08	15.92	15.95	16.80	17.91	14.59	15.43	15.46	16.31	17.43
	6H	15.48	16.25	16.36	17.14	18.27	14.99	15.77	15.87	16.65	17.78
	8H	15.59	16.32	16.48	17.23	18.36	15.10	15.83	15.99	16.74	17.87
	12H	15.64	16.34	16.53	17.24	18.39	15.14	15.84	16.04	16.74	17.89
4H	2H	13.30	14.14	14.17	15.02	16.13	12.95	13.79	13.82	14.67	15.78
	3H	15.17	15.87	16.05	16.78	17.91	14.77	15.47	15.65	16.38	17.51
	4H	15.88	16.52	16.78	17.43	18.59	15.47	16.11	16.36	17.01	18.17
	6H	16.40	16.95	17.31	17.88	19.04	15.98	16.53	16.89	17.46	18.62
	8H	16.55	17.07	17.46	17.99	19.16	16.12	16.64	17.04	17.56	18.74
	12H	16.63	17.09	17.56	18.03	19.21	16.19	16.65	17.12	17.60	18.77
8H	4H	16.09	16.60	17.00	17.53	18.70	15.72	16.23	16.63	17.16	18.33
	6H	16.72	17.14	17.66	18.11	19.28	16.34	16.77	17.28	17.73	18.90
	8H	16.93	17.31	17.88	18.27	19.46	16.55	16.93	17.50	17.89	19.07
	12H	17.07	17.40	18.02	18.35	19.59	16.67	17.00	17.62	17.95	19.19
12H	4H	16.08	16.54	17.01	17.49	18.66	15.72	16.18	16.65	17.12	18.30
	6H	16.74	17.12	17.70	18.08	19.27	16.38	16.76	17.33	17.72	18.91
	8H	16.99	17.32	17.94	18.27	19.51	16.62	16.95	17.57	17.90	19.14