

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924813

Luminaire Tested: DFN2DIP-PN3F0-040D060US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924813
REPORT IS A COMBINATION OF REPORTS P901075 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D060US950-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9444.6 lumens
Efficiency: N/A
Efficacy: 117.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 80.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

Luminous Intensity Polar Plot

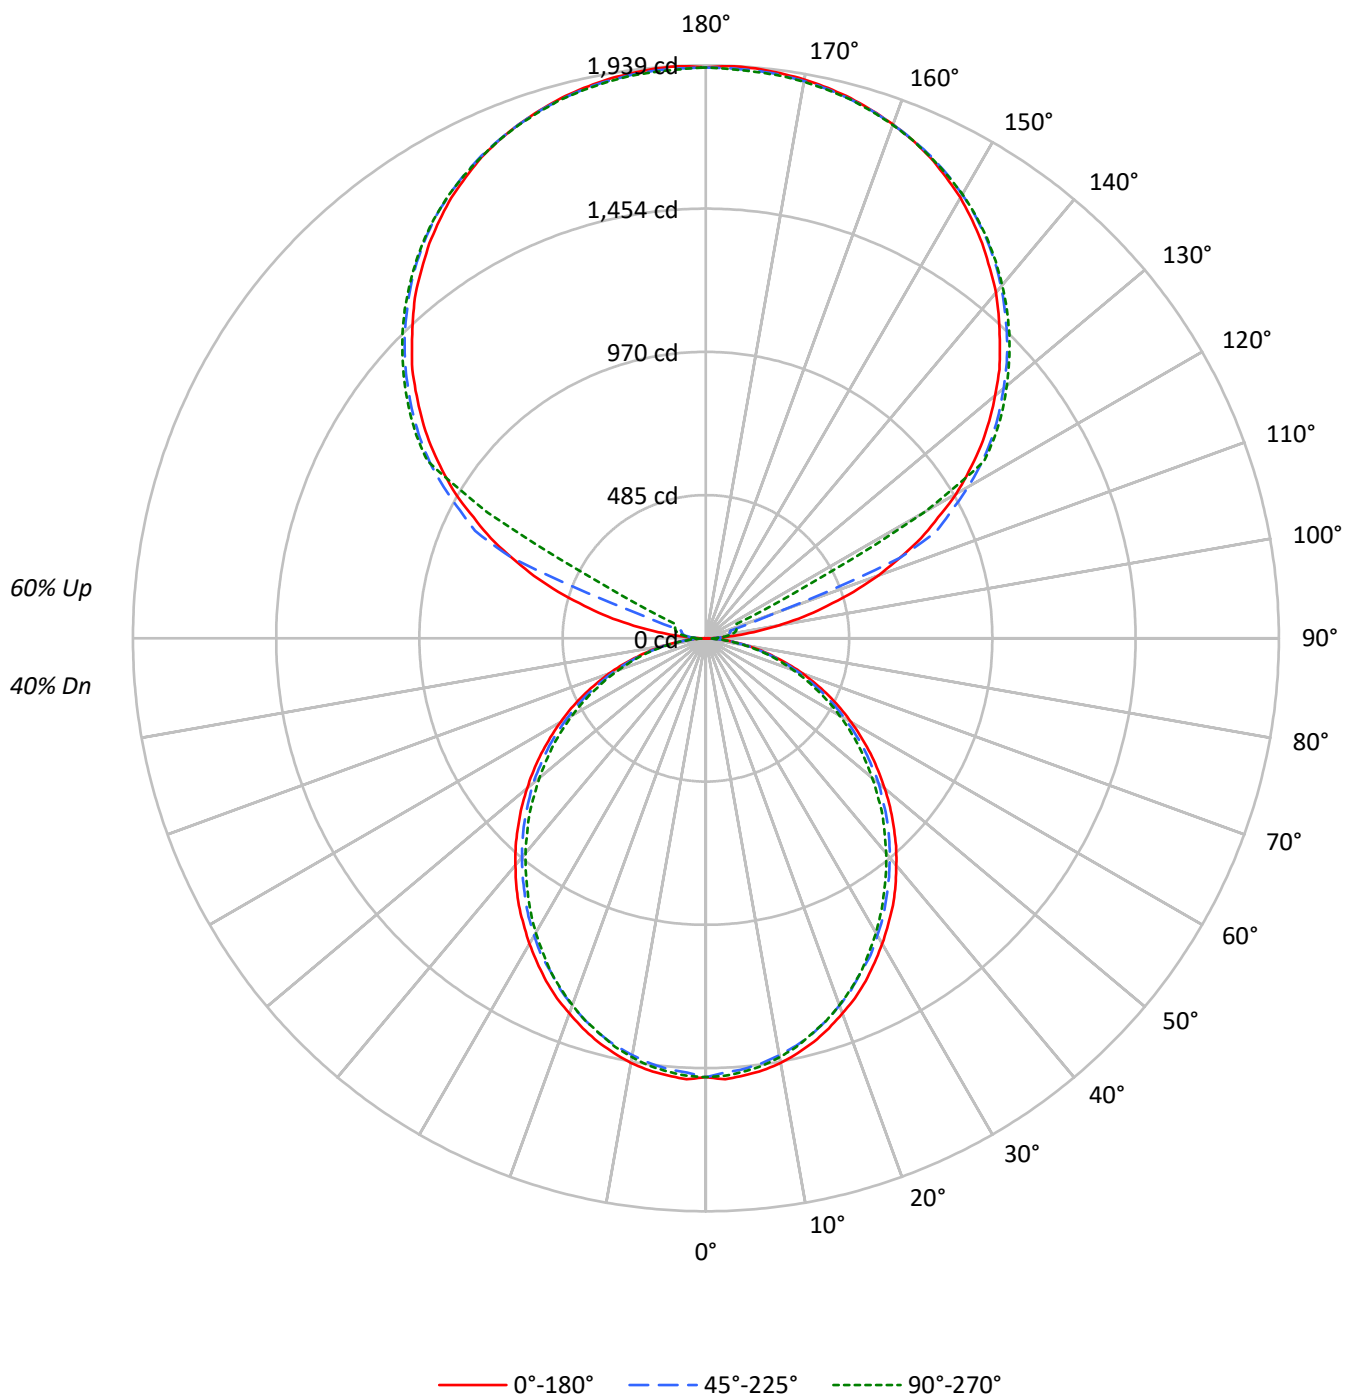

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1736	1736	1736
5°	1737	1710	1722
10°	1722	1686	1698
15°	1696	1657	1661
20°	1661	1617	1623
25°	1626	1570	1579
30°	1582	1526	1524
35°	1540	1474	1465
40°	1489	1421	1409
45°	1439	1369	1352
50°	1383	1314	1285
55°	1324	1250	1224
60°	1258	1174	1154
65°	1186	1095	1072
70°	1094	999	983
75°	967	884	899
80°	813	737	742
85°	574	487	484

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1439 cd/sqm

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	139.8	1.5
10°-20°	393.2	4.2
20°-30°	577.9	6.1
30°-40°	671.2	7.1
40°-50°	670.3	7.1
50°-60°	584.5	6.2
60°-70°	432.1	4.6
70°-80°	244.5	2.6
80°-90°	67.9	0.7
90°-100°	63.7	0.7
100°-110°	237.5	2.5
110°-120°	629.8	6.7
120°-130°	1044.5	11.1
130°-140°	1109.5	11.7
140°-150°	1031.2	10.9
150°-160°	829.1	8.8
160°-170°	534.2	5.7
170°-180°	183.9	1.9
0°-30°	1110.8	11.8
0°-40°	1782.0	18.9
0°-60°	3036.8	32.2
0°-90°	3781.2	40.0
90°-120°	930.9	9.9
90°-150°	4116.2	43.6
90°-180°	5663.0	60.0
0°-180°	9444.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1485	1485	1485	1485	1485	
5°	1485	1479	1463	1475	1472	141
15°	1413	1405	1386	1392	1385	398
25°	1279	1268	1244	1246	1244	589
35°	1104	1090	1067	1058	1051	689
45°	898	888	867	851	845	693
55°	680	671	654	637	630	608
65°	458	450	436	423	416	453
75°	240	237	230	221	224	256
85°	58	57	56	51	50	65
90°	1	17	28	35	38	9
95°	91	45	54	62	60	108
105°	425	467	85	101	106	454
115°	804	828	862	215	115	791
125°	1136	1155	1181	1191	1195	1014
135°	1406	1429	1441	1455	1452	1086
145°	1631	1630	1654	1663	1656	1020
155°	1796	1784	1800	1809	1798	828
165°	1893	1884	1888	1898	1888	535
175°	1936	1926	1929	1939	1925	184
180°	1932	1932	1932	1932	1932	

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1484.8	1484.8	1484.8	1484.8	1484.8
2.5°	1493.5	1486.3	1470.6	1484.8	1482.1
5°	1484.8	1479.2	1463.4	1474.8	1472.1
7.5°	1474.8	1466.3	1450.6	1462.1	1459.2
10°	1459.2	1449.2	1432.1	1443.5	1439.2
12.5°	1437.7	1429.2	1412.1	1419.3	1416.3
15°	1413.4	1405.0	1386.4	1392.1	1385.0
17.5°	1383.5	1375.0	1356.4	1363.5	1356.4
20°	1350.6	1342.1	1322.1	1326.3	1320.8
22.5°	1317.9	1305.0	1286.4	1286.4	1283.5
25°	1279.2	1267.9	1243.6	1246.4	1243.6
27.5°	1236.4	1226.4	1208.0	1203.7	1196.6
30°	1193.6	1182.2	1160.8	1156.5	1150.8
32.5°	1147.9	1139.5	1116.6	1108.0	1102.2
35°	1103.7	1089.5	1066.6	1058.0	1050.8
37.5°	1053.7	1040.8	1017.9	1008.0	1000.8
40°	1002.4	990.8	967.9	955.2	949.5
42.5°	952.4	940.8	918.1	903.7	895.2
45°	898.1	888.2	866.6	851.1	845.2
47.5°	845.2	835.2	812.4	796.7	788.2
50°	789.5	782.4	762.4	742.4	735.2
52.5°	735.2	725.3	706.8	691.1	681.1
55°	679.7	671.0	654.0	636.8	629.7
57.5°	623.9	616.9	598.2	581.1	575.4
60°	568.2	562.6	542.6	526.9	522.6
62.5°	514.0	504.0	489.8	475.5	469.7
65°	458.4	449.7	435.5	422.6	415.6
67.5°	401.3	394.0	381.3	371.3	365.6
70°	348.4	342.7	329.8	319.8	314.2
72.5°	294.2	288.4	281.3	271.3	267.0
75°	239.8	237.1	229.8	221.3	224.2
77.5°	191.3	185.6	182.7	178.4	174.2
80°	142.8	141.3	138.4	134.2	131.4
82.5°	97.1	97.1	95.8	90.0	90.0
85°	58.5	57.1	55.7	51.3	50.0
87.5°	25.8	22.9	20.0	15.7	14.2
90°	1.3	16.8	27.9	35.0	37.7
92.5°	35.0	29.4	33.5	36.3	37.7
95°	90.8	44.6	54.5	61.6	60.1
97.5°	163.5	48.9	71.2	75.6	76.9
100°	247.5	55.9	79.7	90.8	93.6
102.5°	339.6	337.0	82.5	97.8	102.1
105°	424.9	466.9	85.3	100.6	106.3
107.5°	524.2	559.0	88.1	103.4	109.0
110°	619.3	648.5	244.7	104.9	110.4

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	708.7	733.8	710.1	107.5	111.9
115°	803.7	827.5	862.5	215.3	114.7
117.5°	886.2	914.1	938.0	738.0	371.8
120°	978.5	999.4	1024.7	1041.4	852.7
122.5°	1056.7	1079.1	1107.1	1115.4	1116.9
125°	1136.4	1154.6	1181.1	1191.0	1195.1
127.5°	1209.1	1228.7	1249.7	1263.7	1265.0
130°	1277.6	1300.0	1315.3	1330.7	1329.4
132.5°	1347.5	1365.7	1381.0	1393.6	1392.3
135°	1406.3	1428.7	1441.1	1455.2	1452.4
137.5°	1467.6	1484.4	1498.5	1512.5	1508.4
140°	1527.7	1539.1	1554.4	1566.9	1560.0
142.5°	1578.2	1588.0	1606.2	1617.2	1610.3
145°	1631.3	1629.8	1653.6	1663.4	1656.4
147.5°	1677.3	1673.1	1696.9	1703.8	1698.4
150°	1722.2	1712.3	1734.8	1743.1	1736.1
152.5°	1759.8	1748.7	1769.6	1778.1	1768.2
155°	1796.2	1783.7	1800.5	1808.8	1797.6
157.5°	1825.6	1814.4	1827.0	1836.8	1825.6
160°	1850.8	1842.3	1850.8	1859.1	1849.3
162.5°	1873.0	1864.7	1871.7	1881.5	1868.9
165°	1892.6	1884.3	1888.4	1898.3	1888.4
167.5°	1908.0	1899.6	1903.9	1913.7	1901.0
170°	1920.7	1912.2	1915.1	1924.8	1912.2
172.5°	1929.0	1920.7	1923.5	1933.3	1920.7
175°	1936.0	1926.1	1929.0	1938.7	1924.8
177.5°	1938.7	1929.0	1930.4	1940.2	1927.7
180°	1931.8	1931.8	1931.8	1931.8	1931.8

TEST NUMBER: P924813

CATALOG NUMBER: DFN2DIP-PN3F0-040D060US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.15	8.93	9.19	9.97	11.38	7.71	8.49	8.75	9.54	10.94
	3H	9.80	10.50	10.85	11.55	12.98	9.32	10.02	10.37	11.07	12.49
	4H	10.38	11.04	11.44	12.10	13.53	9.89	10.56	10.95	11.61	13.04
	6H	10.77	11.38	11.84	12.44	13.88	10.28	10.89	11.35	11.95	13.39
	8H	10.87	11.45	11.94	12.53	13.97	10.38	10.96	11.45	12.04	13.48
	12H	10.91	11.46	11.99	12.53	14.00	10.42	10.97	11.50	12.04	13.50
4H	2H	8.60	9.26	9.67	10.32	11.75	8.25	8.91	9.32	9.97	11.40
	3H	10.45	11.00	11.52	12.09	13.53	10.05	10.60	11.12	11.68	13.13
	4H	11.16	11.66	12.24	12.74	14.20	10.74	11.25	11.82	12.32	13.79
	6H	11.66	12.10	12.75	13.19	14.65	11.24	11.67	12.33	12.77	14.23
	8H	11.81	12.21	12.89	13.30	14.78	11.38	11.79	12.47	12.87	14.35
	12H	11.87	12.24	12.98	13.34	14.82	11.43	11.80	12.54	12.90	14.39
8H	4H	11.34	11.75	12.43	12.84	14.31	10.97	11.38	12.06	12.47	13.94
	6H	11.96	12.30	13.07	13.43	14.90	11.59	11.92	12.70	13.05	14.53
	8H	12.18	12.47	13.30	13.59	15.08	11.80	12.09	12.91	13.20	14.70
	12H	12.30	12.56	13.42	13.67	15.20	11.90	12.16	13.02	13.27	14.80
12H	4H	11.32	11.69	12.43	12.79	14.28	10.96	11.33	12.07	12.43	13.91
	6H	11.99	12.28	13.11	13.40	14.89	11.63	11.92	12.74	13.03	14.53
	8H	12.22	12.48	13.34	13.59	15.12	11.85	12.11	12.97	13.22	14.75

END OF REPORT