

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924821

Luminaire Tested: DFN2DIP-PN3F0-040D080US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924821
REPORT IS A COMBINATION OF REPORTS P901103 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D080US950-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11333.5 lumens
Efficiency: N/A
Efficacy: 117.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 96.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLLONL

Luminous Intensity Polar Plot

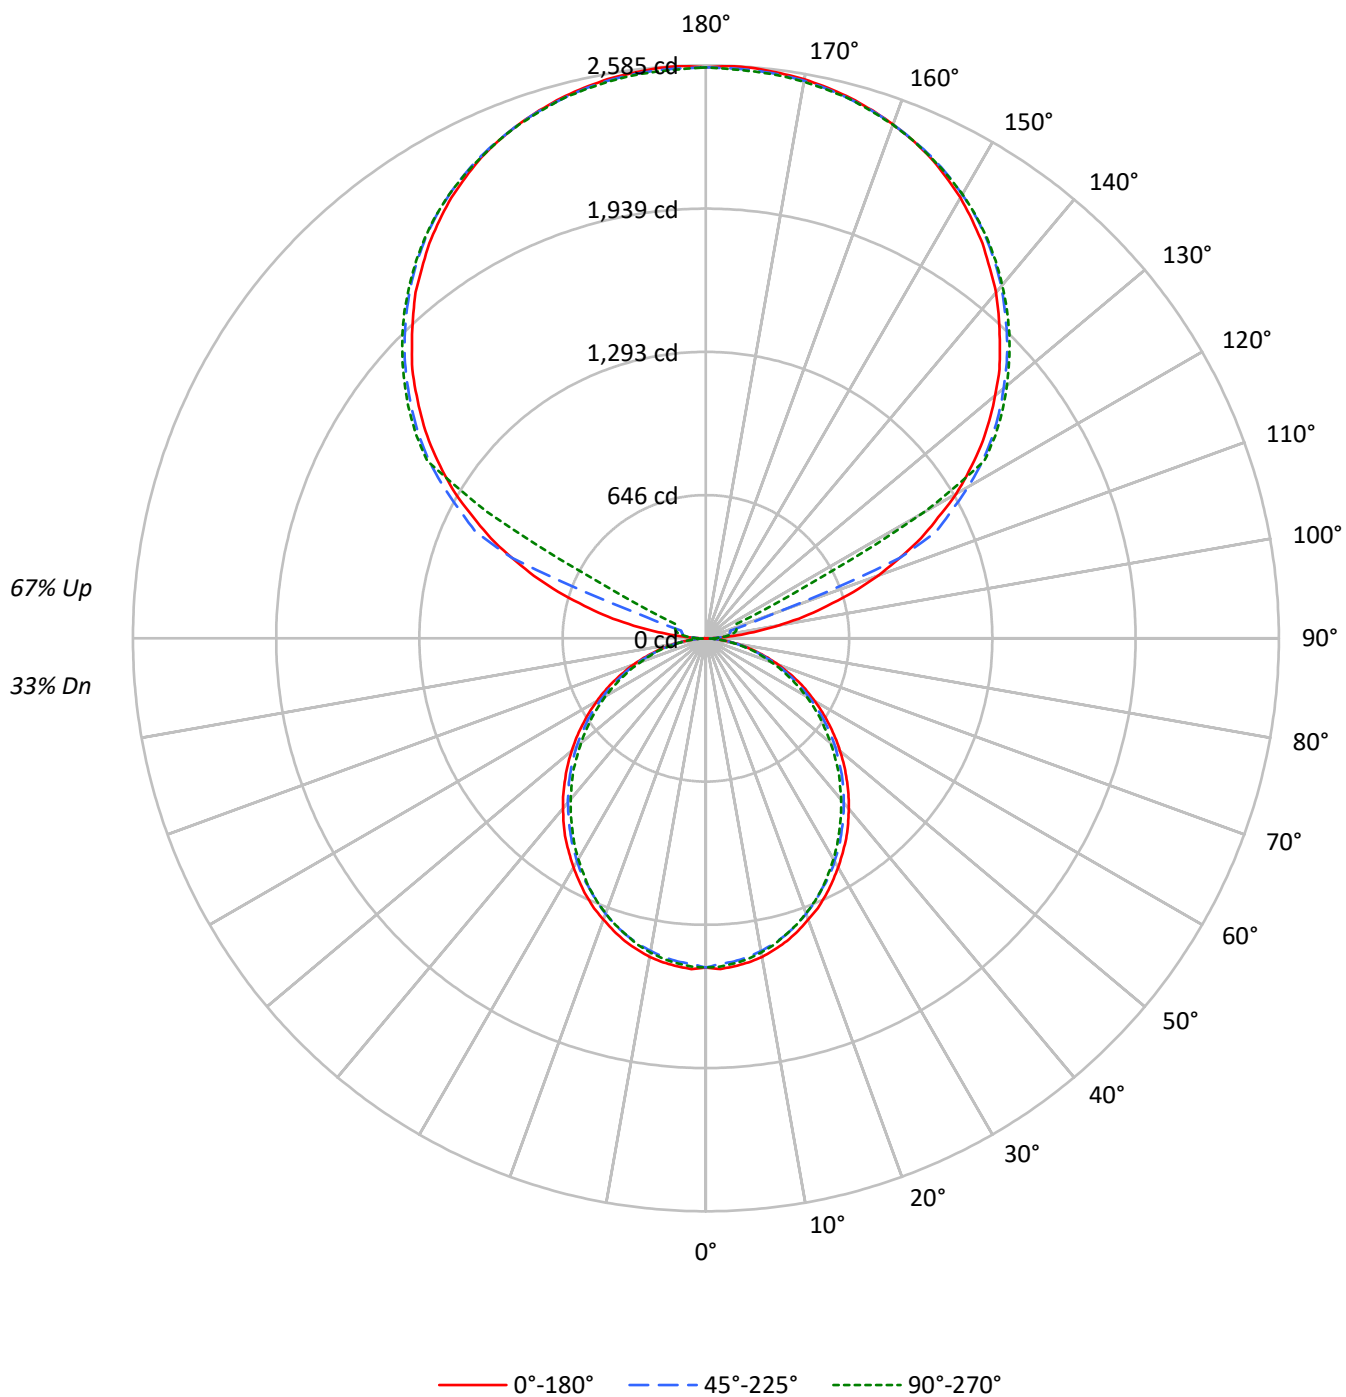

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1736	1736	1736
5°	1737	1710	1722
10°	1722	1686	1698
15°	1696	1657	1661
20°	1661	1617	1623
25°	1626	1570	1579
30°	1582	1526	1524
35°	1540	1474	1465
40°	1489	1421	1409
45°	1439	1369	1352
50°	1383	1314	1285
55°	1324	1250	1224
60°	1258	1174	1154
65°	1186	1095	1072
70°	1094	999	983
75°	967	884	899
80°	813	737	742
85°	574	487	484

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1740 cd/sqm

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	139.8	1.2
10°-20°	393.2	3.5
20°-30°	577.9	5.1
30°-40°	671.2	5.9
40°-50°	670.3	5.9
50°-60°	584.5	5.2
60°-70°	432.1	3.8
70°-80°	244.5	2.2
80°-90°	69.0	0.6
90°-100°	84.9	0.7
100°-110°	316.6	2.8
110°-120°	839.7	7.4
120°-130°	1392.7	12.3
130°-140°	1479.4	13.1
140°-150°	1374.9	12.1
150°-160°	1105.4	9.8
160°-170°	712.3	6.3
170°-180°	245.2	2.2
0°-30°	1110.8	9.8
0°-40°	1782.0	15.7
0°-60°	3036.8	26.8
0°-90°	3782.4	33.4
90°-120°	1241.3	11.0
90°-150°	5488.3	48.4
90°-180°	7551.0	66.6
0°-180°	11333.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1485	1485	1485	1485	1485	
5°	1485	1479	1463	1475	1472	141
15°	1413	1405	1386	1392	1385	398
25°	1279	1268	1244	1246	1244	589
35°	1104	1090	1067	1058	1051	689
45°	898	888	867	851	845	693
55°	680	671	654	637	630	608
65°	458	450	436	423	416	453
75°	240	237	230	221	224	256
85°	58	57	56	51	50	65
90°	2	22	37	47	50	10
95°	121	60	73	82	80	143
105°	567	623	114	134	142	605
115°	1072	1103	1150	287	153	1055
125°	1515	1540	1575	1588	1594	1351
135°	1875	1905	1922	1940	1936	1448
145°	2175	2173	2205	2218	2208	1360
155°	2395	2378	2401	2412	2397	1104
165°	2524	2512	2518	2531	2518	713
175°	2581	2568	2572	2585	2566	246
180°	2576	2576	2576	2576	2576	

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1484.8	1484.8	1484.8	1484.8	1484.8
2.5°	1493.5	1486.3	1470.6	1484.8	1482.1
5°	1484.8	1479.2	1463.4	1474.8	1472.1
7.5°	1474.8	1466.3	1450.6	1462.1	1459.2
10°	1459.2	1449.2	1432.1	1443.5	1439.2
12.5°	1437.7	1429.2	1412.1	1419.3	1416.3
15°	1413.4	1405.0	1386.4	1392.1	1385.0
17.5°	1383.5	1375.0	1356.4	1363.5	1356.4
20°	1350.6	1342.1	1322.1	1326.3	1320.8
22.5°	1317.9	1305.0	1286.4	1286.4	1283.5
25°	1279.2	1267.9	1243.6	1246.4	1243.6
27.5°	1236.4	1226.4	1208.0	1203.7	1196.6
30°	1193.6	1182.2	1160.8	1156.5	1150.8
32.5°	1147.9	1139.5	1116.6	1108.0	1102.2
35°	1103.7	1089.5	1066.6	1058.0	1050.8
37.5°	1053.7	1040.8	1017.9	1008.0	1000.8
40°	1002.4	990.8	967.9	955.2	949.5
42.5°	952.4	940.8	918.1	903.7	895.2
45°	898.1	888.2	866.6	851.1	845.2
47.5°	845.2	835.2	812.4	796.7	788.2
50°	789.5	782.4	762.4	742.4	735.2
52.5°	735.2	725.3	706.8	691.1	681.1
55°	679.7	671.0	654.0	636.8	629.7
57.5°	623.9	616.9	598.2	581.1	575.4
60°	568.2	562.6	542.6	526.9	522.6
62.5°	514.0	504.0	489.8	475.5	469.7
65°	458.4	449.7	435.5	422.6	415.6
67.5°	401.3	394.0	381.3	371.3	365.6
70°	348.4	342.7	329.8	319.8	314.2
72.5°	294.2	288.4	281.3	271.3	267.0
75°	239.8	237.1	229.8	221.3	224.2
77.5°	191.3	185.6	182.7	178.4	174.2
80°	142.8	141.3	138.4	134.2	131.4
82.5°	97.1	97.1	95.8	90.0	90.0
85°	58.5	57.1	55.7	51.3	50.0
87.5°	25.8	22.9	20.0	15.7	14.2
90°	1.8	22.3	37.2	46.7	50.3
92.5°	46.7	39.2	44.7	48.5	50.3
95°	121.1	59.5	72.6	82.1	80.1
97.5°	218.0	65.3	94.9	100.7	102.5
100°	330.0	74.6	106.3	121.1	124.8
102.5°	452.9	449.2	110.0	130.3	136.1
105°	566.6	622.6	113.7	134.1	141.7
107.5°	698.9	745.4	117.5	137.9	145.4
110°	825.8	864.7	326.3	139.9	147.2

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	945.0	978.4	946.8	143.4	149.2
115°	1071.6	1103.3	1150.0	287.1	152.9
117.5°	1181.6	1218.8	1250.7	984.0	495.8
120°	1304.7	1332.5	1366.2	1388.5	1136.9
122.5°	1408.9	1438.8	1476.2	1487.3	1489.3
125°	1515.1	1539.5	1574.9	1587.9	1593.5
127.5°	1612.1	1638.2	1666.4	1684.9	1686.7
130°	1703.5	1733.3	1753.7	1774.3	1772.5
132.5°	1796.7	1821.0	1841.4	1858.2	1856.4
135°	1875.0	1904.9	1921.5	1940.3	1936.5
137.5°	1956.9	1979.3	1998.1	2016.7	2011.1
140°	2037.0	2052.1	2072.5	2089.3	2079.9
142.5°	2104.3	2117.3	2141.4	2156.3	2147.0
145°	2175.1	2173.1	2204.8	2217.9	2208.5
147.5°	2236.5	2230.9	2262.5	2271.9	2264.5
150°	2296.2	2283.1	2313.0	2324.0	2314.8
152.5°	2346.5	2331.6	2359.4	2370.8	2357.7
155°	2394.9	2378.3	2400.6	2411.7	2396.9
157.5°	2434.0	2419.2	2436.0	2449.1	2434.0
160°	2467.7	2456.5	2467.7	2478.8	2465.7
162.5°	2497.4	2486.3	2495.6	2508.6	2491.8
165°	2523.5	2512.5	2518.0	2531.0	2518.0
167.5°	2544.0	2532.8	2538.5	2551.6	2534.8
170°	2560.9	2549.6	2553.4	2566.5	2549.6
172.5°	2572.0	2560.9	2564.6	2577.7	2560.9
175°	2581.2	2568.2	2572.0	2585.0	2566.5
177.5°	2585.0	2572.0	2573.9	2587.0	2570.2
180°	2575.7	2575.7	2575.7	2575.7	2575.7

TEST NUMBER: P924821

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.38	8.11	8.46	9.19	10.68	6.94	7.67	8.03	8.75	10.24
	3H	9.02	9.67	10.12	10.77	12.28	8.54	9.19	9.63	10.29	11.79
	4H	9.60	10.22	10.71	11.31	12.83	9.11	9.73	10.22	10.83	12.34
	6H	9.99	10.56	11.10	11.66	13.18	9.50	10.07	10.61	11.17	12.69
	8H	10.08	10.63	11.20	11.74	13.26	9.59	10.14	10.71	11.25	12.77
	12H	10.13	10.64	11.25	11.75	13.29	9.63	10.15	10.75	11.25	12.80
4H	2H	7.82	8.44	8.93	9.53	11.05	7.47	8.09	8.58	9.18	10.70
	3H	9.66	10.18	10.79	11.30	12.83	9.26	9.78	10.38	10.90	12.43
	4H	10.37	10.84	11.49	11.96	13.50	9.95	10.43	11.08	11.54	13.09
	6H	10.87	11.28	12.00	12.41	13.95	10.45	10.86	11.58	11.99	13.53
	8H	11.01	11.39	12.14	12.52	14.08	10.59	10.97	11.72	12.10	13.65
	12H	11.08	11.42	12.23	12.56	14.12	10.64	10.98	11.79	12.12	13.68
8H	4H	10.55	10.93	11.68	12.06	13.61	10.18	10.56	11.31	11.69	13.24
	6H	11.17	11.48	12.32	12.65	14.20	10.79	11.11	11.95	12.28	13.83
	8H	11.38	11.66	12.54	12.81	14.38	11.00	11.28	12.16	12.42	14.00
	12H	11.50	11.75	12.67	12.89	14.50	11.10	11.35	12.27	12.49	14.10
12H	4H	10.53	10.87	11.68	12.01	13.57	10.17	10.51	11.31	11.65	13.21
	6H	11.20	11.47	12.35	12.62	14.19	10.83	11.11	11.99	12.26	13.83
	8H	11.43	11.67	12.59	12.81	14.42	11.05	11.30	12.22	12.44	14.05

END OF REPORT