

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924848

Luminaire Tested: DFN2DIP-PN3F0-050D080US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924848
REPORT IS A COMBINATION OF REPORTS P899585 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-050D080US950-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11476.6 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 106.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFLL

Luminous Intensity Polar Plot

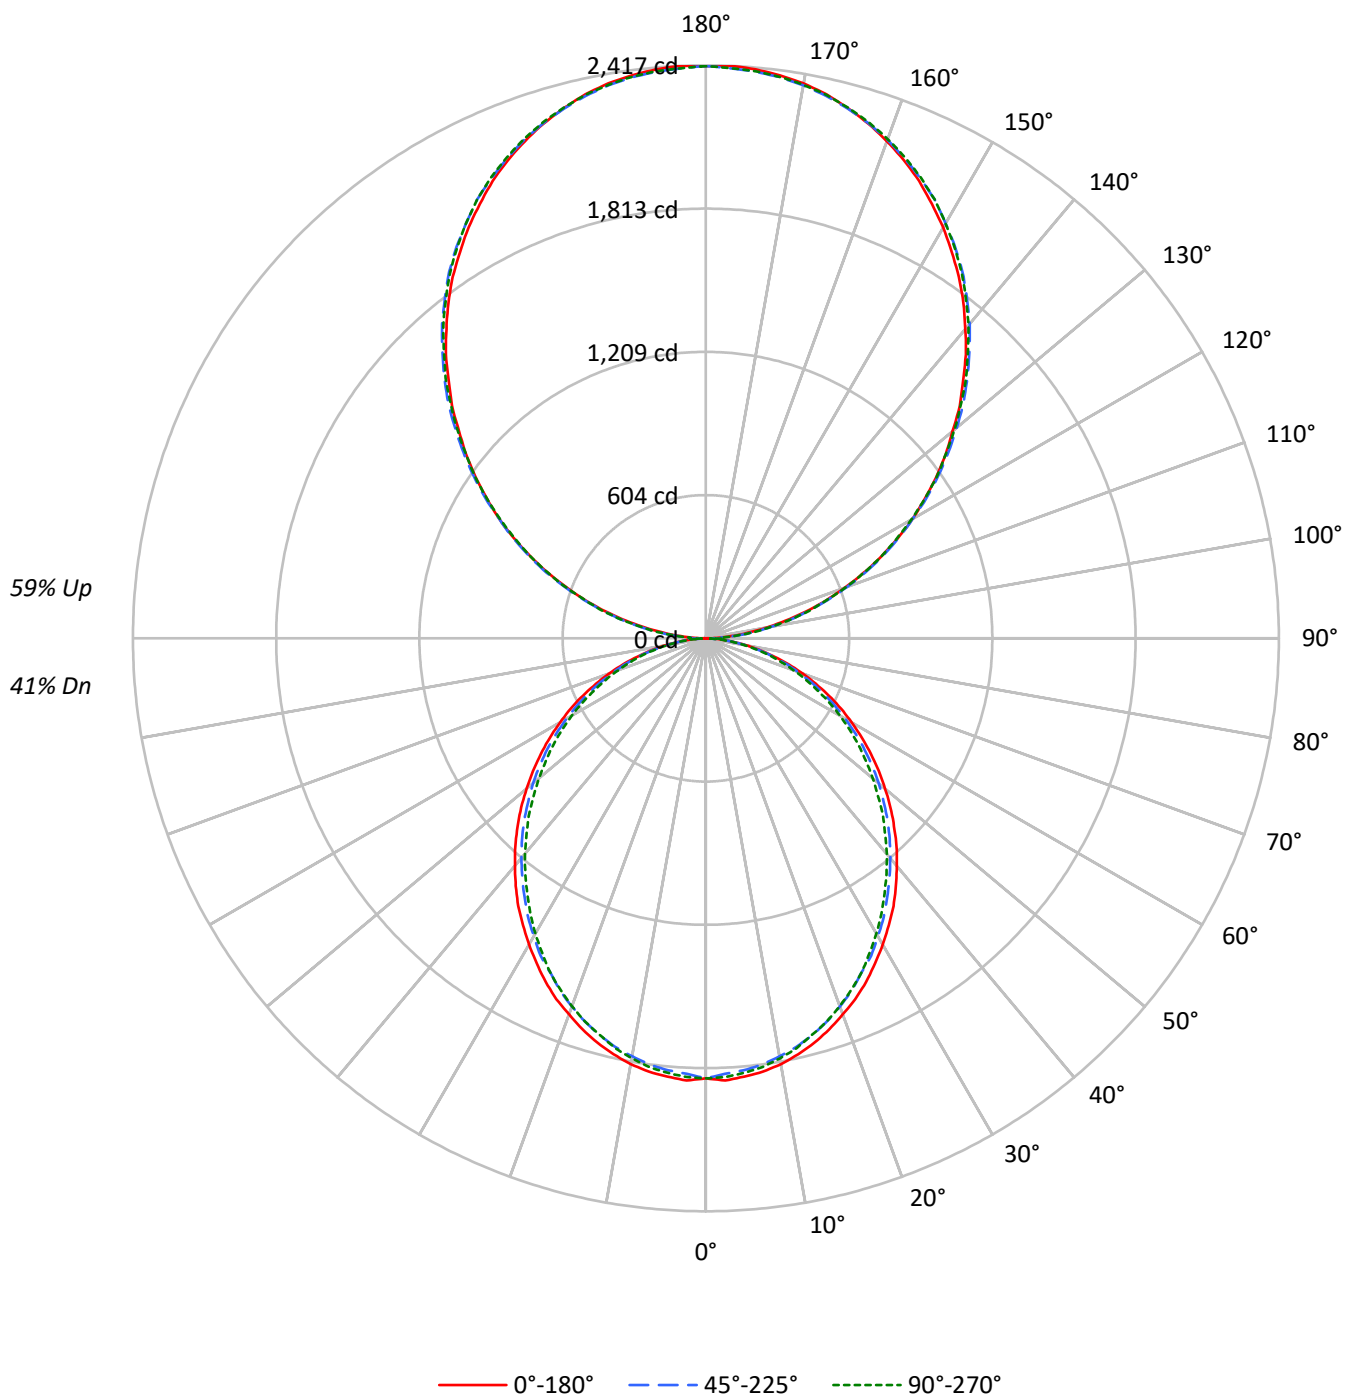

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	84	87	84	80	77	69	66	64	55	53	52	42	41	41
2	87	80	74	69	79	73	68	63	60	56	53	48	46	43	37	36	34
3	80	70	63	57	72	64	58	53	53	48	45	43	39	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	30	27	25
5	67	55	47	41	61	51	44	38	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	38	33	38	33	29	31	27	24	24	21	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	40	33	28	48	37	31	26	31	26	22	26	22	19	20	17	15
9	49	37	30	25	45	34	27	23	29	23	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2170	2170	2170
5°	2172	2138	2153
10°	2153	2108	2123
15°	2120	2071	2076
20°	2076	2022	2029
25°	2032	1962	1974
30°	1977	1907	1905
35°	1925	1842	1831
40°	1862	1777	1761
45°	1798	1711	1690
50°	1729	1642	1607
55°	1656	1562	1530
60°	1573	1467	1443
65°	1483	1369	1340
70°	1368	1249	1228
75°	1209	1105	1124
80°	1017	922	928
85°	717	609	605

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2394 cd/sqm

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.7	1.5
10°-20°	491.5	4.3
20°-30°	722.3	6.3
30°-40°	838.9	7.3
40°-50°	837.9	7.3
50°-60°	730.6	6.4
60°-70°	540.1	4.7
70°-80°	305.6	2.7
80°-90°	87.5	0.8
90°-100°	149.4	1.3
100°-110°	474.6	4.1
110°-120°	812.1	7.1
120°-130°	1068.1	9.3
130°-140°	1198.9	10.4
140°-150°	1175.6	10.2
150°-160°	986.2	8.6
160°-170°	654.0	5.7
170°-180°	228.6	2.0
0°-30°	1388.5	12.1
0°-40°	2227.5	19.4
0°-60°	3796.0	33.1
0°-90°	4729.1	41.2
90°-120°	1436.1	12.5
90°-150°	4878.6	42.5
90°-180°	6747.0	58.8
0°-180°	11476.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1856	1856	1856	1856	1856	
5°	1856	1849	1829	1844	1840	176
15°	1767	1756	1733	1740	1731	498
25°	1599	1585	1554	1558	1554	736
35°	1380	1362	1333	1322	1314	862
45°	1123	1110	1083	1064	1057	866
55°	850	839	817	796	787	760
65°	573	562	544	528	519	567
75°	300	296	287	277	280	320
85°	73	71	70	64	62	82
90°	2	26	71	67	69	11
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1856.0	1856.0	1856.0	1856.0	1856.0
2.5°	1866.8	1857.9	1838.3	1856.0	1852.7
5°	1856.0	1849.0	1829.3	1843.5	1840.2
7.5°	1843.5	1832.9	1813.3	1827.7	1824.0
10°	1824.0	1811.6	1790.2	1804.3	1799.1
12.5°	1797.1	1786.6	1765.2	1774.1	1770.4
15°	1766.8	1756.2	1732.9	1740.2	1731.2
17.5°	1729.3	1718.7	1695.4	1704.3	1695.4
20°	1688.3	1677.7	1652.7	1658.0	1651.0
22.5°	1647.4	1631.2	1608.0	1608.0	1604.3
25°	1599.1	1584.9	1554.5	1558.0	1554.5
27.5°	1545.5	1533.0	1509.9	1504.6	1495.7
30°	1492.1	1477.7	1451.0	1445.7	1438.5
32.5°	1434.9	1424.3	1395.7	1384.9	1377.8
35°	1379.6	1361.8	1333.2	1322.4	1313.6
37.5°	1317.1	1301.1	1272.4	1259.9	1251.1
40°	1253.0	1238.6	1210.0	1194.0	1186.9
42.5°	1190.5	1176.1	1147.7	1129.6	1119.0
45°	1122.7	1110.2	1083.3	1063.8	1056.6
47.5°	1056.6	1044.1	1015.5	995.8	985.2
50°	986.9	978.0	953.0	928.1	919.1
52.5°	919.1	906.6	883.5	863.8	851.3
55°	849.6	838.9	817.4	796.0	787.1
57.5°	779.9	771.0	747.7	726.4	719.1
60°	710.3	703.3	678.3	658.5	653.3
62.5°	642.5	630.0	612.2	594.3	587.2
65°	573.0	562.2	544.4	528.3	519.4
67.5°	501.6	492.6	476.6	464.1	456.9
70°	435.5	428.3	412.2	399.7	392.8
72.5°	367.8	360.5	351.6	339.1	333.8
75°	299.7	296.3	287.2	276.7	280.3
77.5°	239.2	231.9	228.4	223.0	217.8
80°	178.6	176.7	173.1	167.8	164.2
82.5°	121.3	121.3	119.6	112.5	112.5
85°	73.1	71.4	69.6	64.2	62.5
87.5°	32.1	28.6	25.0	19.7	17.8
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P924848

CATALOG NUMBER: DFN2DIP-PN3F0-050D080US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.05	9.84	10.08	10.87	12.27	8.61	9.40	9.64	10.44	11.83
	3H	10.70	11.41	11.74	12.45	13.86	10.22	10.92	11.26	11.97	13.38
	4H	11.28	11.95	12.33	13.00	14.41	10.79	11.46	11.85	12.51	13.93
	6H	11.67	12.29	12.73	13.34	14.77	11.18	11.80	12.24	12.85	14.28
	8H	11.77	12.36	12.84	13.43	14.85	11.28	11.87	12.35	12.94	14.36
	12H	11.81	12.37	12.89	13.43	14.88	11.32	11.88	12.39	12.94	14.39
4H	2H	9.50	10.17	10.56	11.22	12.63	9.15	9.82	10.21	10.87	12.28
	3H	11.35	11.91	12.42	12.99	14.42	10.95	11.51	12.02	12.58	14.01
	4H	12.06	12.57	13.13	13.64	15.09	11.64	12.15	12.71	13.22	14.67
	6H	12.56	13.00	13.64	14.09	15.54	12.14	12.58	13.22	13.67	15.12
	8H	12.71	13.12	13.79	14.20	15.66	12.28	12.69	13.36	13.77	15.24
	12H	12.77	13.15	13.87	14.24	15.71	12.34	12.71	13.44	13.80	15.27
8H	4H	12.24	12.65	13.32	13.74	15.20	11.87	12.29	12.95	13.37	14.83
	6H	12.86	13.20	13.97	14.33	15.79	12.49	12.83	13.59	13.95	15.41
	8H	13.08	13.38	14.19	14.48	15.96	12.70	13.00	13.81	14.10	15.58
	12H	13.20	13.47	14.32	14.57	16.09	12.81	13.07	13.92	14.17	15.69
12H	4H	12.23	12.60	13.32	13.69	15.16	11.86	12.24	12.96	13.33	14.80
	6H	12.89	13.19	14.00	14.30	15.78	12.53	12.83	13.64	13.93	15.41
	8H	13.13	13.39	14.24	14.49	16.01	12.76	13.02	13.87	14.12	15.64

END OF REPORT