

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924941

Luminaire Tested: DFN2DIP-PN3F0-090D030US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924941
REPORT IS A COMBINATION OF REPORTS P901043 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D030US950-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11333.6 lumens
Efficiency: N/A
Efficacy: 97.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 116.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

Luminous Intensity Polar Plot

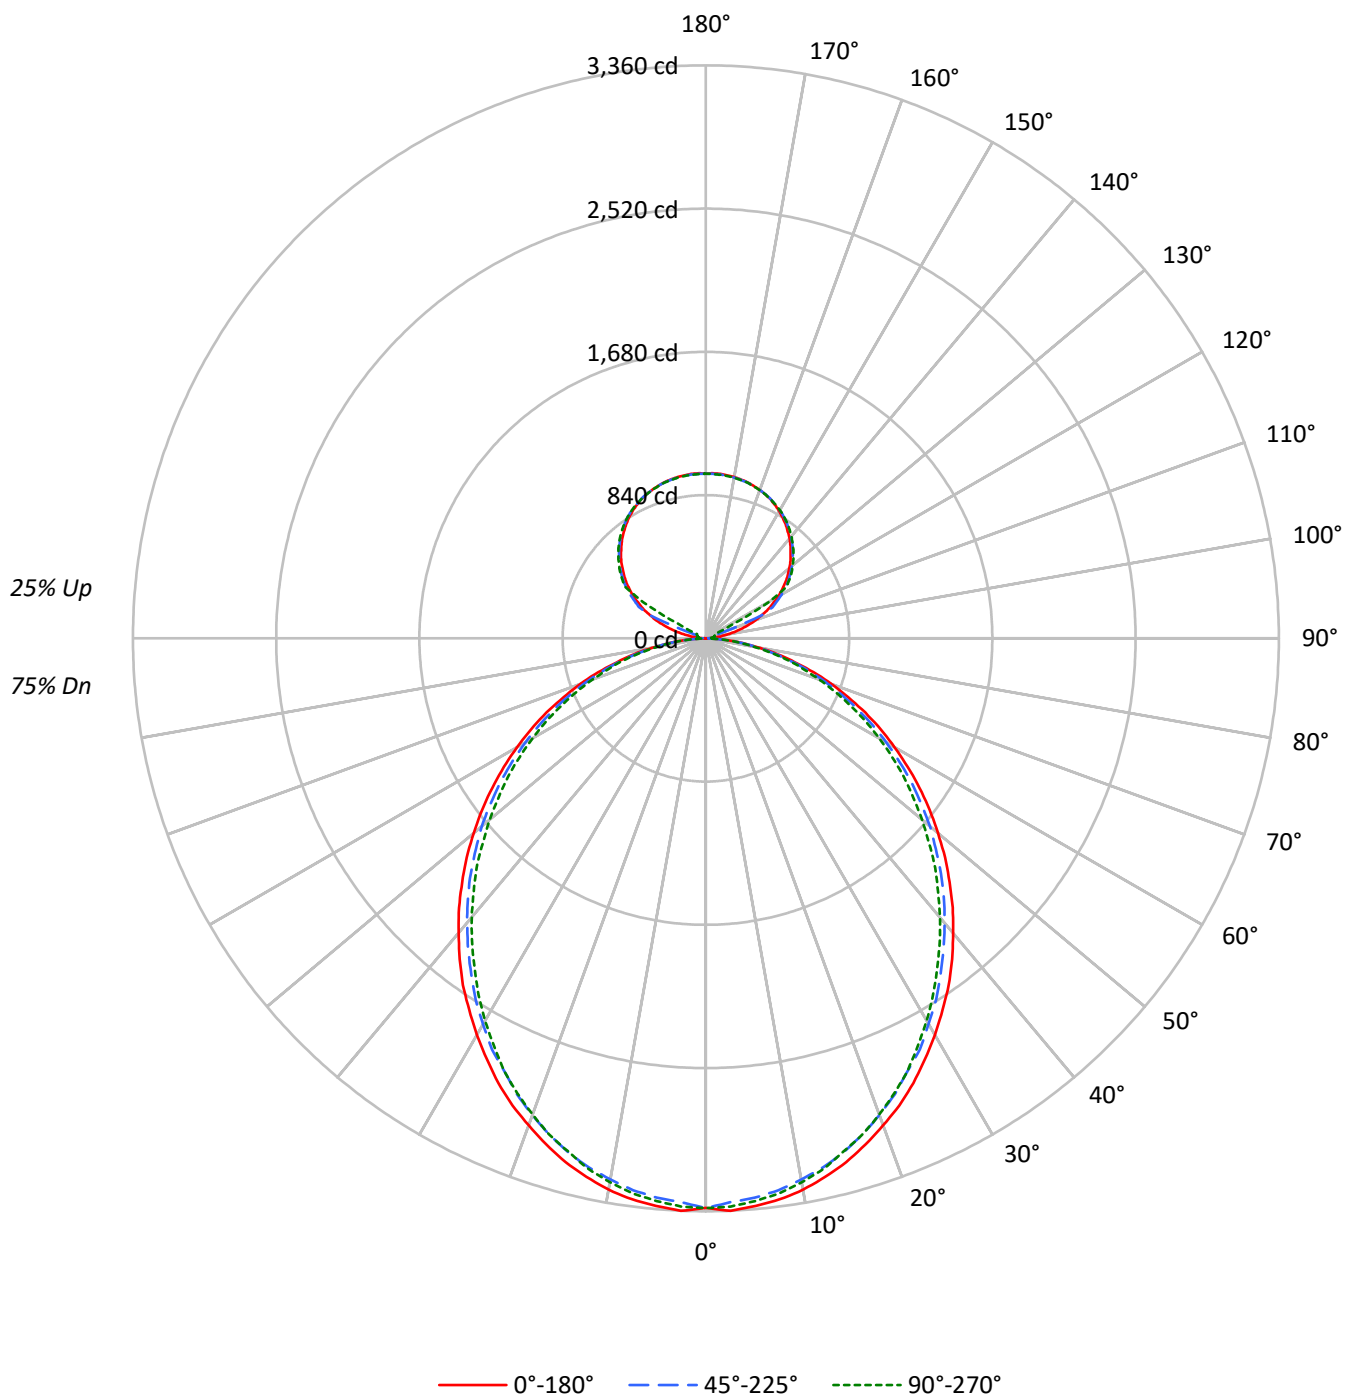

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	46	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	37	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3905	3905	3905
5°	3909	3848	3875
10°	3875	3794	3821
15°	3816	3728	3737
20°	3737	3639	3652
25°	3658	3533	3553
30°	3559	3433	3428
35°	3466	3316	3296
40°	3351	3198	3170
45°	3237	3080	3041
50°	3111	2955	2892
55°	2980	2812	2755
60°	2831	2641	2597
65°	2669	2464	2411
70°	2462	2248	2211
75°	2176	1989	2023
80°	1830	1658	1669
85°	1291	1098	1088

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3237 cd/sqm

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	2.8
10°-20°	884.7	7.8
20°-30°	1300.2	11.5
30°-40°	1510.1	13.3
40°-50°	1508.2	13.3
50°-60°	1315.1	11.6
60°-70°	972.2	8.6
70°-80°	550.0	4.9
80°-90°	146.9	1.3
90°-100°	31.9	0.3
100°-110°	118.7	1.0
110°-120°	314.9	2.8
120°-130°	522.3	4.6
130°-140°	554.8	4.9
140°-150°	515.6	4.5
150°-160°	414.5	3.7
160°-170°	267.1	2.4
170°-180°	91.9	0.8
0°-30°	2499.3	22.1
0°-40°	4009.4	35.4
0°-60°	6832.8	60.3
0°-90°	8501.9	75.0
90°-120°	465.5	4.1
90°-150°	2058.1	18.2
90°-180°	2832.0	25.0
0°-180°	11333.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	1	8	14	18	19	11
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P924941

CATALOG NUMBER: DFN2DIP-PN3F0-090D030US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.01	15.16	14.72	15.88	16.75	13.57	14.72	14.28	15.44	16.31
	3H	15.69	16.72	16.41	17.45	18.35	15.21	16.23	15.93	16.97	17.87
	4H	16.28	17.25	17.02	18.00	18.91	15.80	16.77	16.54	17.52	18.42
	6H	16.69	17.59	17.45	18.35	19.27	16.20	17.10	16.96	17.86	18.78
	8H	16.80	17.66	17.57	18.43	19.36	16.31	17.17	17.08	17.94	18.87
	12H	16.86	17.67	17.63	18.44	19.39	16.36	17.18	17.13	17.95	18.90
4H	2H	14.50	15.47	15.25	16.22	17.13	14.15	15.12	14.90	15.87	16.78
	3H	16.39	17.20	17.14	17.98	18.91	15.99	16.80	16.74	17.58	18.50
	4H	17.11	17.84	17.88	18.63	19.58	16.69	17.43	17.46	18.21	19.17
	6H	17.63	18.27	18.42	19.08	20.04	17.21	17.85	18.00	18.66	19.62
	8H	17.79	18.38	18.58	19.19	20.16	17.36	17.96	18.15	18.76	19.73
	12H	17.87	18.41	18.68	19.23	20.21	17.43	17.97	18.25	18.80	19.77
8H	4H	17.32	17.92	18.12	18.72	19.70	16.95	17.55	17.75	18.35	19.33
	6H	17.96	18.45	18.78	19.30	20.27	17.58	18.08	18.41	18.92	19.90
	8H	18.18	18.62	19.01	19.46	20.45	17.80	18.23	18.63	19.08	20.07
	12H	18.32	18.71	19.16	19.54	20.59	17.92	18.31	18.76	19.14	20.19
12H	4H	17.32	17.86	18.14	18.69	19.66	16.96	17.50	17.77	18.32	19.30
	6H	17.99	18.43	18.82	19.27	20.26	17.63	18.07	18.46	18.91	19.90
	8H	18.24	18.63	19.08	19.46	20.51	17.87	18.26	18.71	19.09	20.14