

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924965

Luminaire Tested: DFN2DIP-PN3F0-090D090US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924965
REPORT IS A COMBINATION OF REPORTS P901127 AND P897955
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-090D090US950-FLLONL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17000.3 lumens
Efficiency: N/A
Efficacy: 103.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 164.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

Luminous Intensity Polar Plot

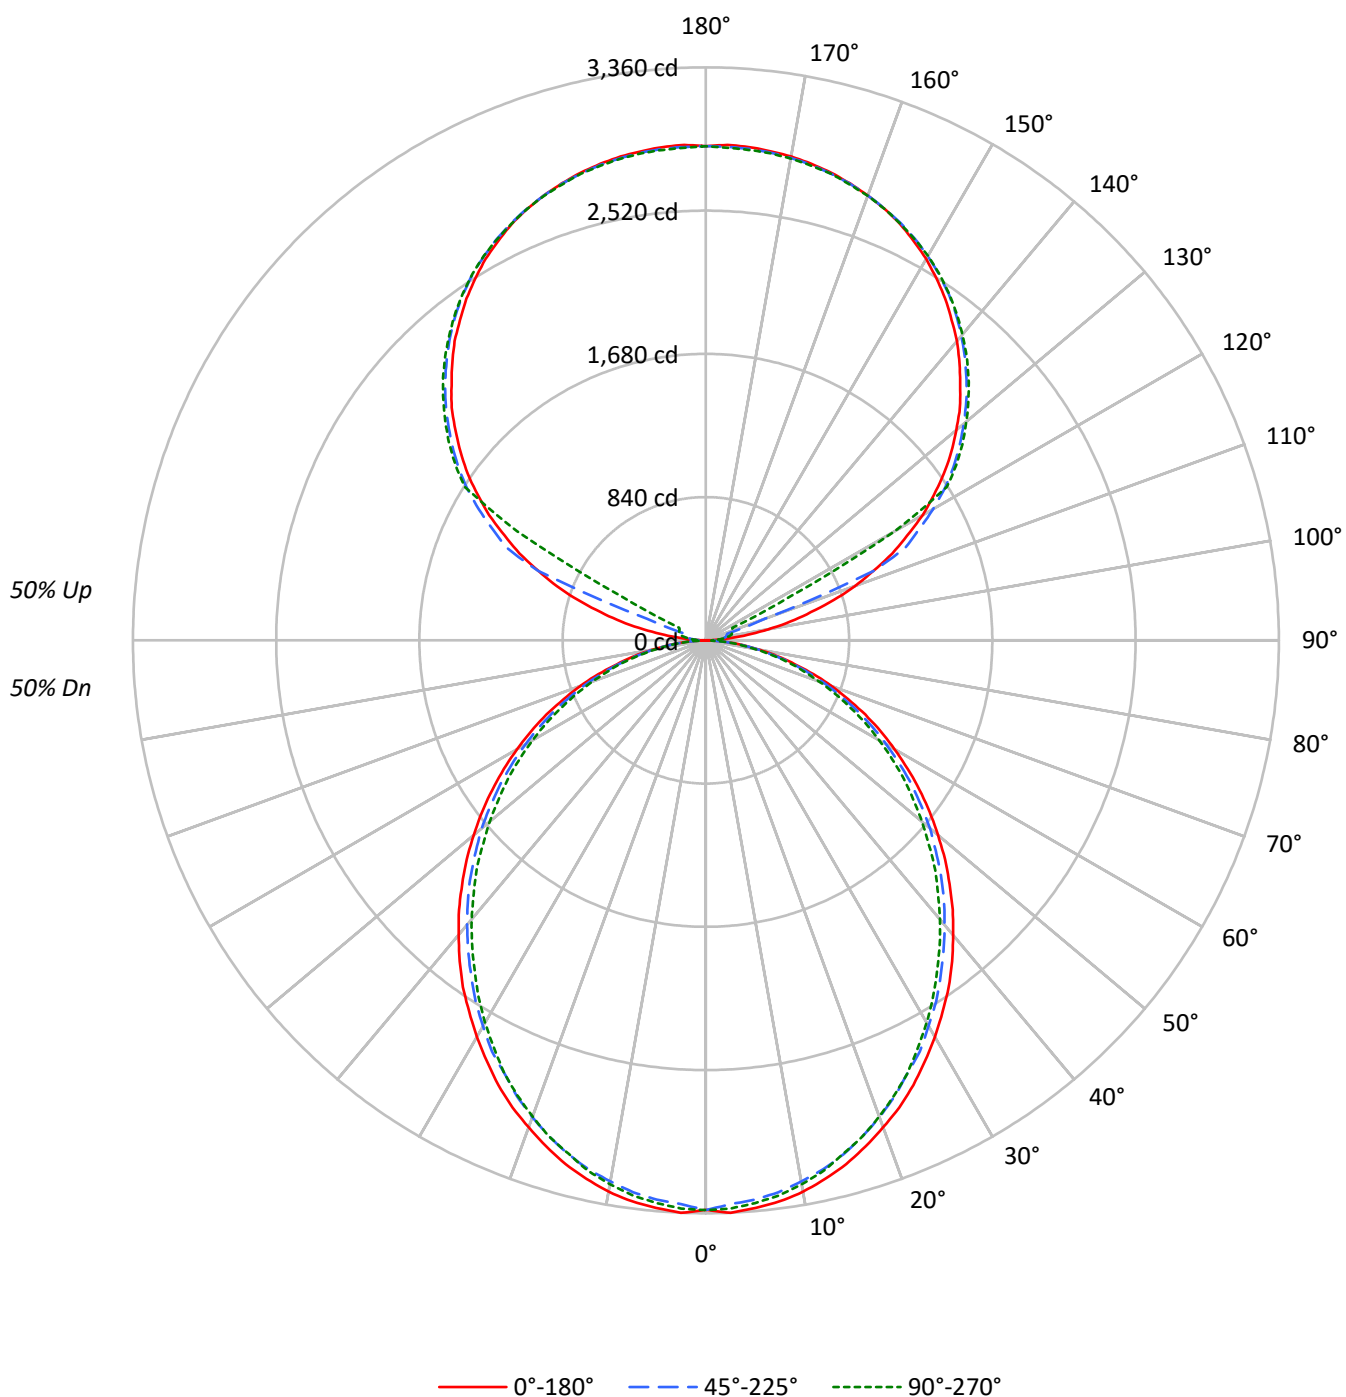

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3905	3905	3905
5°	3909	3848	3875
10°	3875	3794	3821
15°	3816	3728	3737
20°	3737	3639	3652
25°	3658	3533	3553
30°	3559	3433	3428
35°	3466	3316	3296
40°	3351	3198	3170
45°	3237	3080	3041
50°	3111	2955	2892
55°	2980	2812	2755
60°	2831	2641	2597
65°	2669	2464	2411
70°	2462	2248	2211
75°	2176	1989	2023
80°	1830	1658	1669
85°	1291	1098	1088

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3237 cd/sqm

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	1.8
10°-20°	884.7	5.2
20°-30°	1300.2	7.6
30°-40°	1510.1	8.9
40°-50°	1508.2	8.9
50°-60°	1315.1	7.7
60°-70°	972.2	5.7
70°-80°	550.0	3.2
80°-90°	150.3	0.9
90°-100°	95.6	0.6
100°-110°	356.2	2.1
110°-120°	944.7	5.6
120°-130°	1566.8	9.2
130°-140°	1664.3	9.8
140°-150°	1546.8	9.1
150°-160°	1243.6	7.3
160°-170°	801.3	4.7
170°-180°	275.8	1.6
0°-30°	2499.3	14.7
0°-40°	4009.4	23.6
0°-60°	6832.8	40.2
0°-90°	8505.3	50.0
90°-120°	1396.4	8.2
90°-150°	6174.3	36.3
90°-180°	8495.0	50.0
0°-180°	17000.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	2	25	42	53	56	16
95°	136	67	82	92	90	161
105°	637	700	128	151	159	681
115°	1206	1241	1294	323	172	1187
125°	1704	1732	1772	1786	1793	1520
135°	2109	2143	2162	2183	2179	1629
145°	2447	2445	2480	2495	2485	1530
155°	2694	2676	2701	2713	2696	1242
165°	2839	2826	2833	2847	2833	802
175°	2904	2889	2894	2908	2887	276
180°	2898	2898	2898	2898	2898	

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	2.0	25.2	41.8	52.6	56.5
92.5°	52.6	44.1	50.3	54.6	56.5
95°	136.2	67.0	81.7	92.3	90.2
97.5°	245.3	73.5	106.8	113.2	115.2
100°	371.2	84.0	119.5	136.2	140.4
102.5°	509.4	505.4	123.7	146.6	153.1
105°	637.4	700.4	127.9	150.9	159.3
107.5°	786.3	838.6	132.2	155.1	163.6
110°	928.9	972.8	367.0	157.3	165.6

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1063.1	1100.7	1065.1	161.3	167.8
115°	1205.6	1241.2	1293.7	322.9	172.0
117.5°	1329.3	1371.2	1407.0	1107.0	557.7
120°	1467.7	1499.1	1537.0	1562.1	1279.0
122.5°	1585.1	1618.7	1660.7	1673.1	1675.4
125°	1704.5	1731.9	1771.8	1786.5	1792.7
127.5°	1813.6	1842.9	1874.6	1895.5	1897.5
130°	1916.4	1950.1	1973.0	1996.1	1994.1
132.5°	2021.2	2048.6	2071.5	2090.5	2088.5
135°	2109.4	2143.0	2161.7	2182.8	2178.6
137.5°	2201.5	2226.6	2247.8	2268.7	2262.5
140°	2291.6	2308.6	2331.5	2350.4	2340.0
142.5°	2367.4	2382.0	2409.1	2425.8	2415.4
145°	2447.0	2444.7	2480.4	2495.1	2484.6
147.5°	2516.0	2509.8	2545.4	2555.9	2547.6
150°	2583.2	2568.5	2602.1	2614.5	2604.1
152.5°	2639.7	2623.0	2654.4	2667.1	2652.4
155°	2694.3	2675.6	2700.7	2713.2	2696.5
157.5°	2738.4	2721.7	2740.6	2755.2	2738.4
160°	2776.1	2763.5	2776.1	2788.6	2773.9
162.5°	2809.5	2797.0	2807.5	2822.2	2803.3
165°	2838.9	2826.4	2832.7	2847.4	2832.7
167.5°	2862.1	2849.4	2855.8	2870.5	2851.6
170°	2881.0	2868.3	2872.5	2887.2	2868.3
172.5°	2893.5	2881.0	2885.2	2899.9	2881.0
175°	2903.9	2889.2	2893.5	2908.1	2887.2
177.5°	2908.1	2893.5	2895.7	2910.4	2891.5
180°	2897.7	2897.7	2897.7	2897.7	2897.7

TEST NUMBER: P924965

CATALOG NUMBER: DFN2DIP-PN3F0-090D090US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.97	12.83	12.93	13.80	15.07	11.53	12.39	12.49	13.36	14.64
	3H	13.62	14.40	14.59	15.38	16.67	13.14	13.91	14.11	14.90	16.19
	4H	14.21	14.94	15.19	15.92	17.23	13.72	14.45	14.70	15.44	16.74
	6H	14.60	15.28	15.60	16.27	17.58	14.11	14.79	15.11	15.78	17.09
	8H	14.71	15.35	15.70	16.35	17.67	14.21	14.86	15.21	15.86	17.17
	12H	14.75	15.36	15.76	16.36	17.70	14.25	14.86	15.26	15.87	17.20
4H	2H	12.43	13.16	13.41	14.14	15.45	12.08	12.81	13.06	13.79	15.09
	3H	14.29	14.90	15.28	15.91	17.23	13.88	14.49	14.88	15.51	16.82
	4H	15.00	15.55	16.00	16.56	17.90	14.58	15.14	15.58	16.14	17.48
	6H	15.50	15.99	16.52	17.02	18.35	15.08	15.56	16.10	16.59	17.93
	8H	15.65	16.10	16.67	17.12	18.48	15.22	15.67	16.24	16.70	18.05
	12H	15.72	16.13	16.76	17.17	18.52	15.28	15.69	16.32	16.73	18.09
8H	4H	15.19	15.64	16.21	16.66	18.01	14.82	15.27	15.84	16.29	17.64
	6H	15.81	16.18	16.85	17.25	18.60	15.44	15.81	16.48	16.87	18.22
	8H	16.03	16.36	17.08	17.41	18.77	15.65	15.97	16.70	17.02	18.39
	12H	16.16	16.44	17.21	17.49	18.90	15.76	16.04	16.81	17.09	18.50
12H	4H	15.17	15.58	16.21	16.62	17.97	14.81	15.22	15.85	16.26	17.61
	6H	15.84	16.17	16.89	17.22	18.59	15.48	15.80	16.53	16.85	18.22
	8H	16.08	16.36	17.13	17.41	18.82	15.71	15.99	16.76	17.04	18.45