

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903185

Luminaire Tested: DFN2DIP-PN4F0-050D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903185
REPORT IS A COMBINATION OF REPORTS P901149 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-050D050US830-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 114.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLLONL

Luminous Intensity Polar Plot

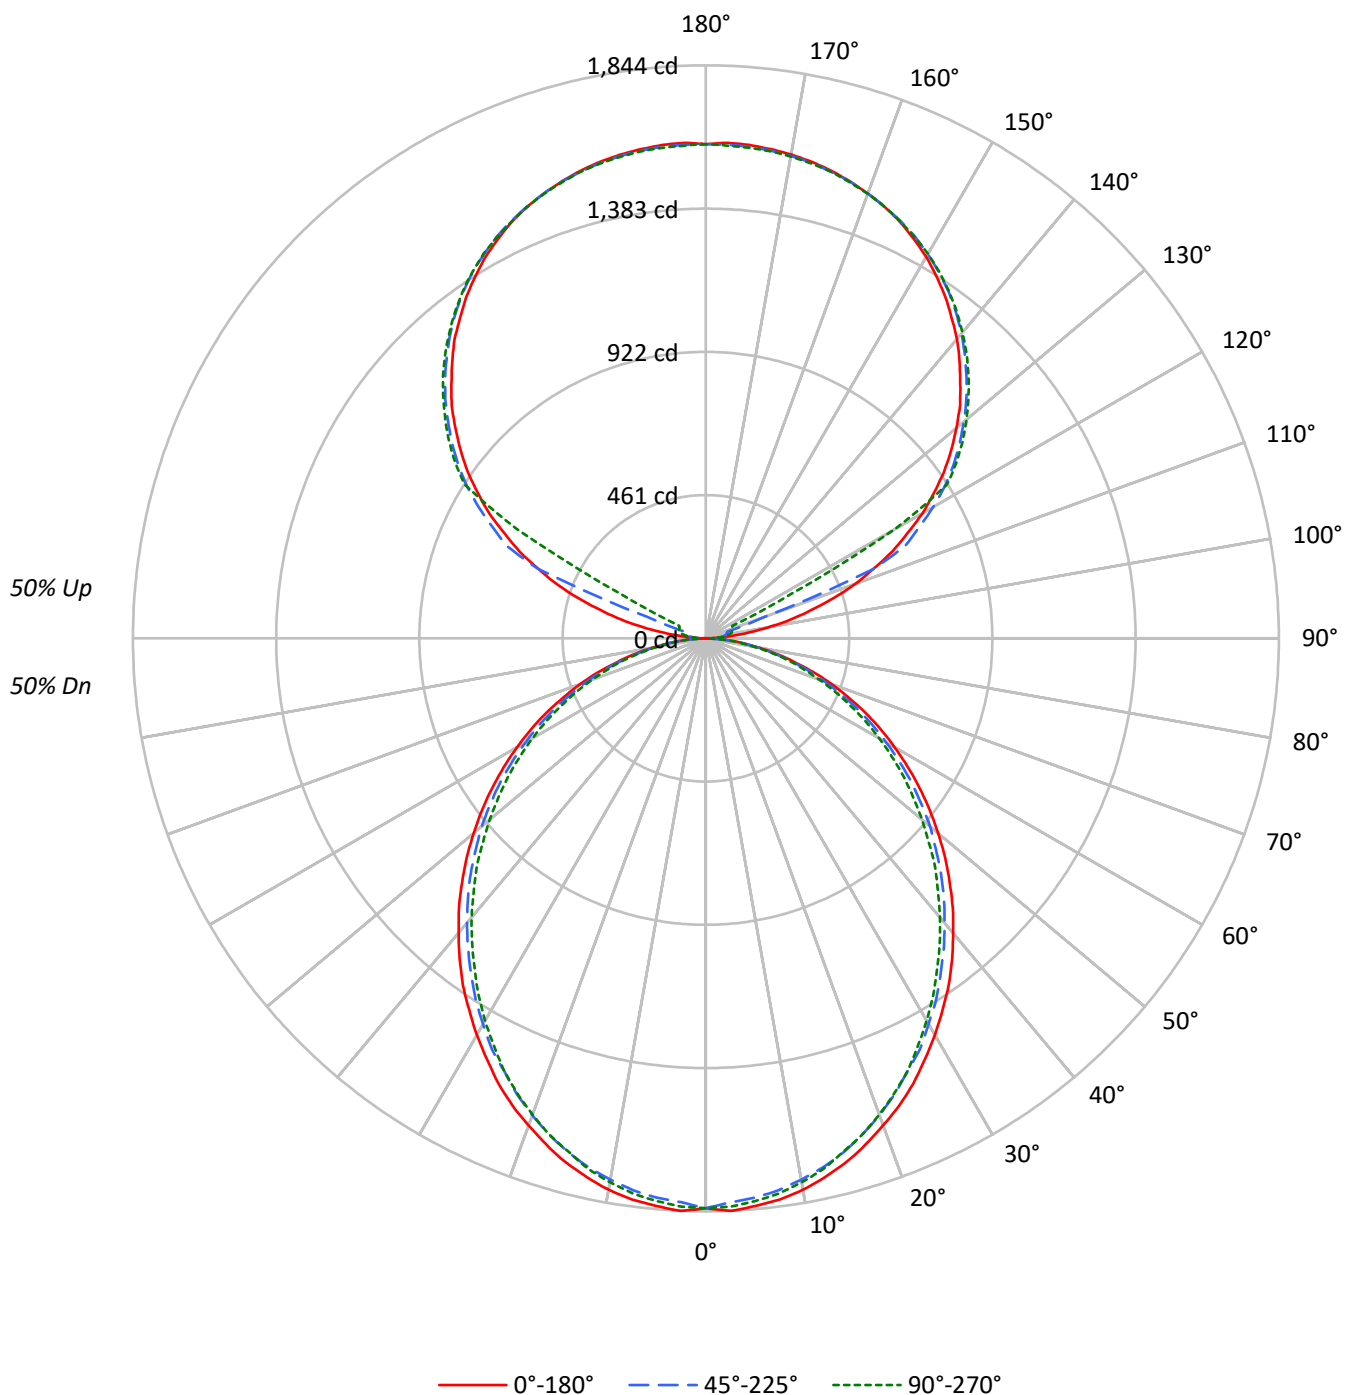

TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1339	1339	1339
5°	1341	1320	1329
10°	1330	1303	1311
15°	1310	1281	1283
20°	1284	1252	1255
25°	1258	1216	1222
30°	1225	1183	1180
35°	1193	1144	1135
40°	1155	1105	1093
45°	1117	1066	1050
50°	1075	1024	999
55°	1031	976	953
60°	981	920	901
65°	927	861	838
70°	858	789	771
75°	763	704	710
80°	648	595	592
85°	469	405	396

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1117 cd/sqm

TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.8
10°-20°	485.6	5.2
20°-30°	713.7	7.6
30°-40°	828.9	8.9
40°-50°	827.8	8.9
50°-60°	721.8	7.7
60°-70°	533.6	5.7
70°-80°	301.9	3.2
80°-90°	82.5	0.9
90°-100°	52.5	0.6
100°-110°	195.5	2.1
110°-120°	518.5	5.6
120°-130°	860.0	9.2
130°-140°	913.5	9.8
140°-150°	849.0	9.1
150°-160°	682.6	7.3
160°-170°	439.8	4.7
170°-180°	151.4	1.6
0°-30°	1371.9	14.7
0°-40°	2200.7	23.6
0°-60°	3750.4	40.2
0°-90°	4668.4	50.0
90°-120°	766.5	8.2
90°-150°	3389.0	36.3
90°-180°	4663.0	50.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903185

CATALOG NUMBER: DFN2DIP-PN4F0-050D050US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.16	9.25	10.13	11.40	7.86	8.72	8.81	9.69	10.96
	3H	9.96	10.73	10.93	11.71	13.01	9.47	10.25	10.44	11.23	12.52
	4H	10.55	11.28	11.53	12.26	13.57	10.06	10.79	11.04	11.78	13.08
	6H	10.95	11.62	11.94	12.61	13.93	10.46	11.13	11.45	12.12	13.44
	8H	11.06	11.70	12.05	12.70	14.02	10.56	11.21	11.56	12.21	13.52
	12H	11.11	11.72	12.11	12.72	14.05	10.61	11.22	11.61	12.22	13.55
4H	2H	8.76	9.49	9.74	10.47	11.77	8.41	9.14	9.39	10.12	11.42
	3H	10.63	11.24	11.62	12.25	13.57	10.22	10.83	11.22	11.85	13.16
	4H	11.34	11.90	12.35	12.91	14.25	10.92	11.48	11.93	12.49	13.83
	6H	11.86	12.34	12.88	13.37	14.71	11.44	11.92	12.45	12.95	14.28
	8H	12.01	12.46	13.03	13.48	14.84	11.58	12.03	12.60	13.06	14.41
	12H	12.09	12.49	13.12	13.53	14.89	11.65	12.05	12.68	13.09	14.45
8H	4H	11.54	11.99	12.56	13.01	14.36	11.17	11.62	12.19	12.64	13.99
	6H	12.17	12.55	13.22	13.61	14.96	11.80	12.17	12.84	13.23	14.58
	8H	12.40	12.72	13.45	13.77	15.14	12.01	12.34	13.06	13.39	14.76
	12H	12.53	12.82	13.58	13.86	15.27	12.13	12.42	13.18	13.46	14.87
12H	4H	11.53	11.93	12.56	12.97	14.33	11.16	11.57	12.20	12.61	13.96
	6H	12.20	12.53	13.25	13.58	14.95	11.84	12.17	12.89	13.22	14.59
	8H	12.45	12.74	13.50	13.78	15.19	12.08	12.36	13.13	13.41	14.82

END OF REPORT