

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903221

Luminaire Tested: DFN2DIP-PN4F0-060D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903221
REPORT IS A COMBINATION OF REPORTS P901151 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D050US830-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 111.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

Luminous Intensity Polar Plot

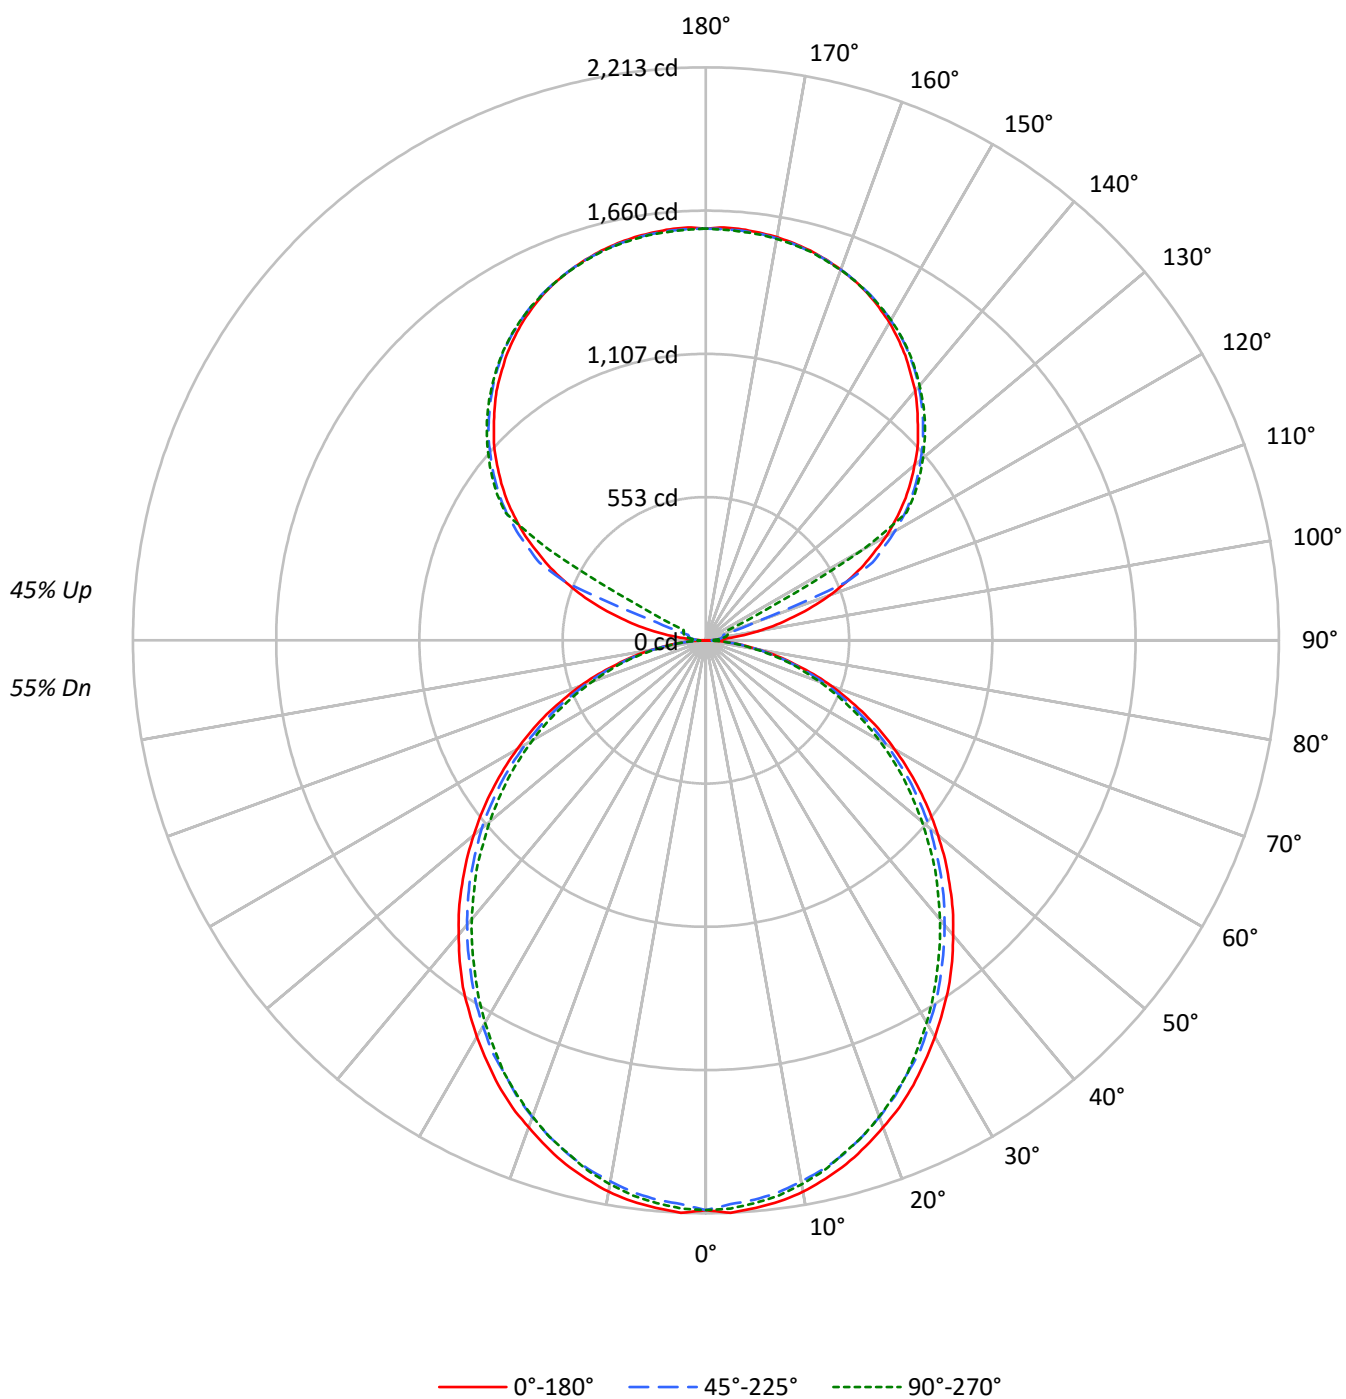

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1606	1606	1606
5°	1609	1584	1595
10°	1596	1563	1574
15°	1572	1538	1540
20°	1541	1502	1506
25°	1509	1459	1466
30°	1470	1420	1416
35°	1432	1373	1362
40°	1386	1326	1311
45°	1340	1279	1259
50°	1290	1229	1199
55°	1237	1172	1144
60°	1178	1104	1081
65°	1113	1033	1006
70°	1030	947	926
75°	915	844	852
80°	778	714	710
85°	562	487	475

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1340 cd/sqm

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.0
10°-20°	582.7	5.7
20°-30°	856.4	8.3
30°-40°	994.6	9.7
40°-50°	993.4	9.7
50°-60°	866.2	8.4
60°-70°	640.3	6.2
70°-80°	362.3	3.5
80°-90°	98.4	1.0
90°-100°	52.5	0.5
100°-110°	195.5	1.9
110°-120°	518.5	5.1
120°-130°	860.0	8.4
130°-140°	913.5	8.9
140°-150°	849.0	8.3
150°-160°	682.6	6.7
160°-170°	439.8	4.3
170°-180°	151.4	1.5
0°-30°	1646.2	16.0
0°-40°	2640.9	25.7
0°-60°	4500.5	43.8
0°-90°	5601.5	54.6
90°-120°	766.5	7.5
90°-150°	3389.0	33.0
90°-180°	4663.0	45.4
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903221

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.34	10.24	10.25	11.18	12.38	8.90	9.80	9.81	10.74	11.94
	3H	11.00	11.82	11.93	12.76	13.99	10.52	11.33	11.45	12.28	13.50
	4H	11.60	12.36	12.54	13.31	14.55	11.11	11.88	12.05	12.83	14.06
	6H	12.00	12.71	12.95	13.66	14.91	11.51	12.22	12.46	13.17	14.42
	8H	12.11	12.78	13.07	13.75	15.00	11.61	12.29	12.58	13.26	14.51
	12H	12.16	12.80	13.13	13.77	15.04	11.66	12.30	12.63	13.27	14.54
4H	2H	9.81	10.57	10.75	11.52	12.76	9.45	10.22	10.40	11.17	12.41
	3H	11.68	12.32	12.64	13.30	14.55	11.28	11.92	12.23	12.90	14.15
	4H	12.40	12.98	13.36	13.95	15.23	11.98	12.56	12.95	13.54	14.81
	6H	12.92	13.42	13.90	14.42	15.69	12.49	13.00	13.47	13.99	15.27
	8H	13.07	13.54	14.05	14.53	15.82	12.64	13.11	13.62	14.10	15.39
	12H	13.15	13.57	14.15	14.58	15.87	12.71	13.13	13.71	14.14	15.43
8H	4H	12.60	13.07	13.58	14.06	15.35	12.23	12.70	13.21	13.69	14.98
	6H	13.23	13.62	14.24	14.65	15.94	12.86	13.25	13.86	14.28	15.57
	8H	13.46	13.80	14.47	14.82	16.13	13.07	13.42	14.09	14.44	15.74
	12H	13.59	13.89	14.61	14.91	16.26	13.19	13.49	14.21	14.51	15.86
12H	4H	12.58	13.01	13.59	14.02	15.31	12.22	12.65	13.22	13.65	14.95
	6H	13.26	13.61	14.28	14.63	15.93	12.90	13.24	13.91	14.26	15.57
	8H	13.51	13.81	14.53	14.83	16.18	13.14	13.44	14.16	14.45	15.81