

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903222

Luminaire Tested: DFN2DIP-PN4F0-060D050US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903222
REPORT IS A COMBINATION OF REPORTS P899632 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D050US830-RLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8977.7 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLLFLL

Luminous Intensity Polar Plot

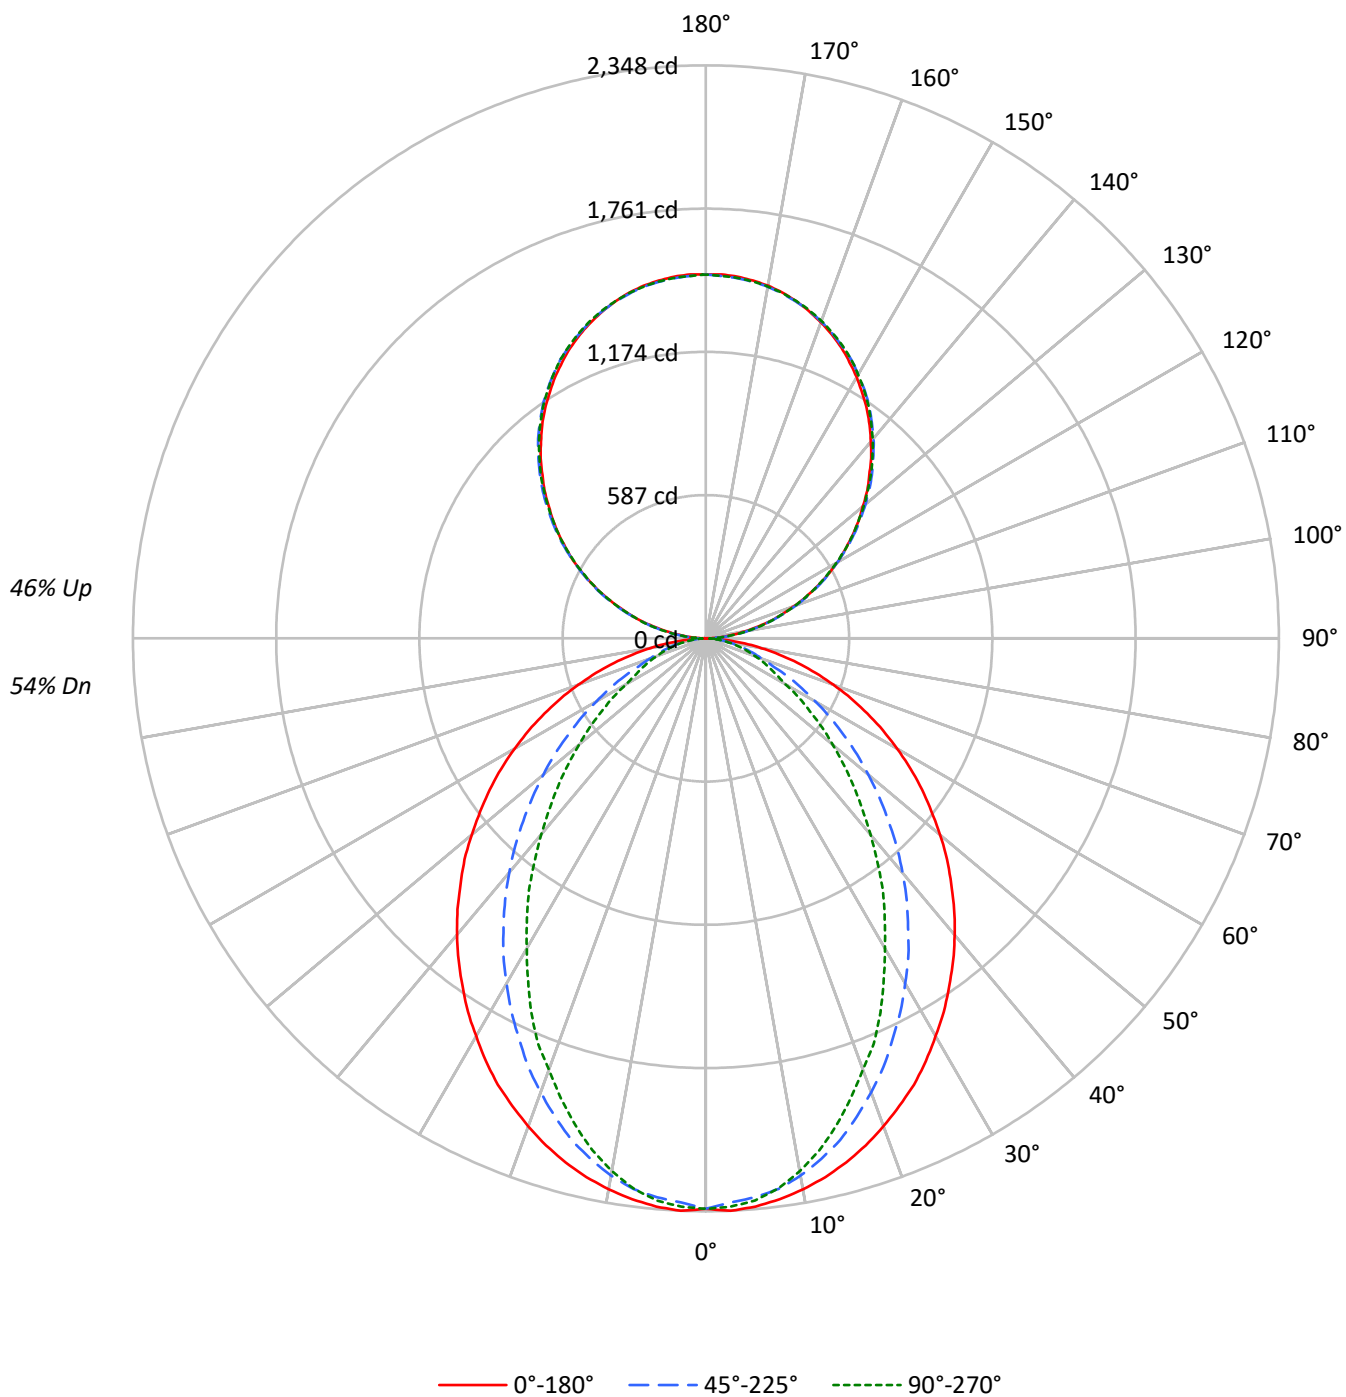

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1706	1706	1706
5°	1709	1679	1690
10°	1692	1647	1635
15°	1669	1592	1551
20°	1638	1518	1447
25°	1606	1434	1346
30°	1564	1348	1218
35°	1522	1255	1106
40°	1480	1159	978
45°	1431	1053	861
50°	1380	946	747
55°	1327	831	638
60°	1266	711	525
65°	1195	589	473
70°	1110	475	429
75°	1003	420	391
80°	847	353	340
85°	590	237	258

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1431 cd/sqm

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	2.4
10°-20°	601.3	6.7
20°-30°	844.3	9.4
30°-40°	920.3	10.3
40°-50°	845.9	9.4
50°-60°	664.3	7.4
60°-70°	432.4	4.8
70°-80°	222.6	2.5
80°-90°	61.1	0.7
90°-100°	92.2	1.0
100°-110°	293.0	3.3
110°-120°	501.5	5.6
120°-130°	659.5	7.3
130°-140°	740.3	8.2
140°-150°	725.9	8.1
150°-160°	609.0	6.8
160°-170°	403.9	4.5
170°-180°	141.2	1.6
0°-30°	1664.7	18.5
0°-40°	2585.0	28.8
0°-60°	4095.1	45.6
0°-90°	4811.2	53.6
90°-120°	886.7	9.9
90°-150°	3012.5	33.6
90°-180°	4167.0	46.4
0°-180°	8977.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	1	16	44	41	43	9
95°	66	78	80	80	78	73
105°	270	274	277	279	279	285
115°	503	510	508	507	503	498
125°	732	743	740	736	734	654
135°	947	961	963	962	958	732
145°	1149	1158	1166	1167	1162	718
155°	1314	1318	1322	1328	1324	605
165°	1430	1428	1428	1438	1431	403
175°	1488	1484	1482	1490	1483	141
180°	1490	1490	1490	1490	1490	

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	1.3	16.2	44.0	41.4	42.7
92.5°	27.9	37.7	39.1	40.4	40.4
95°	65.6	78.2	80.4	80.4	78.2
97.5°	109.1	120.8	125.8	125.8	125.8
100°	159.5	169.8	173.4	173.4	172.1
102.5°	212.5	220.2	225.1	226.5	225.1
105°	270.5	274.1	276.8	279.0	279.0
107.5°	328.0	333.4	333.4	334.3	328.0
110°	383.7	391.0	391.0	391.0	387.3

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.9	451.6	450.3	446.7	443.9
115°	503.2	510.5	508.2	506.9	503.2
117.5°	562.1	572.0	565.7	562.1	558.6
120°	621.4	631.3	621.4	621.4	617.4
122.5°	675.3	688.0	681.6	678.1	675.3
125°	732.0	743.2	739.6	735.6	734.2
127.5°	787.2	801.2	796.3	790.8	787.2
130°	839.0	855.1	852.8	850.2	845.2
132.5°	896.9	909.5	910.4	904.1	900.5
135°	946.8	960.6	963.4	962.1	958.5
137.5°	1002.5	1013.7	1016.0	1015.0	1009.7
140°	1051.4	1062.7	1068.9	1068.9	1064.0
142.5°	1101.7	1113.0	1116.6	1117.9	1113.0
145°	1149.4	1158.4	1165.5	1167.0	1162.0
147.5°	1192.1	1203.3	1208.7	1211.0	1206.0
150°	1236.1	1243.8	1248.7	1252.7	1248.7
152.5°	1275.3	1282.9	1289.1	1294.1	1289.1
155°	1314.3	1317.9	1321.9	1328.2	1324.2
157.5°	1348.0	1350.7	1352.9	1362.0	1355.7
160°	1378.1	1380.8	1382.1	1389.8	1384.4
162.5°	1406.0	1406.0	1407.3	1415.9	1409.6
165°	1429.8	1428.4	1428.4	1437.5	1431.2
167.5°	1451.3	1447.3	1447.3	1456.3	1450.0
170°	1467.5	1464.0	1462.6	1471.6	1464.0
172.5°	1478.8	1475.2	1473.9	1482.8	1475.2
175°	1487.8	1484.1	1481.5	1490.4	1482.8
177.5°	1492.7	1489.1	1486.4	1494.0	1486.4
180°	1490.4	1490.4	1490.4	1490.4	1490.4

TEST NUMBER: P903222

CATALOG NUMBER: DFN2DIP-PN4F0-060D050US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.34	10.20	10.27	11.14	12.37	5.30	6.16	6.24	7.11	8.33
	3H	11.02	11.79	11.97	12.74	13.99	6.49	7.26	7.44	8.22	9.46
	4H	11.63	12.36	12.59	13.32	14.57	6.95	7.67	7.91	8.63	9.89
	6H	12.06	12.73	13.03	13.69	14.96	7.27	7.94	8.24	8.90	10.17
	8H	12.19	12.82	13.16	13.80	15.07	7.36	8.00	8.34	8.98	10.24
	12H	12.25	12.86	13.23	13.83	15.12	7.41	8.01	8.39	8.99	10.28
4H	2H	9.36	10.09	10.32	11.05	12.30	5.90	6.63	6.87	7.59	8.84
	3H	11.20	11.80	12.17	12.79	14.06	7.26	7.86	8.23	8.85	10.12
	4H	11.89	12.44	12.87	13.42	14.72	7.81	8.36	8.79	9.34	10.63
	6H	12.41	12.88	13.41	13.89	15.18	8.23	8.70	9.22	9.71	11.00
	8H	12.59	13.03	13.58	14.03	15.33	8.36	8.80	9.36	9.80	11.11
	12H	12.69	13.09	13.70	14.10	15.41	8.43	8.83	9.44	9.84	11.15
8H	4H	11.86	12.30	12.86	13.30	14.61	8.09	8.53	9.09	9.53	10.84
	6H	12.43	12.80	13.45	13.84	15.14	8.61	8.98	9.63	10.02	11.32
	8H	12.65	12.97	13.68	14.00	15.32	8.80	9.13	9.83	10.15	11.48
	12H	12.79	13.08	13.82	14.10	15.46	8.93	9.21	9.96	10.23	11.60
12H	4H	11.81	12.21	12.83	13.23	14.54	8.10	8.50	9.11	9.51	10.82
	6H	12.41	12.73	13.44	13.76	15.08	8.66	8.98	9.69	10.01	11.33
	8H	12.63	12.91	13.66	13.94	15.30	8.88	9.16	9.91	10.18	11.55

END OF REPORT