

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903253

Luminaire Tested: DFN2DIP-PN4F0-070D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903253
REPORT IS A COMBINATION OF REPORTS P901135 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D040US830-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 105.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 97
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLLONL

Luminous Intensity Polar Plot

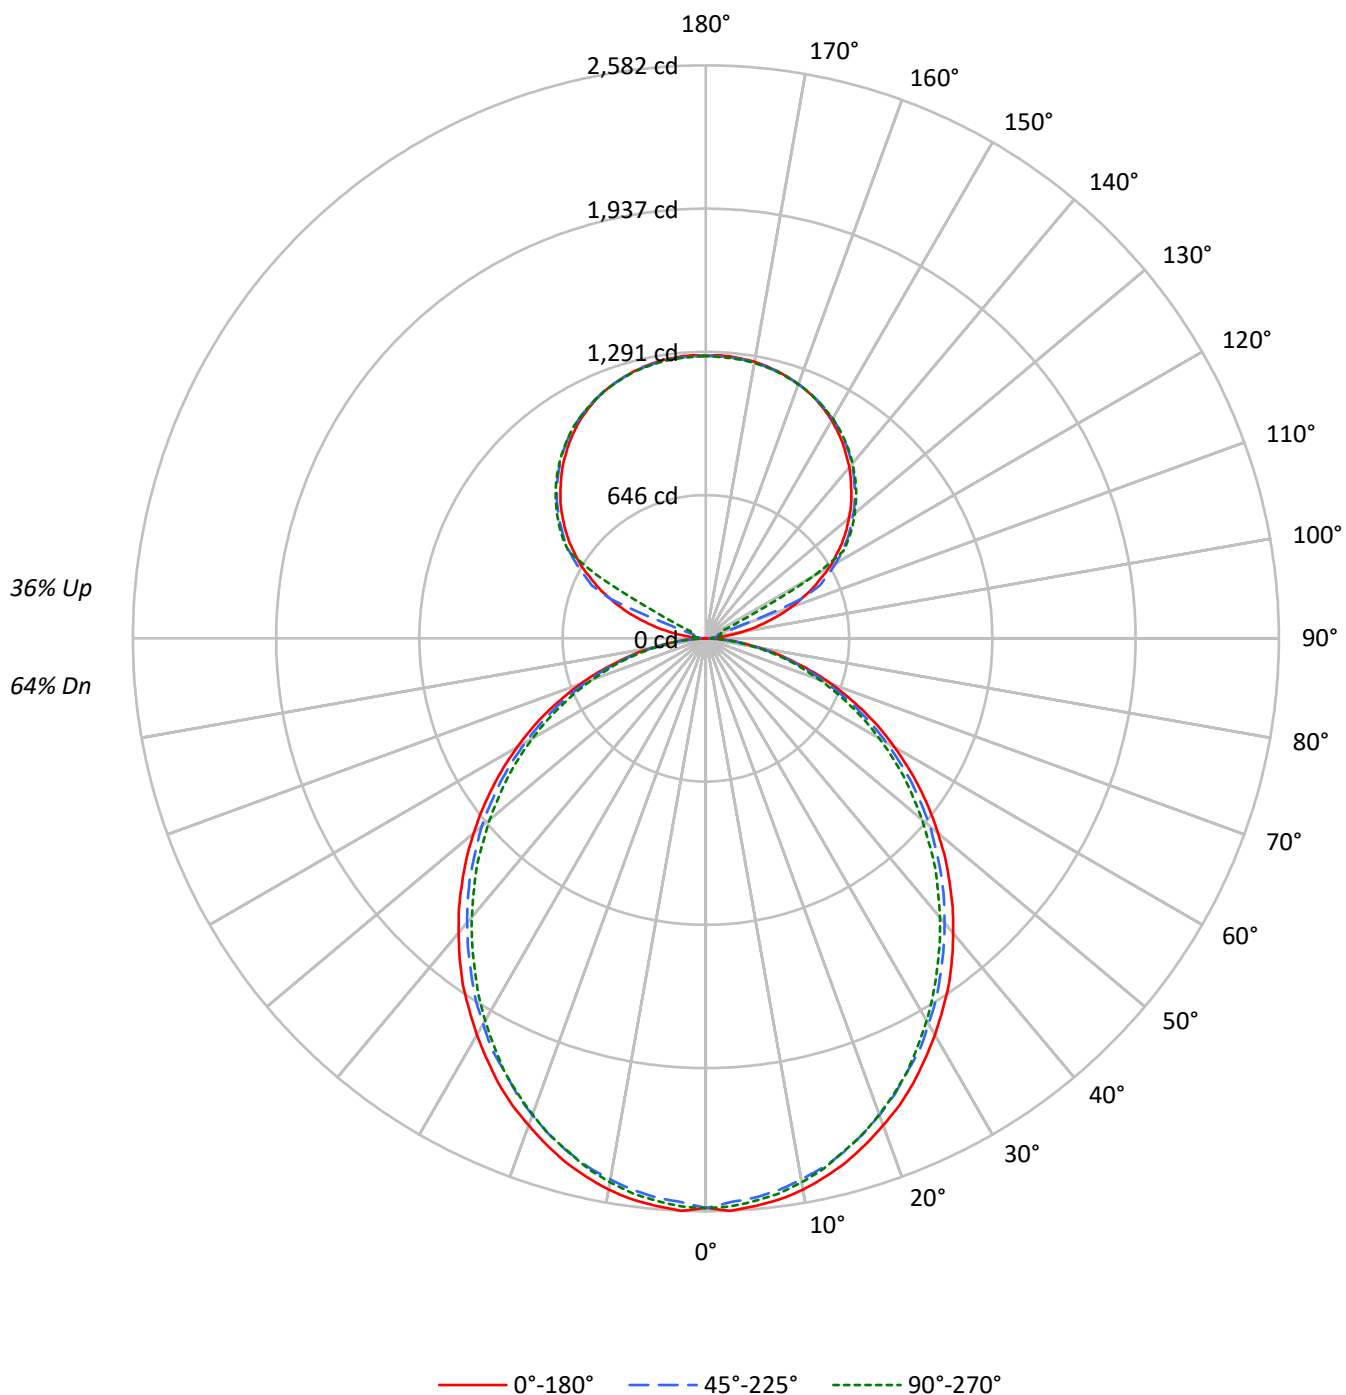

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91		79	79	79		69
1	101	96	92	89	94	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		61	58	55		53
3	84	74	67	61	78	70	63	58	62	57	52		54	50	47		47
4	77	66	58	51	72	62	55	49	55	49	45		48	44	40		42
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	44	38	34		39	34	31		35
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	52	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1874	1874	1874
5°	1877	1848	1861
10°	1862	1823	1836
15°	1834	1794	1797
20°	1797	1752	1757
25°	1761	1703	1711
30°	1714	1656	1652
35°	1671	1602	1589
40°	1617	1547	1530
45°	1563	1492	1469
50°	1505	1434	1399
55°	1443	1367	1335
60°	1374	1288	1261
65°	1298	1205	1174
70°	1202	1105	1080
75°	1068	985	994
80°	907	832	829
85°	656	568	554

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1563 cd/sqm

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	2.4
10°-20°	679.9	6.6
20°-30°	999.1	9.7
30°-40°	1160.4	11.3
40°-50°	1159.0	11.3
50°-60°	1010.6	9.8
60°-70°	747.1	7.3
70°-80°	422.7	4.1
80°-90°	113.8	1.1
90°-100°	41.9	0.4
100°-110°	156.4	1.5
110°-120°	414.8	4.0
120°-130°	688.0	6.7
130°-140°	730.8	7.1
140°-150°	679.2	6.6
150°-160°	546.1	5.3
160°-170°	351.9	3.4
170°-180°	121.1	1.2
0°-30°	1920.6	18.7
0°-40°	3081.0	30.0
0°-60°	5250.6	51.2
0°-90°	6534.1	63.7
90°-120°	613.2	6.0
90°-150°	2711.2	26.4
90°-180°	3730.0	36.3
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	1	11	18	23	25	9
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P903253

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.63	11.63	11.46	12.49	13.55	10.19	11.19	11.02	12.05	13.11
	3H	12.31	13.20	13.15	14.07	15.16	11.82	12.72	12.67	13.58	14.67
	4H	12.90	13.75	13.76	14.62	15.72	12.42	13.26	13.28	14.13	15.23
	6H	13.31	14.09	14.18	14.97	16.08	12.82	13.60	13.69	14.48	15.59
	8H	13.42	14.17	14.30	15.06	16.17	12.93	13.67	13.81	14.57	15.68
	12H	13.48	14.19	14.36	15.07	16.21	12.98	13.69	13.86	14.57	15.71
4H	2H	11.11	11.96	11.98	12.83	13.93	10.76	11.61	11.62	12.48	13.58
	3H	12.99	13.70	13.87	14.60	15.72	12.59	13.30	13.47	14.20	15.32
	4H	13.72	14.36	14.60	15.26	16.40	13.30	13.94	14.19	14.84	15.98
	6H	14.24	14.80	15.14	15.72	16.86	13.82	14.37	14.72	15.30	16.44
	8H	14.40	14.92	15.30	15.83	16.99	13.97	14.49	14.87	15.40	16.56
	12H	14.48	14.95	15.40	15.88	17.04	14.04	14.51	14.96	15.44	16.60
8H	4H	13.92	14.44	14.83	15.36	16.52	13.55	14.07	14.46	14.99	16.15
	6H	14.56	15.00	15.50	15.95	17.11	14.19	14.62	15.12	15.58	16.73
	8H	14.79	15.17	15.73	16.12	17.29	14.40	14.79	15.35	15.74	16.91
	12H	14.93	15.26	15.87	16.21	17.43	14.53	14.86	15.47	15.81	17.03
12H	4H	13.92	14.39	14.84	15.32	16.48	13.55	14.02	14.48	14.96	16.12
	6H	14.60	14.98	15.54	15.93	17.10	14.23	14.61	15.17	15.56	16.74
	8H	14.85	15.18	15.79	16.12	17.35	14.47	14.81	15.42	15.75	16.98

END OF REPORT