

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903349

Luminaire Tested: DFN2DIP-PN4F0-090D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903349
REPORT IS A COMBINATION OF REPORTS P901247 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D100US830-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17729.2 lumens
Efficiency: N/A
Efficacy: 108.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 163.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLLONL

Luminous Intensity Polar Plot

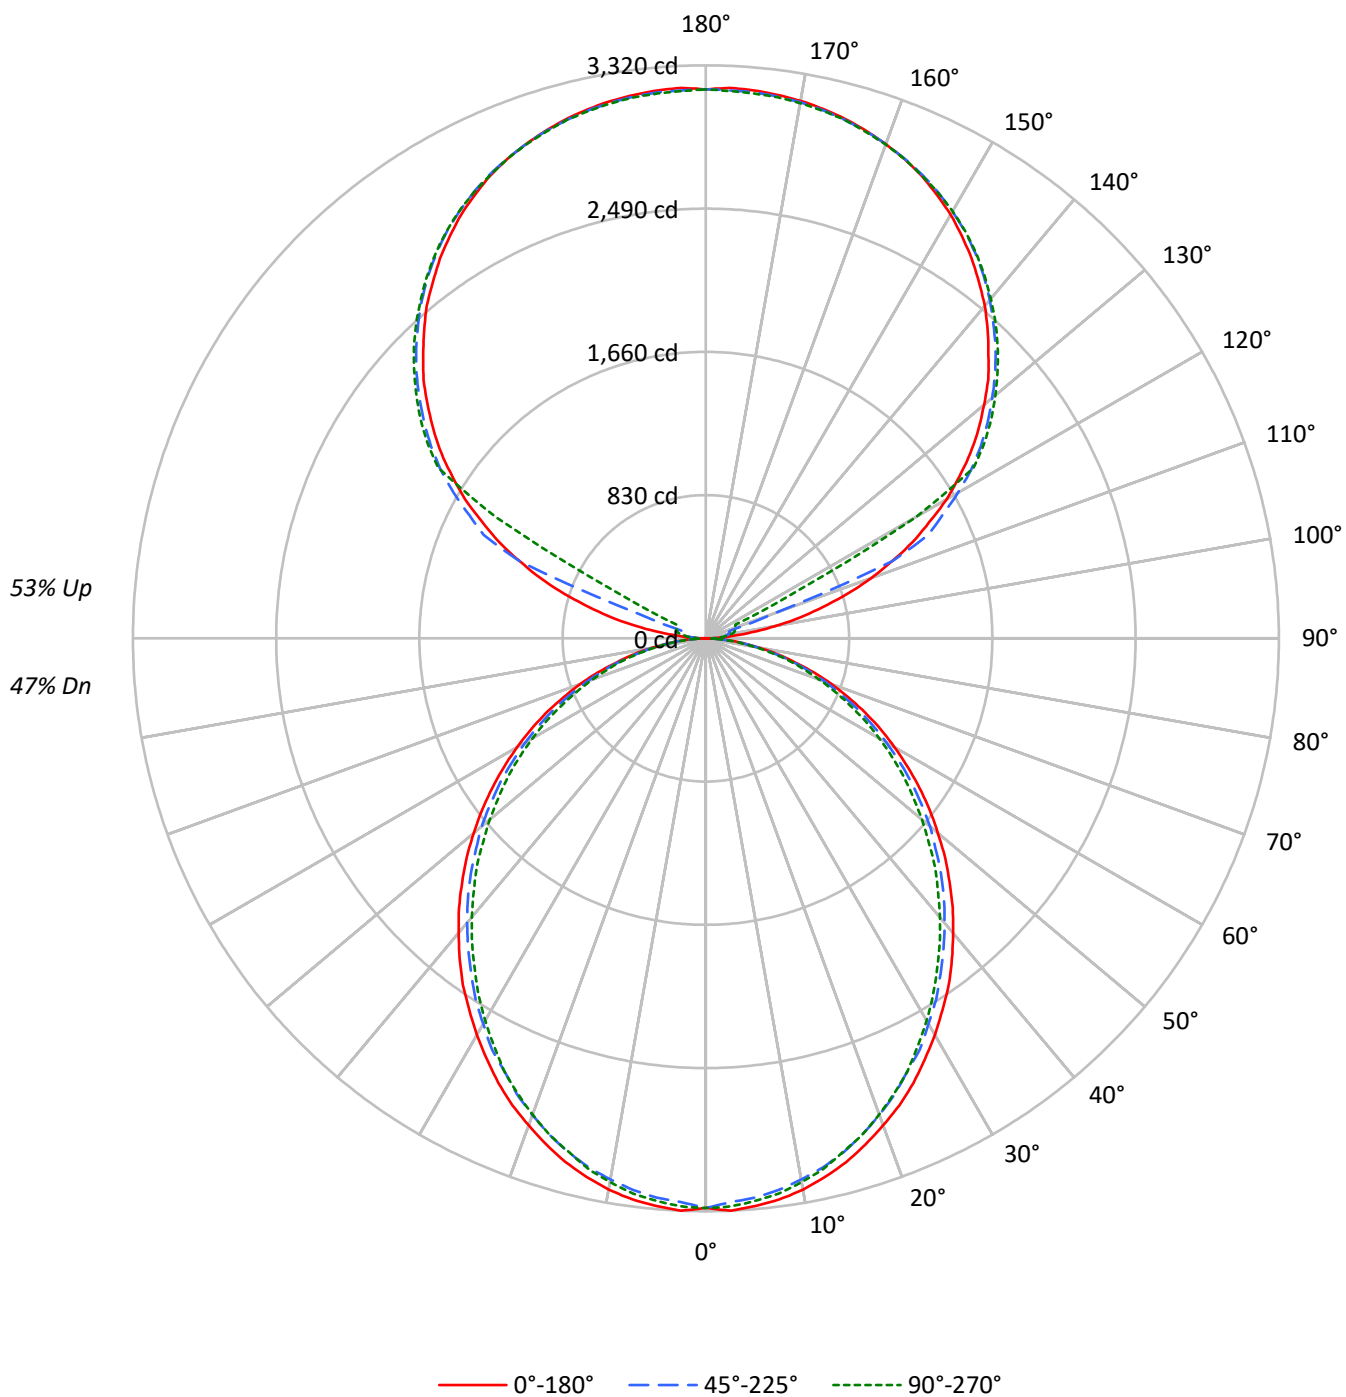

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	86	89	86	82	79	72	69	67	59	57	56	47	46	45
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	24
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	22	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	35	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2409	2409	2409
5°	2413	2376	2392
10°	2394	2344	2360
15°	2359	2306	2310
20°	2311	2253	2259
25°	2264	2189	2199
30°	2204	2130	2124
35°	2148	2060	2043
40°	2079	1989	1967
45°	2010	1918	1889
50°	1935	1844	1799
55°	1856	1758	1716
60°	1766	1655	1621
65°	1669	1550	1509
70°	1545	1421	1389
75°	1373	1267	1278
80°	1167	1070	1066
85°	844	730	713

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2010 cd/sqm

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	1.8
10°-20°	874.1	4.9
20°-30°	1284.6	7.2
30°-40°	1492.0	8.4
40°-50°	1490.1	8.4
50°-60°	1299.3	7.3
60°-70°	960.5	5.4
70°-80°	543.4	3.1
80°-90°	149.0	0.8
90°-100°	104.9	0.6
100°-110°	391.0	2.2
110°-120°	1037.0	5.8
120°-130°	1720.0	9.7
130°-140°	1827.0	10.3
140°-150°	1698.0	9.6
150°-160°	1365.2	7.7
160°-170°	879.7	5.0
170°-180°	302.8	1.7
0°-30°	2469.3	13.9
0°-40°	3961.3	22.3
0°-60°	6750.7	38.1
0°-90°	8403.7	47.4
90°-120°	1532.9	8.6
90°-150°	6778.0	38.2
90°-180°	9326.0	52.6
0°-180°	17729.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	2	28	46	58	62	16
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P903349

CATALOG NUMBER: DFN2DIP-PN4F0-090D100US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.09	10.93	11.07	11.92	13.23	9.65	10.49	10.63	11.48	12.79
	3H	11.75	12.50	12.74	13.50	14.83	11.27	12.02	12.26	13.02	14.35
	4H	12.34	13.05	13.34	14.06	15.39	11.85	12.56	12.85	13.57	14.91
	6H	12.74	13.40	13.75	14.40	15.75	12.25	12.90	13.26	13.91	15.26
	8H	12.84	13.47	13.86	14.50	15.84	12.35	12.98	13.37	14.00	15.35
	12H	12.89	13.49	13.92	14.51	15.88	12.39	12.99	13.42	14.01	15.38
4H	2H	10.55	11.26	11.56	12.26	13.60	10.20	10.91	11.21	11.91	13.25
	3H	12.41	13.01	13.43	14.04	15.39	12.01	12.61	13.03	13.64	14.99
	4H	13.13	13.67	14.16	14.70	16.07	12.71	13.26	13.74	14.28	15.66
	6H	13.65	14.11	14.68	15.16	16.53	13.22	13.69	14.26	14.74	16.11
	8H	13.80	14.23	14.83	15.28	16.66	13.37	13.81	14.41	14.85	16.23
	12H	13.87	14.27	14.93	15.32	16.71	13.43	13.83	14.49	14.88	16.27
8H	4H	13.33	13.76	14.36	14.80	16.19	12.95	13.39	13.99	14.43	15.82
	6H	13.96	14.32	15.02	15.40	16.79	13.58	13.94	14.64	15.03	16.41
	8H	14.18	14.50	15.25	15.57	16.97	13.80	14.11	14.87	15.18	16.58
	12H	14.31	14.59	15.39	15.66	17.10	13.91	14.19	14.98	15.25	16.70
12H	4H	13.31	13.70	14.37	14.76	16.15	12.95	13.34	14.00	14.40	15.79
	6H	13.99	14.31	15.06	15.38	16.78	13.62	13.94	14.69	15.01	16.41
	8H	14.23	14.51	15.30	15.57	17.02	13.86	14.14	14.93	15.20	16.65

END OF REPORT