

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903399

Luminaire Tested: DFN2DIP-PN4F0-110D040US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903399
REPORT IS A COMBINATION OF REPORTS P901144 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-110D040US830-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12545.2 lumens
Efficiency: N/A
Efficacy: 86.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 144.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLLONL

Luminous Intensity Polar Plot

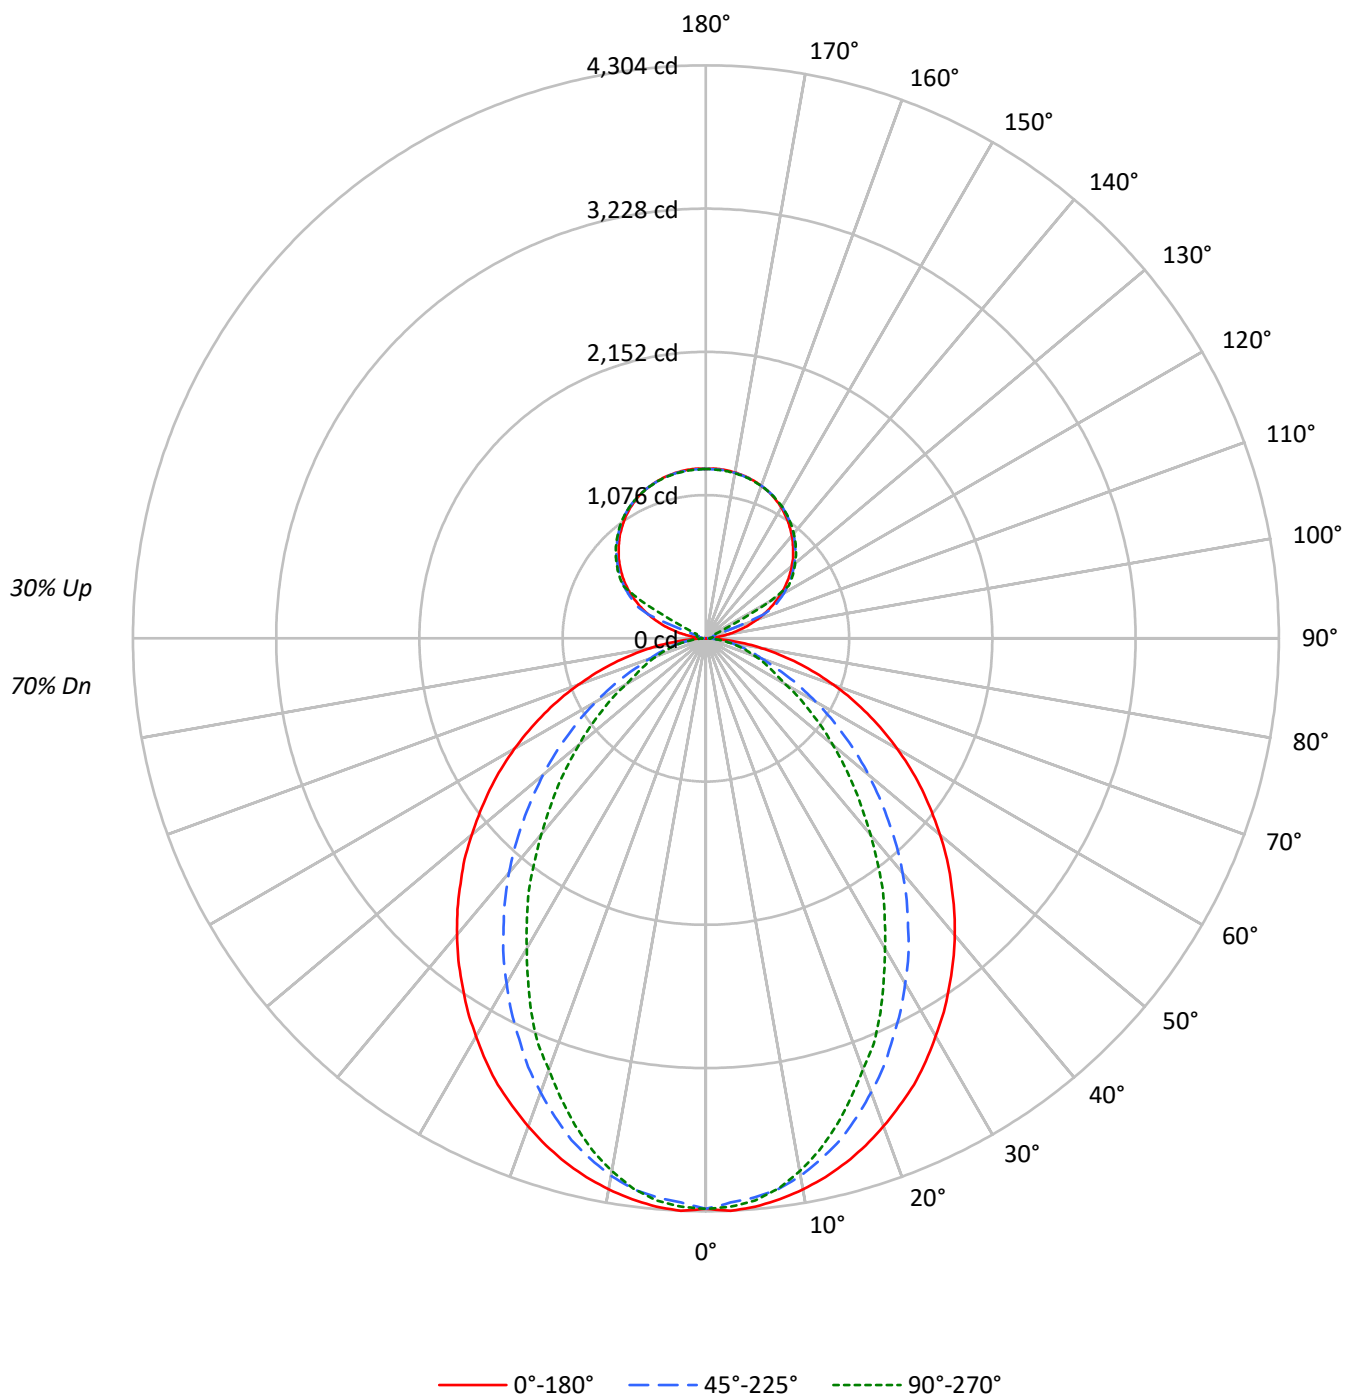

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	84	84	84	75	75	75
1	103	99	95	92	97	94	90	87	84	82	79	75	73	72	67	66	64
2	94	87	81	76	89	83	77	73	75	70	67	67	64	61	60	58	55
3	87	77	70	64	82	73	67	62	66	61	57	60	56	52	54	51	48
4	80	69	61	55	75	66	59	53	60	54	49	54	49	46	48	45	42
5	73	62	54	48	69	59	52	46	54	48	43	49	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	43	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	41	36	32	37	33	30
8	59	46	39	33	56	45	37	32	41	35	30	37	32	29	34	30	27
9	55	43	35	30	52	41	34	29	38	32	28	35	30	26	32	27	24
10	52	39	32	27	49	38	31	27	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3128	3128	3128
5°	3133	3079	3099
10°	3102	3019	2998
15°	3059	2919	2843
20°	3003	2782	2652
25°	2945	2628	2468
30°	2867	2471	2234
35°	2791	2301	2028
40°	2714	2125	1793
45°	2624	1931	1579
50°	2531	1734	1370
55°	2433	1524	1170
60°	2321	1304	963
65°	2192	1080	868
70°	2035	872	786
75°	1838	769	717
80°	1552	647	624
85°	1081	434	472

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2624 cd/sqm

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	401.6	3.2
10°-20°	1102.5	8.8
20°-30°	1547.8	12.3
30°-40°	1687.2	13.4
40°-50°	1550.8	12.4
50°-60°	1217.9	9.7
60°-70°	792.7	6.3
70°-80°	408.1	3.3
80°-90°	106.4	0.8
90°-100°	41.9	0.3
100°-110°	156.4	1.2
110°-120°	414.8	3.3
120°-130°	688.0	5.5
130°-140°	730.8	5.8
140°-150°	679.2	5.4
150°-160°	546.1	4.4
160°-170°	351.9	2.8
170°-180°	121.1	1.0
0°-30°	3051.9	24.3
0°-40°	4739.1	37.8
0°-60°	7507.8	59.8
0°-90°	8815.0	70.3
90°-120°	613.2	4.9
90°-150°	2711.2	21.6
90°-180°	3730.0	29.7
0°-180°	12545.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4285	4285	4285	4285	4285	
5°	4285	4266	4215	4250	4239	406
15°	4076	4033	3901	3828	3789	1148
25°	3700	3575	3319	3161	3102	1701
35°	3188	2990	2649	2404	2319	1995
45°	2606	2346	1939	1663	1570	2013
55°	1981	1679	1260	1028	954	1771
65°	1338	1024	675	543	531	1326
75°	713	442	310	283	279	755
85°	167	85	74	74	74	191
90°	1	11	18	23	25	12
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4285.1	4285.1	4285.1	4285.1	4285.1
2.5°	4304.4	4285.1	4242.3	4281.4	4273.6
5°	4285.1	4265.8	4215.1	4250.1	4238.6
7.5°	4250.1	4227.0	4172.7	4188.0	4168.6
10°	4203.6	4176.4	4099.1	4087.1	4064.1
12.5°	4145.6	4110.6	4005.7	3982.6	3939.8
15°	4075.6	4032.9	3901.2	3827.6	3788.8
17.5°	3994.2	3932.1	3769.1	3683.9	3621.8
20°	3901.2	3823.4	3629.6	3532.9	3447.3
22.5°	3800.4	3711.1	3486.1	3354.4	3296.4
25°	3699.6	3575.3	3319.4	3160.6	3102.2
27.5°	3579.5	3447.3	3164.3	2982.0	2892.8
30°	3451.5	3303.8	2993.6	2796.1	2691.1
32.5°	3327.3	3148.7	2831.0	2598.2	2501.1
35°	3187.8	2989.8	2648.8	2404.4	2318.8
37.5°	3052.0	2838.5	2478.0	2210.2	2113.6
40°	2908.4	2676.0	2299.5	2024.2	1923.4
42.5°	2761.1	2513.0	2121.4	1834.2	1737.5
45°	2606.0	2346.0	1939.1	1663.4	1570.5
47.5°	2458.7	2183.5	1764.6	1488.9	1403.8
50°	2295.8	2020.5	1593.9	1326.1	1245.0
52.5°	2136.6	1845.7	1431.0	1175.1	1101.4
55°	1981.4	1679.0	1260.2	1027.7	954.1
57.5°	1822.7	1512.4	1109.2	892.0	829.8
60°	1659.7	1349.5	950.0	752.5	690.4
62.5°	1500.9	1190.7	814.3	628.3	597.4
65°	1337.9	1023.6	674.8	543.1	531.1
67.5°	1182.9	868.6	543.1	476.8	465.3
70°	1019.9	717.6	449.7	411.0	395.4
72.5°	864.8	577.7	376.1	345.2	337.3
75°	713.4	441.9	310.2	283.0	279.4
77.5°	562.4	314.0	244.4	228.8	220.9
80°	422.5	225.1	186.0	170.8	170.8
82.5°	294.5	151.4	128.0	120.2	120.2
85°	166.6	85.2	73.6	73.6	73.6
87.5°	62.1	30.8	30.8	27.1	27.1
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P903399

CATALOG NUMBER: DFN2DIP-PN4F0-110D040US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.83	13.86	13.60	14.64	15.60	8.79	9.82	9.56	10.61	11.56
	3H	14.52	15.45	15.31	16.24	17.22	10.00	10.92	10.78	11.71	12.70
	4H	15.14	16.01	15.94	16.82	17.81	10.46	11.33	11.26	12.13	13.12
	6H	15.58	16.38	16.39	17.19	18.20	10.79	11.59	11.60	12.40	13.41
	8H	15.71	16.47	16.53	17.30	18.31	10.89	11.65	11.71	12.48	13.49
	12H	15.78	16.51	16.61	17.33	18.36	10.94	11.66	11.76	12.49	13.52
4H	2H	12.87	13.74	13.68	14.54	15.54	9.42	10.28	10.22	11.09	12.08
	3H	14.72	15.44	15.54	16.28	17.29	10.78	11.50	11.60	12.34	13.35
	4H	15.42	16.08	16.25	16.91	17.95	11.34	11.99	12.17	12.83	13.87
	6H	15.95	16.52	16.80	17.38	18.42	11.77	12.34	12.62	13.20	14.24
	8H	16.13	16.66	16.98	17.52	18.57	11.91	12.43	12.75	13.29	14.34
	12H	16.24	16.71	17.11	17.59	18.65	11.98	12.45	12.85	13.33	14.39
8H	4H	15.41	15.93	16.26	16.79	17.84	11.64	12.16	12.49	13.02	14.08
	6H	15.98	16.42	16.86	17.32	18.37	12.16	12.60	13.04	13.50	14.55
	8H	16.20	16.59	17.09	17.48	18.55	12.36	12.74	13.24	13.64	14.71
	12H	16.35	16.69	17.24	17.58	18.70	12.49	12.83	13.37	13.71	14.84
12H	4H	15.37	15.84	16.24	16.72	17.78	11.65	12.12	12.52	13.00	14.06
	6H	15.96	16.35	16.85	17.24	18.31	12.21	12.60	13.10	13.49	14.57
	8H	16.19	16.53	17.08	17.41	18.54	12.44	12.78	13.32	13.66	14.79

END OF REPORT