

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903423

Luminaire Tested: DFN2DIP-PN4F0-110D100US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903423
REPORT IS A COMBINATION OF REPORTS P901252 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-110D100US830-RLLONL
Description: 4 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18143.9 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 189.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLLONL

Luminous Intensity Polar Plot

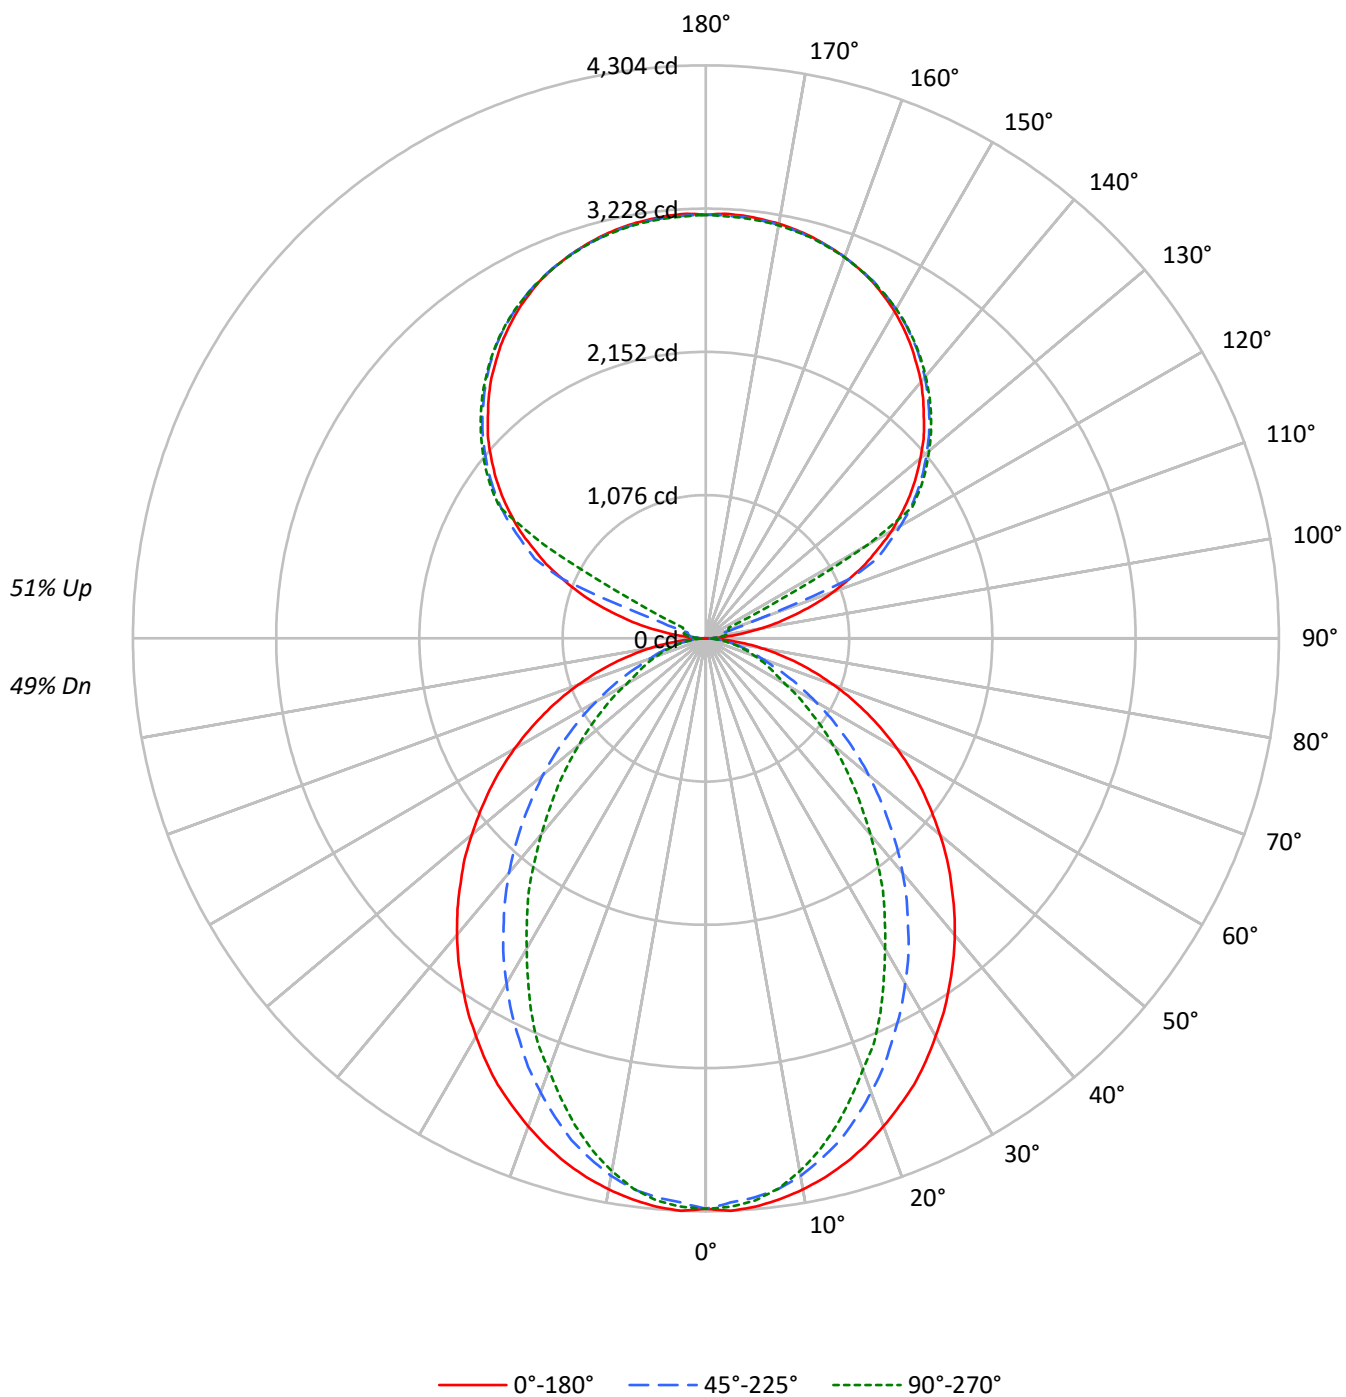

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	83	81	73	71	69	61	59	58	49	48	47
2	90	82	77	72	82	76	71	67	65	61	58	54	51	49	44	42	40
3	82	73	66	60	75	68	61	56	57	53	49	48	45	42	39	37	35
4	75	65	57	51	69	60	53	48	51	46	42	43	39	36	35	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	36	42	36	32	35	31	28	29	26	24
7	59	47	39	34	55	44	37	32	38	33	29	32	28	25	27	24	21
8	55	43	35	30	51	40	33	29	35	29	26	30	25	22	25	22	19
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	27	23	29	24	21	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3128	3128	3128
5°	3133	3079	3099
10°	3102	3019	2998
15°	3059	2919	2843
20°	3003	2782	2652
25°	2945	2628	2468
30°	2867	2471	2234
35°	2791	2301	2028
40°	2714	2125	1793
45°	2624	1931	1579
50°	2531	1734	1370
55°	2433	1524	1170
60°	2321	1304	963
65°	2192	1080	868
70°	2035	872	786
75°	1838	769	717
80°	1552	647	624
85°	1081	434	472

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2624 cd/sqm

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	401.6	2.2
10°-20°	1102.5	6.1
20°-30°	1547.8	8.5
30°-40°	1687.2	9.3
40°-50°	1550.8	8.5
50°-60°	1217.9	6.7
60°-70°	792.7	4.4
70°-80°	408.1	2.2
80°-90°	109.8	0.6
90°-100°	104.9	0.6
100°-110°	391.0	2.2
110°-120°	1037.0	5.7
120°-130°	1720.0	9.5
130°-140°	1827.0	10.1
140°-150°	1698.0	9.4
150°-160°	1365.2	7.5
160°-170°	879.7	4.8
170°-180°	302.8	1.7
0°-30°	3051.9	16.8
0°-40°	4739.1	26.1
0°-60°	7507.8	41.4
0°-90°	8818.4	48.6
90°-120°	1532.9	8.4
90°-150°	6778.0	37.4
90°-180°	9326.0	51.4
0°-180°	18143.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4285	4285	4285	4285	4285	
5°	4285	4266	4215	4250	4239	406
15°	4076	4033	3901	3828	3789	1148
25°	3700	3575	3319	3161	3102	1701
35°	3188	2990	2649	2404	2319	1995
45°	2606	2346	1939	1663	1570	2013
55°	1981	1679	1260	1028	954	1771
65°	1338	1024	675	543	531	1326
75°	713	442	310	283	279	755
85°	167	85	74	74	74	191
90°	2	28	46	58	62	17
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4285.1	4285.1	4285.1	4285.1	4285.1
2.5°	4304.4	4285.1	4242.3	4281.4	4273.6
5°	4285.1	4265.8	4215.1	4250.1	4238.6
7.5°	4250.1	4227.0	4172.7	4188.0	4168.6
10°	4203.6	4176.4	4099.1	4087.1	4064.1
12.5°	4145.6	4110.6	4005.7	3982.6	3939.8
15°	4075.6	4032.9	3901.2	3827.6	3788.8
17.5°	3994.2	3932.1	3769.1	3683.9	3621.8
20°	3901.2	3823.4	3629.6	3532.9	3447.3
22.5°	3800.4	3711.1	3486.1	3354.4	3296.4
25°	3699.6	3575.3	3319.4	3160.6	3102.2
27.5°	3579.5	3447.3	3164.3	2982.0	2892.8
30°	3451.5	3303.8	2993.6	2796.1	2691.1
32.5°	3327.3	3148.7	2831.0	2598.2	2501.1
35°	3187.8	2989.8	2648.8	2404.4	2318.8
37.5°	3052.0	2838.5	2478.0	2210.2	2113.6
40°	2908.4	2676.0	2299.5	2024.2	1923.4
42.5°	2761.1	2513.0	2121.4	1834.2	1737.5
45°	2606.0	2346.0	1939.1	1663.4	1570.5
47.5°	2458.7	2183.5	1764.6	1488.9	1403.8
50°	2295.8	2020.5	1593.9	1326.1	1245.0
52.5°	2136.6	1845.7	1431.0	1175.1	1101.4
55°	1981.4	1679.0	1260.2	1027.7	954.1
57.5°	1822.7	1512.4	1109.2	892.0	829.8
60°	1659.7	1349.5	950.0	752.5	690.4
62.5°	1500.9	1190.7	814.3	628.3	597.4
65°	1337.9	1023.6	674.8	543.1	531.1
67.5°	1182.9	868.6	543.1	476.8	465.3
70°	1019.9	717.6	449.7	411.0	395.4
72.5°	864.8	577.7	376.1	345.2	337.3
75°	713.4	441.9	310.2	283.0	279.4
77.5°	562.4	314.0	244.4	228.8	220.9
80°	422.5	225.1	186.0	170.8	170.8
82.5°	294.5	151.4	128.0	120.2	120.2
85°	166.6	85.2	73.6	73.6	73.6
87.5°	62.1	30.8	30.8	27.1	27.1
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P903423

CATALOG NUMBER: DFN2DIP-PN4F0-110D100US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.98	11.80	11.96	12.79	14.08	6.95	7.77	7.92	8.75	10.05
	3H	12.66	13.40	13.65	14.39	15.71	8.14	8.87	9.12	9.86	11.18
	4H	13.27	13.97	14.27	14.96	16.29	8.59	9.28	9.59	10.28	11.60
	6H	13.70	14.33	14.71	15.34	16.67	8.91	9.55	9.92	10.55	11.88
	8H	13.82	14.43	14.84	15.45	16.78	9.00	9.61	10.02	10.62	11.96
	12H	13.89	14.46	14.91	15.48	16.83	9.04	9.62	10.06	10.63	11.99
4H	2H	11.00	11.69	12.01	12.69	14.01	7.54	8.24	8.55	9.23	10.56
	3H	12.83	13.41	13.85	14.43	15.77	8.89	9.47	9.91	10.50	11.83
	4H	13.53	14.05	14.55	15.07	16.43	9.44	9.97	10.47	10.99	12.35
	6H	14.04	14.50	15.08	15.54	16.89	9.86	10.31	10.90	11.36	12.71
	8H	14.22	14.64	15.25	15.68	17.05	9.99	10.41	11.03	11.45	12.82
	12H	14.32	14.70	15.37	15.75	17.12	10.06	10.44	11.11	11.49	12.86
8H	4H	13.49	13.92	14.53	14.95	16.32	9.72	10.15	10.76	11.18	12.55
	6H	14.06	14.41	15.12	15.49	16.86	10.24	10.59	11.30	11.67	13.04
	8H	14.28	14.59	15.35	15.65	17.04	10.44	10.74	11.50	11.80	13.19
	12H	14.42	14.69	15.49	15.75	17.18	10.55	10.82	11.62	11.88	13.31
12H	4H	13.44	13.83	14.50	14.88	16.25	9.73	10.11	10.78	11.16	12.54
	6H	14.04	14.34	15.10	15.41	16.79	10.29	10.60	11.36	11.66	13.05
	8H	14.26	14.53	15.33	15.59	17.02	10.50	10.77	11.57	11.83	13.26

END OF REPORT