

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903437

Luminaire Tested: DFN2DIP-PN4F0-120D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903437
REPORT IS A COMBINATION OF REPORTS P901163 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-120D050US830-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15863.0 lumens
Efficiency: N/A
Efficacy: 96.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 163.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

Luminous Intensity Polar Plot

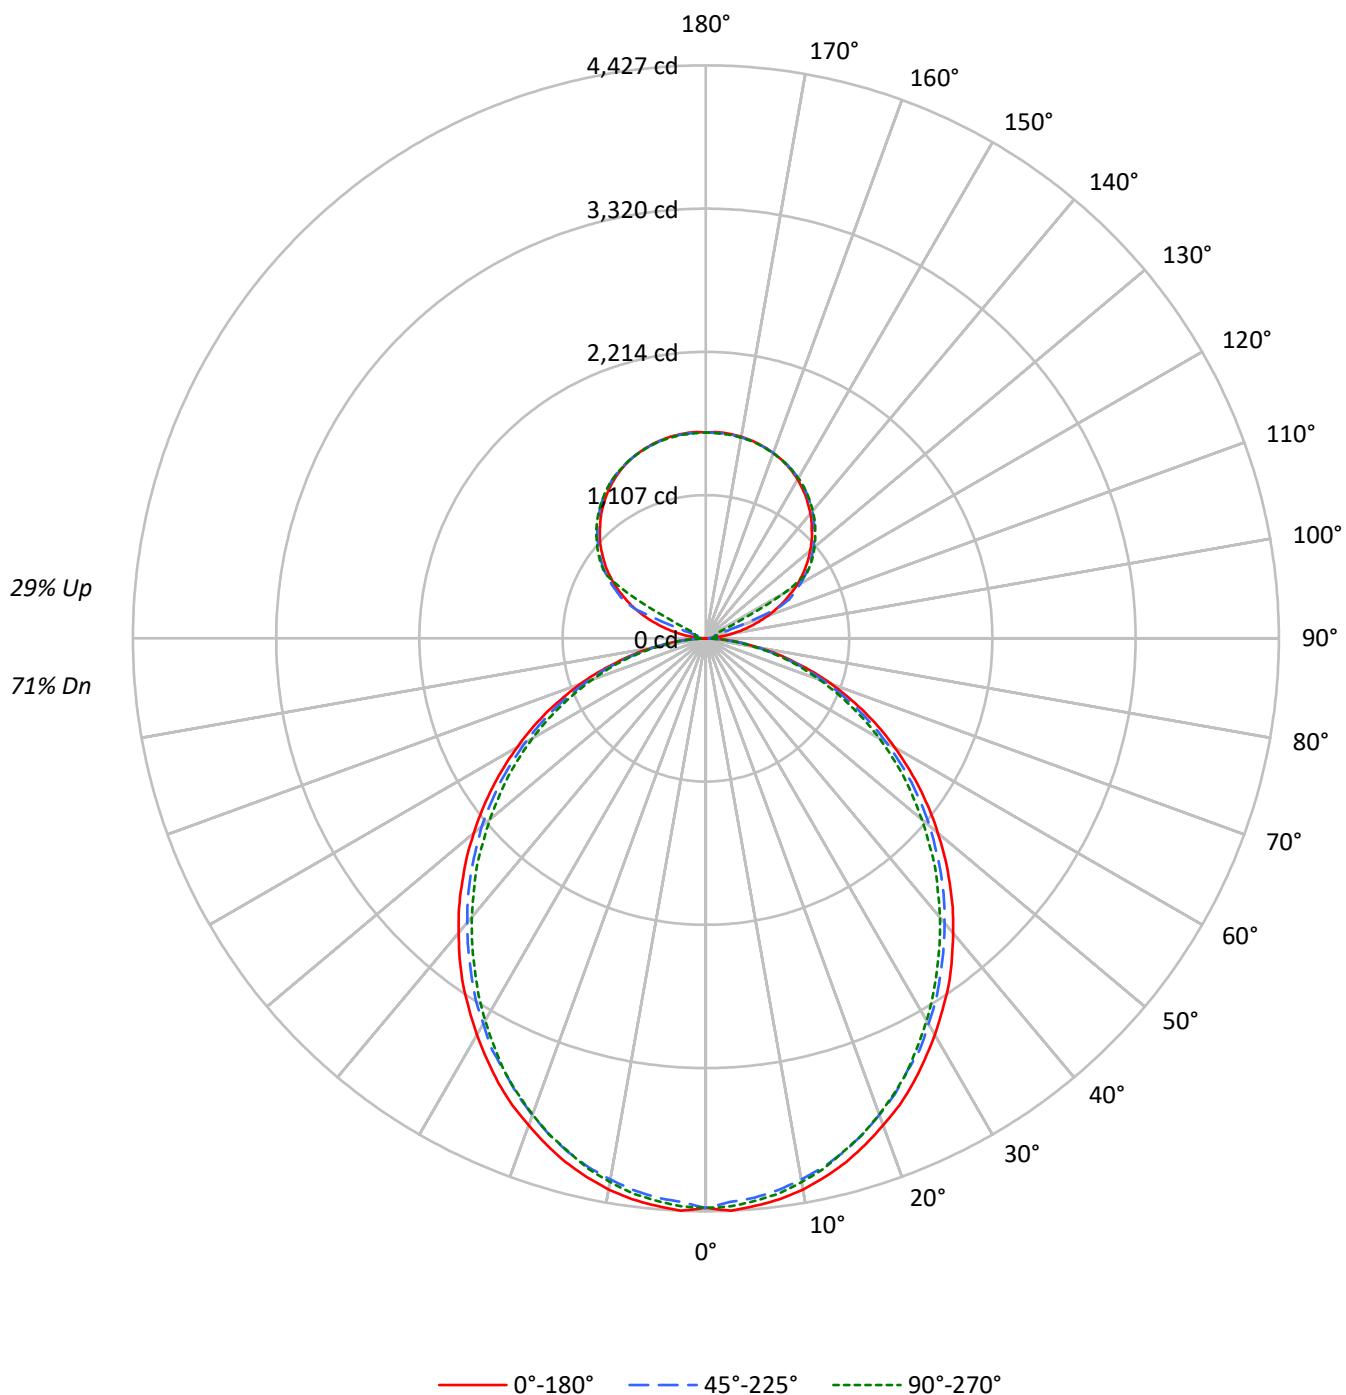

TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	84	84	84	75	75	75
1	102	98	94	90	97	93	89	86	83	81	78	74	72	71	66	65	63
2	93	86	79	74	88	81	76	71	73	69	65	65	62	59	58	56	53
3	85	75	68	62	80	72	65	59	64	59	54	58	54	50	52	48	46
4	78	67	59	52	73	64	56	50	57	51	47	52	47	43	46	42	39
5	72	60	51	45	68	57	49	43	51	45	40	46	41	37	42	38	34
6	66	54	45	39	62	51	43	38	46	40	35	42	37	33	38	34	30
7	61	49	40	35	58	46	39	33	42	36	31	38	33	29	35	30	27
8	57	44	36	31	54	42	35	30	39	32	28	35	30	26	32	27	24
9	53	40	33	28	50	39	32	27	35	29	25	32	27	23	29	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3213	3213	3213
5°	3218	3168	3190
10°	3192	3126	3147
15°	3145	3075	3080
20°	3081	3004	3012
25°	3018	2919	2932
30°	2939	2840	2831
35°	2864	2746	2725
40°	2772	2652	2623
45°	2680	2557	2519
50°	2579	2458	2399
55°	2474	2343	2288
60°	2355	2207	2161
65°	2226	2066	2012
70°	2060	1894	1852
75°	1831	1689	1704
80°	1556	1427	1421
85°	1125	974	951

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2680 cd/sqm

TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.2	2.6
10°-20°	1165.5	7.3
20°-30°	1712.8	10.8
30°-40°	1989.3	12.5
40°-50°	1986.8	12.5
50°-60°	1732.4	10.9
60°-70°	1280.6	8.1
70°-80°	724.6	4.6
80°-90°	194.0	1.2
90°-100°	52.5	0.3
100°-110°	195.5	1.2
110°-120°	518.5	3.3
120°-130°	860.0	5.4
130°-140°	913.5	5.8
140°-150°	849.0	5.4
150°-160°	682.6	4.3
160°-170°	439.8	2.8
170°-180°	151.4	1.0
0°-30°	3292.4	20.8
0°-40°	5281.7	33.3
0°-60°	9000.9	56.7
0°-90°	11200.2	70.6
90°-120°	766.5	4.8
90°-150°	3389.0	21.4
90°-180°	4663.0	29.4
0°-180°	15863.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4401	4401	4401	4401	4401	
5°	4401	4384	4338	4371	4363	418
15°	4190	4164	4109	4126	4105	1180
25°	3792	3758	3686	3694	3686	1745
35°	3271	3229	3161	3136	3115	2043
45°	2662	2632	2569	2522	2505	2054
55°	2015	1989	1938	1888	1866	1801
65°	1359	1333	1291	1253	1232	1343
75°	711	703	681	656	664	759
85°	173	169	165	152	148	193
90°	1	14	23	29	31	15
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4401.0	4401.0	4401.0	4401.0	4401.0
2.5°	4426.6	4405.4	4358.8	4401.0	4392.9
5°	4401.0	4384.3	4337.7	4371.3	4363.2
7.5°	4371.3	4346.2	4299.5	4333.6	4325.1
10°	4325.1	4295.4	4244.7	4278.4	4265.9
12.5°	4261.3	4236.2	4185.5	4206.6	4198.0
15°	4189.5	4164.3	4109.1	4126.2	4105.1
17.5°	4100.6	4075.5	4020.2	4041.3	4020.2
20°	4003.2	3978.0	3918.8	3931.3	3914.8
22.5°	3906.2	3868.0	3812.8	3812.8	3804.3
25°	3791.7	3758.0	3686.2	3694.3	3686.2
27.5°	3664.6	3635.0	3580.2	3567.6	3546.6
30°	3538.0	3503.9	3440.6	3428.0	3411.0
32.5°	3402.4	3377.3	3309.5	3283.9	3266.9
35°	3271.3	3229.1	3161.3	3135.7	3114.6
37.5°	3123.1	3085.0	3017.2	2987.6	2966.5
40°	2971.0	2936.9	2869.0	2831.3	2814.2
42.5°	2822.8	2788.7	2721.3	2678.7	2653.5
45°	2662.0	2632.4	2568.6	2522.4	2505.4
47.5°	2505.4	2475.7	2407.9	2361.3	2336.1
50°	2340.1	2319.0	2259.7	2200.5	2179.3
52.5°	2179.3	2149.8	2095.0	2048.2	2018.6
55°	2014.6	1989.0	1938.2	1887.5	1866.4
57.5°	1849.4	1828.2	1773.0	1722.3	1705.2
60°	1684.1	1667.5	1608.3	1561.6	1549.0
62.5°	1523.4	1493.7	1451.6	1409.4	1392.3
65°	1358.7	1333.0	1290.8	1252.6	1231.6
67.5°	1189.4	1167.8	1130.1	1100.5	1083.5
70°	1032.6	1015.6	977.4	947.8	931.2
72.5°	871.9	854.9	833.8	804.2	791.5
75°	710.8	702.7	681.1	656.0	664.5
77.5°	567.0	550.0	541.5	528.9	516.3
80°	423.4	418.9	410.4	397.8	389.3
82.5°	287.8	287.8	283.8	266.7	266.7
85°	173.3	169.3	165.2	152.2	148.2
87.5°	76.3	67.8	59.3	46.7	42.2
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903437

CATALOG NUMBER: DFN2DIP-PN4F0-120D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.05	14.13	13.81	14.91	15.85	12.61	13.69	13.37	14.47	15.41
	3H	14.73	15.70	15.50	16.49	17.46	14.24	15.22	15.02	16.01	16.98
	4H	15.33	16.25	16.12	17.04	18.03	14.84	15.76	15.63	16.56	17.54
	6H	15.74	16.59	16.54	17.40	18.39	15.25	16.10	16.05	16.90	17.90
	8H	15.85	16.66	16.66	17.49	18.49	15.36	16.17	16.17	16.99	17.99
	12H	15.91	16.68	16.73	17.50	18.53	15.41	16.18	16.23	17.00	18.03
4H	2H	13.54	14.46	14.33	15.25	16.24	13.19	14.10	13.98	14.90	15.89
	3H	15.43	16.19	16.23	17.03	18.03	15.02	15.79	15.83	16.62	17.62
	4H	16.15	16.85	16.97	17.68	18.71	15.73	16.43	16.55	17.26	18.29
	6H	16.68	17.29	17.52	18.14	19.18	16.26	16.86	17.09	17.72	18.75
	8H	16.84	17.40	17.68	18.25	19.30	16.41	16.97	17.25	17.83	18.87
	12H	16.92	17.43	17.78	18.30	19.36	16.48	16.99	17.34	17.86	18.92
8H	4H	16.37	16.93	17.21	17.78	18.83	15.99	16.56	16.83	17.41	18.46
	6H	17.01	17.48	17.88	18.37	19.42	16.63	17.10	17.50	17.99	19.04
	8H	17.23	17.65	18.11	18.54	19.60	16.85	17.27	17.73	18.15	19.22
	12H	17.38	17.74	18.26	18.62	19.74	16.98	17.34	17.86	18.22	19.34
12H	4H	16.36	16.87	17.22	17.74	18.80	16.00	16.51	16.86	17.38	18.43
	6H	17.04	17.46	17.92	18.35	19.41	16.68	17.09	17.56	17.98	19.05
	8H	17.30	17.66	18.18	18.54	19.66	16.92	17.29	17.81	18.17	19.29