

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905957

Luminaire Tested: DFN2DIP-PN4F0-060D070US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905957
REPORT IS A COMBINATION OF REPORTS P901187 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-060D070US835-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12870.0 lumens
Efficiency: N/A
Efficacy: 120.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 107.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

Luminous Intensity Polar Plot

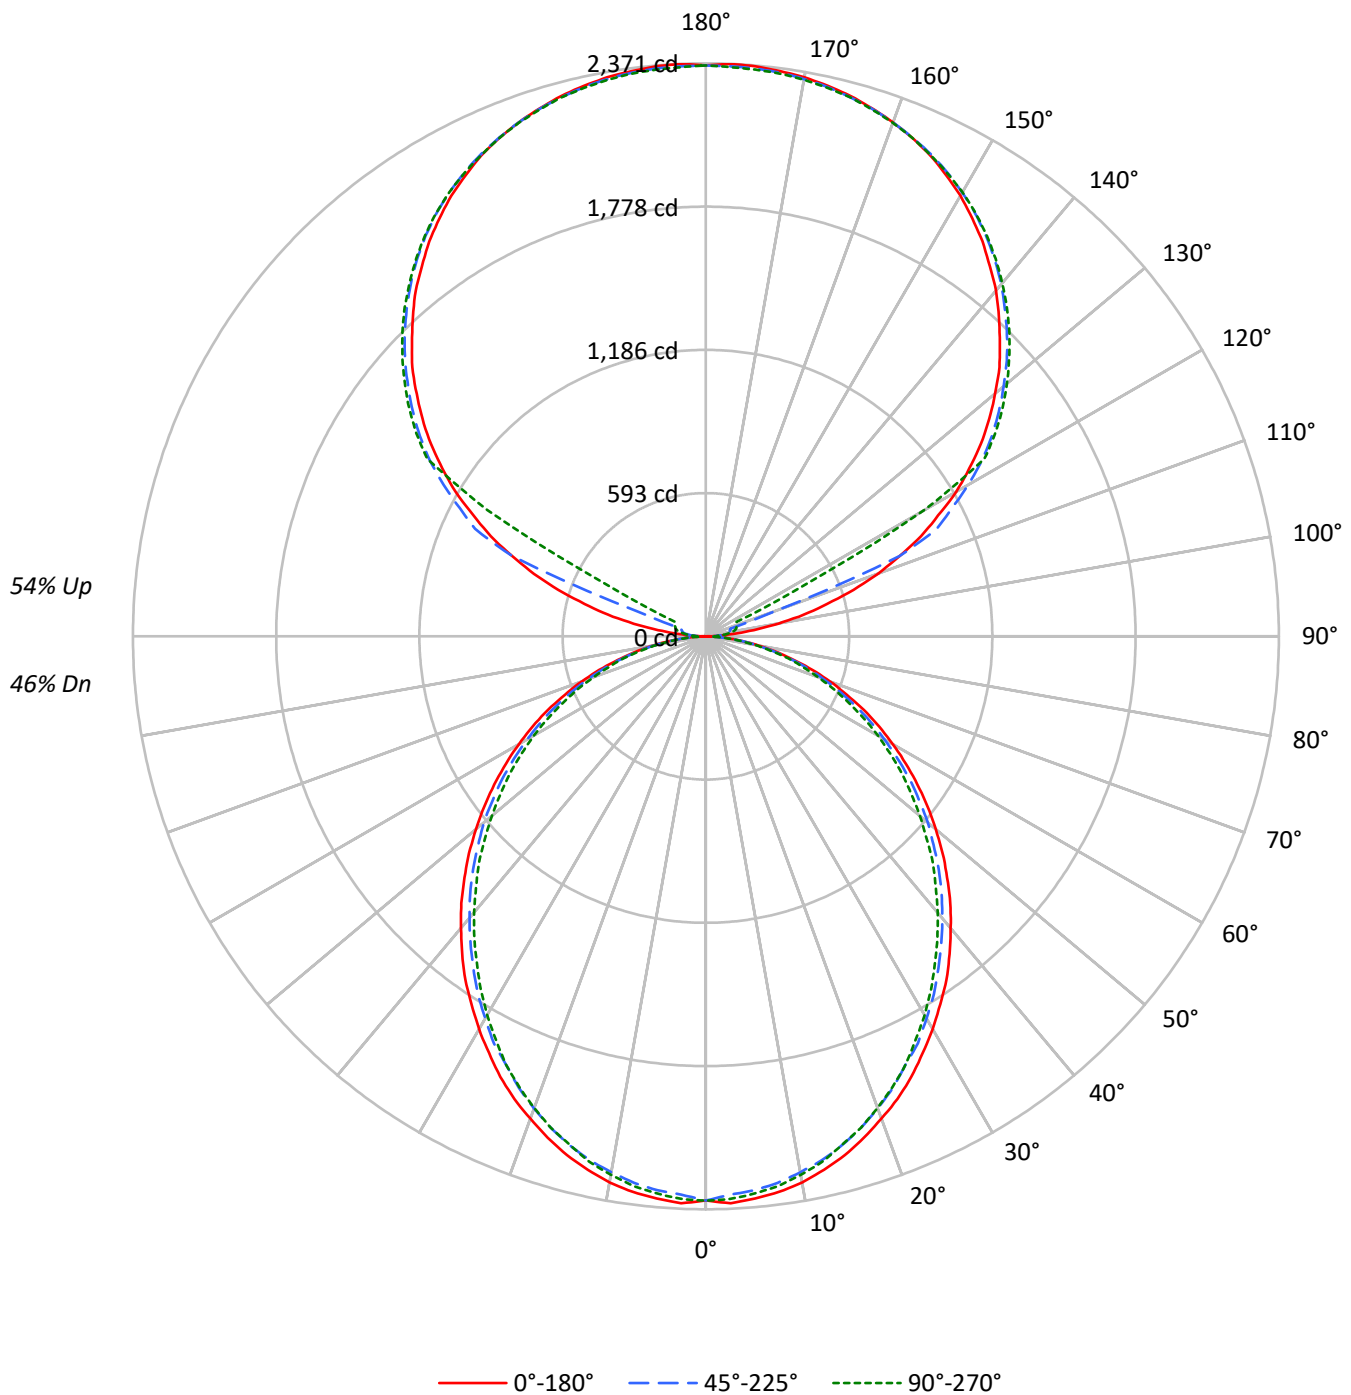

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53	46		
1	97	93	89	85	89	85	82	79	71	69	67	58	57	55	46	45	44	39		
2	88	81	75	70	81	74	69	65	62	59	55	51	48	46	41	39	37	33		
3	81	71	64	58	74	66	59	54	55	50	46	45	42	39	36	34	32	28		
4	74	63	55	49	67	58	51	46	49	44	40	40	37	33	32	30	27	24		
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	21		
6	62	50	42	36	57	46	39	34	39	34	30	33	29	25	26	23	21	18		
7	58	45	37	32	53	42	35	30	36	30	26	30	26	22	24	21	19	16		
8	53	41	33	28	49	38	31	26	33	27	23	27	23	20	22	19	17	14		
9	50	38	30	25	46	35	28	24	30	24	21	25	21	18	21	17	15	13		
10	46	34	27	22	43	32	26	21	27	22	19	23	19	16	19	16	14	12		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1704	1704	1704
5°	1707	1681	1692
10°	1693	1658	1669
15°	1668	1631	1634
20°	1635	1593	1598
25°	1601	1548	1556
30°	1559	1506	1502
35°	1519	1457	1445
40°	1470	1407	1391
45°	1422	1357	1336
50°	1368	1304	1272
55°	1312	1243	1214
60°	1249	1171	1147
65°	1181	1096	1067
70°	1093	1005	982
75°	971	896	904
80°	825	757	754
85°	597	516	504

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1422 cd/sqm

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.7
10°-20°	618.3	4.8
20°-30°	908.6	7.1
30°-40°	1055.3	8.2
40°-50°	1054.0	8.2
50°-60°	919.0	7.1
60°-70°	679.4	5.3
70°-80°	384.4	3.0
80°-90°	105.6	0.8
90°-100°	77.9	0.6
100°-110°	290.4	2.3
110°-120°	770.2	6.0
120°-130°	1277.4	9.9
130°-140°	1356.9	10.5
140°-150°	1261.1	9.8
150°-160°	1013.9	7.9
160°-170°	653.3	5.1
170°-180°	224.9	1.7
0°-30°	1746.6	13.6
0°-40°	2801.8	21.8
0°-60°	4774.8	37.1
0°-90°	5944.1	46.2
90°-120°	1138.5	8.8
90°-150°	5033.8	39.1
90°-180°	6926.0	53.8
0°-180°	12870.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	2	20	34	43	46	12
95°	111	55	67	75	74	131
105°	520	571	104	123	130	555
115°	983	1012	1055	263	140	968
125°	1390	1412	1444	1456	1462	1239
135°	1720	1747	1762	1780	1776	1328
145°	1995	1993	2022	2034	2026	1248
155°	2197	2181	2202	2212	2198	1012
165°	2314	2304	2309	2321	2309	654
175°	2368	2356	2359	2371	2354	225
180°	2362	2362	2362	2362	2362	

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	1.6	20.5	34.1	42.8	46.1
92.5°	42.8	35.9	41.0	44.5	46.1
95°	111.0	54.6	66.6	75.3	73.5
97.5°	199.9	59.9	87.1	92.4	94.0
100°	302.7	68.4	97.4	111.0	114.5
102.5°	415.3	412.1	100.9	119.6	124.8
105°	519.7	571.0	104.3	123.0	129.9
107.5°	641.0	683.7	107.8	126.5	133.4
110°	757.4	793.1	299.2	128.3	135.0

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	866.8	897.4	868.4	131.5	136.8
115°	982.9	1011.9	1054.7	263.3	140.3
117.5°	1083.8	1117.9	1147.1	902.5	454.7
120°	1196.6	1222.2	1253.1	1273.6	1042.8
122.5°	1292.2	1319.6	1354.0	1364.1	1365.9
125°	1389.7	1412.0	1444.5	1456.5	1461.5
127.5°	1478.6	1502.5	1528.3	1545.4	1547.0
130°	1562.4	1589.8	1608.5	1627.4	1625.8
132.5°	1647.9	1670.2	1688.9	1704.3	1702.7
135°	1719.7	1747.1	1762.4	1779.6	1776.2
137.5°	1794.8	1815.4	1832.6	1849.7	1844.6
140°	1868.3	1882.1	1900.8	1916.2	1907.7
142.5°	1930.0	1942.0	1964.1	1977.7	1969.2
145°	1995.0	1993.2	2022.2	2034.2	2025.7
147.5°	2051.2	2046.2	2075.2	2083.7	2077.0
150°	2106.0	2094.1	2121.5	2131.6	2123.1
152.5°	2152.1	2138.5	2164.1	2174.4	2162.5
155°	2196.6	2181.3	2201.8	2212.0	2198.4
157.5°	2232.5	2218.9	2234.3	2246.3	2232.5
160°	2263.4	2253.0	2263.4	2273.5	2261.5
162.5°	2290.6	2280.4	2288.9	2300.9	2285.5
165°	2314.5	2304.4	2309.4	2321.4	2309.4
167.5°	2333.4	2323.0	2328.3	2340.3	2324.9
170°	2348.8	2338.5	2341.9	2353.9	2338.5
172.5°	2359.0	2348.8	2352.3	2364.2	2348.8
175°	2367.5	2355.5	2359.0	2370.9	2353.9
177.5°	2370.9	2359.0	2360.8	2372.8	2357.3
180°	2362.4	2362.4	2362.4	2362.4	2362.4

TEST NUMBER: P905957

CATALOG NUMBER: DFN2DIP-PN4F0-060D070US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.77	9.60	9.76	10.60	11.92	8.33	9.16	9.32	10.16	11.48
	3H	10.43	11.17	11.43	12.18	13.53	9.94	10.69	10.94	11.70	13.04
	4H	11.02	11.72	12.03	12.73	14.09	10.53	11.23	11.54	12.25	13.60
	6H	11.42	12.06	12.44	13.08	14.45	10.93	11.57	11.95	12.59	13.96
	8H	11.52	12.14	12.55	13.17	14.54	11.03	11.65	12.06	12.68	14.04
	12H	11.57	12.16	12.60	13.18	14.57	11.07	11.66	12.10	12.69	14.07
4H	2H	9.23	9.93	10.24	10.94	12.30	8.87	9.58	9.89	10.59	11.94
	3H	11.09	11.68	12.12	12.72	14.09	10.69	11.28	11.72	12.32	13.68
	4H	11.81	12.34	12.84	13.38	14.77	11.39	11.93	12.42	12.96	14.35
	6H	12.32	12.78	13.37	13.84	15.23	11.90	12.36	12.94	13.42	14.80
	8H	12.47	12.90	13.52	13.95	15.36	12.04	12.48	13.09	13.53	14.93
	12H	12.55	12.94	13.61	14.00	15.41	12.11	12.50	13.17	13.56	14.97
8H	4H	12.00	12.43	13.05	13.48	14.88	11.63	12.06	12.68	13.11	14.51
	6H	12.63	12.99	13.70	14.08	15.48	12.26	12.61	13.33	13.71	15.10
	8H	12.86	13.17	13.93	14.25	15.66	12.47	12.79	13.55	13.86	15.28
	12H	12.99	13.26	14.07	14.34	15.79	12.59	12.86	13.67	13.93	15.39
12H	4H	11.98	12.38	13.05	13.44	14.85	11.62	12.01	12.69	13.08	14.48
	6H	12.66	12.98	13.74	14.05	15.47	12.30	12.61	13.38	13.69	15.11
	8H	12.91	13.18	13.99	14.25	15.71	12.53	12.81	13.62	13.88	15.34