

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905980

Luminaire Tested: DFN2DIP-PN4F0-070D040US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905980
REPORT IS A COMBINATION OF REPORTS P899615 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D040US835-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10470.0 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 97
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFLL

Luminous Intensity Polar Plot

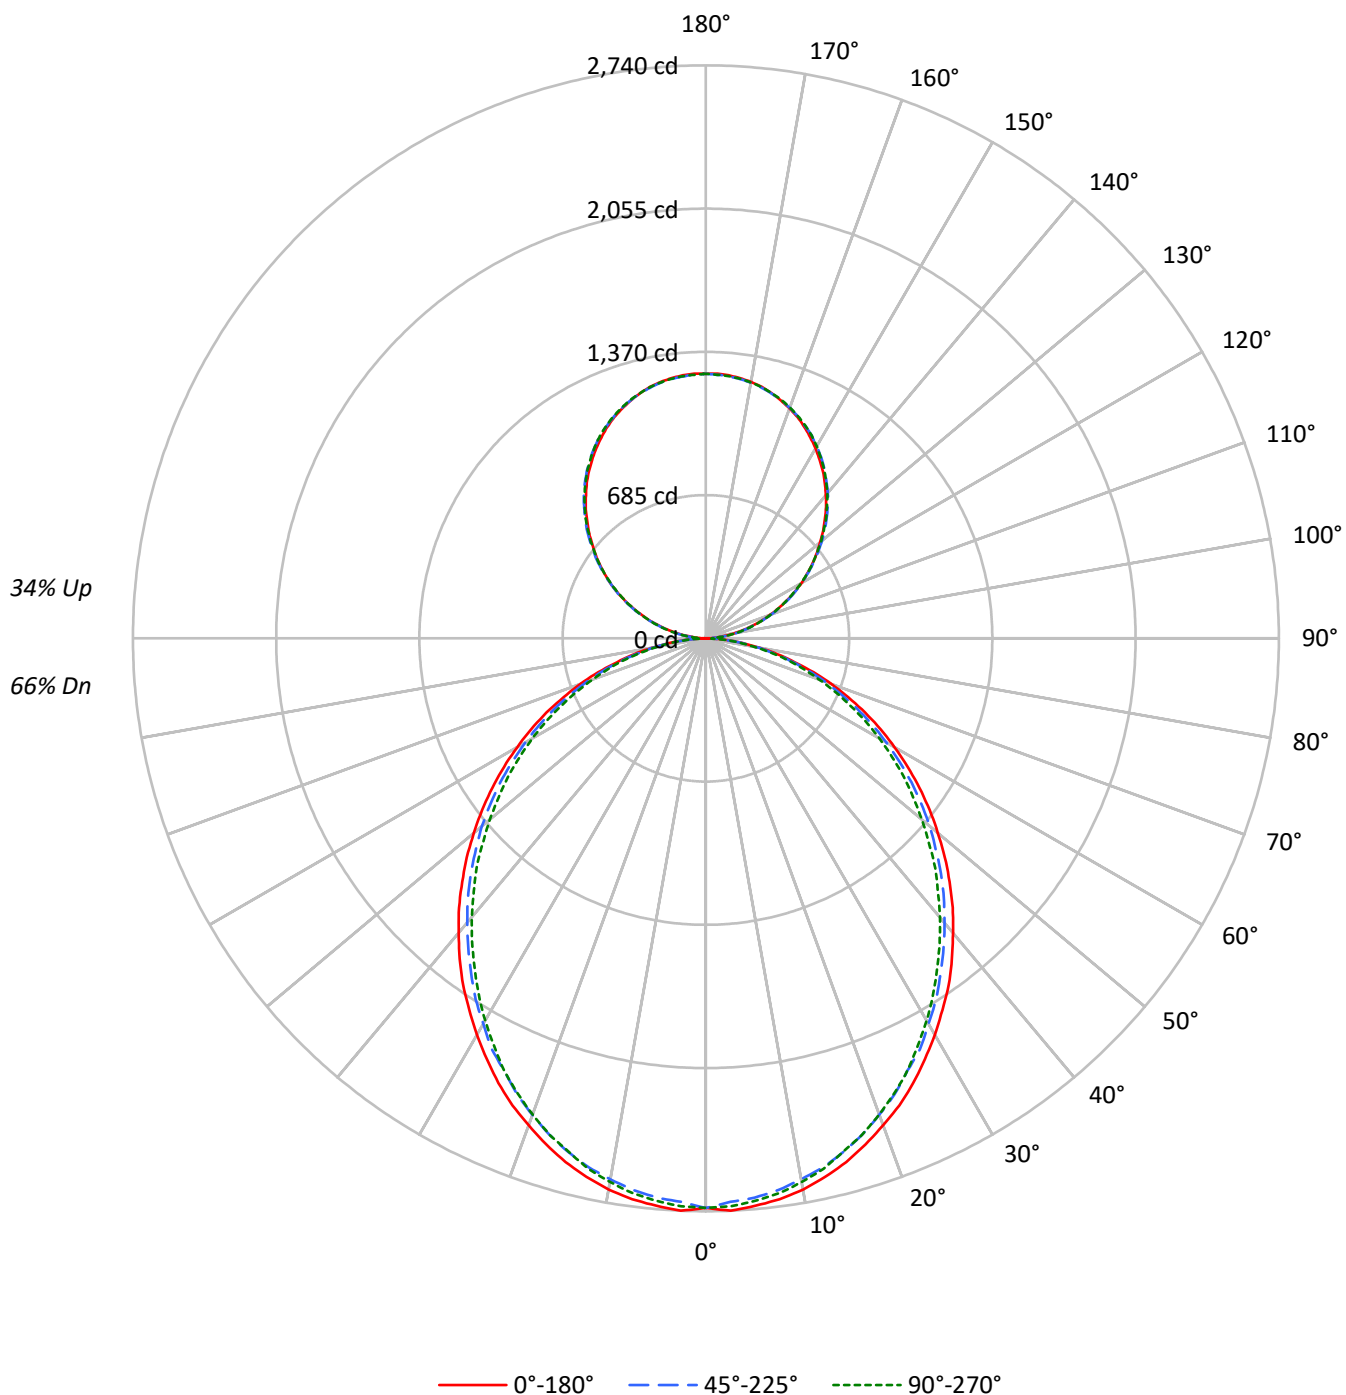

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	72	70	68	63	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	60	57	55	53	51
3	84	75	67	61	79	70	64	58	63	57	53	56	51	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	25
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1988	1988	1988
5°	1991	1961	1974
10°	1975	1935	1948
15°	1946	1903	1906
20°	1907	1859	1864
25°	1868	1806	1815
30°	1819	1757	1752
35°	1773	1700	1686
40°	1716	1641	1623
45°	1659	1583	1559
50°	1596	1521	1484
55°	1531	1450	1416
60°	1458	1366	1338
65°	1377	1279	1245
70°	1275	1172	1146
75°	1133	1045	1055
80°	963	883	879
85°	696	603	588

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1659 cd/sqm

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	2.4
10°-20°	721.3	6.9
20°-30°	1060.0	10.1
30°-40°	1231.1	11.8
40°-50°	1229.6	11.7
50°-60°	1072.2	10.2
60°-70°	792.6	7.6
70°-80°	448.4	4.3
80°-90°	122.0	1.2
90°-100°	78.3	0.7
100°-110°	248.7	2.4
110°-120°	425.6	4.1
120°-130°	559.8	5.3
130°-140°	628.3	6.0
140°-150°	616.2	5.9
150°-160°	516.9	4.9
160°-170°	342.8	3.3
170°-180°	119.8	1.1
0°-30°	2037.7	19.5
0°-40°	3268.8	31.2
0°-60°	5570.6	53.2
0°-90°	6933.6	66.2
90°-120°	752.7	7.2
90°-150°	2556.9	24.4
90°-180°	3536.0	33.8
0°-180°	10470.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	1	14	37	35	36	10
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P905980

CATALOG NUMBER: DFN2DIP-PN4F0-070D040US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.04	12.07	11.85	12.90	13.92	10.60	11.63	11.41	12.46	13.48
	3H	12.72	13.64	13.54	14.48	15.53	12.23	13.16	13.05	13.99	15.04
	4H	13.31	14.19	14.15	15.03	16.09	12.83	13.70	13.66	14.54	15.60
	6H	13.73	14.53	14.57	15.38	16.45	13.23	14.04	14.08	14.89	15.96
	8H	13.84	14.60	14.69	15.47	16.55	13.34	14.11	14.20	14.98	16.05
	12H	13.89	14.62	14.75	15.49	16.59	13.39	14.12	14.25	14.99	16.09
4H	2H	11.52	12.40	12.36	13.24	14.30	11.17	12.05	12.01	12.89	13.95
	3H	13.41	14.14	14.26	15.01	16.09	13.01	13.73	13.86	14.61	15.69
	4H	14.13	14.80	14.99	15.67	16.77	13.71	14.38	14.58	15.25	16.35
	6H	14.66	15.23	15.54	16.13	17.24	14.23	14.81	15.11	15.71	16.81
	8H	14.81	15.35	15.70	16.24	17.36	14.39	14.92	15.27	15.82	16.93
	12H	14.90	15.38	15.80	16.29	17.42	14.46	14.94	15.36	15.85	16.98
8H	4H	14.34	14.88	15.22	15.77	16.89	13.97	14.51	14.85	15.40	16.52
	6H	14.98	15.43	15.89	16.36	17.48	14.61	15.05	15.52	15.99	17.10
	8H	15.21	15.60	16.13	16.53	17.66	14.82	15.22	15.74	16.14	17.28
	12H	15.35	15.70	16.27	16.62	17.80	14.95	15.29	15.87	16.21	17.40
12H	4H	14.34	14.82	15.24	15.73	16.85	13.97	14.46	14.87	15.37	16.49
	6H	15.01	15.41	15.93	16.34	17.47	14.65	15.04	15.57	15.97	17.11
	8H	15.27	15.61	16.19	16.53	17.72	14.89	15.24	15.82	16.16	17.35

END OF REPORT