

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906013

Luminaire Tested: DFN2DIP-PN4F0-070D120US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906013
REPORT IS A COMBINATION OF REPORTS P901279 AND P898053
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-070D120US835-FLLONL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18810.0 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 170.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLLONL

Luminous Intensity Polar Plot

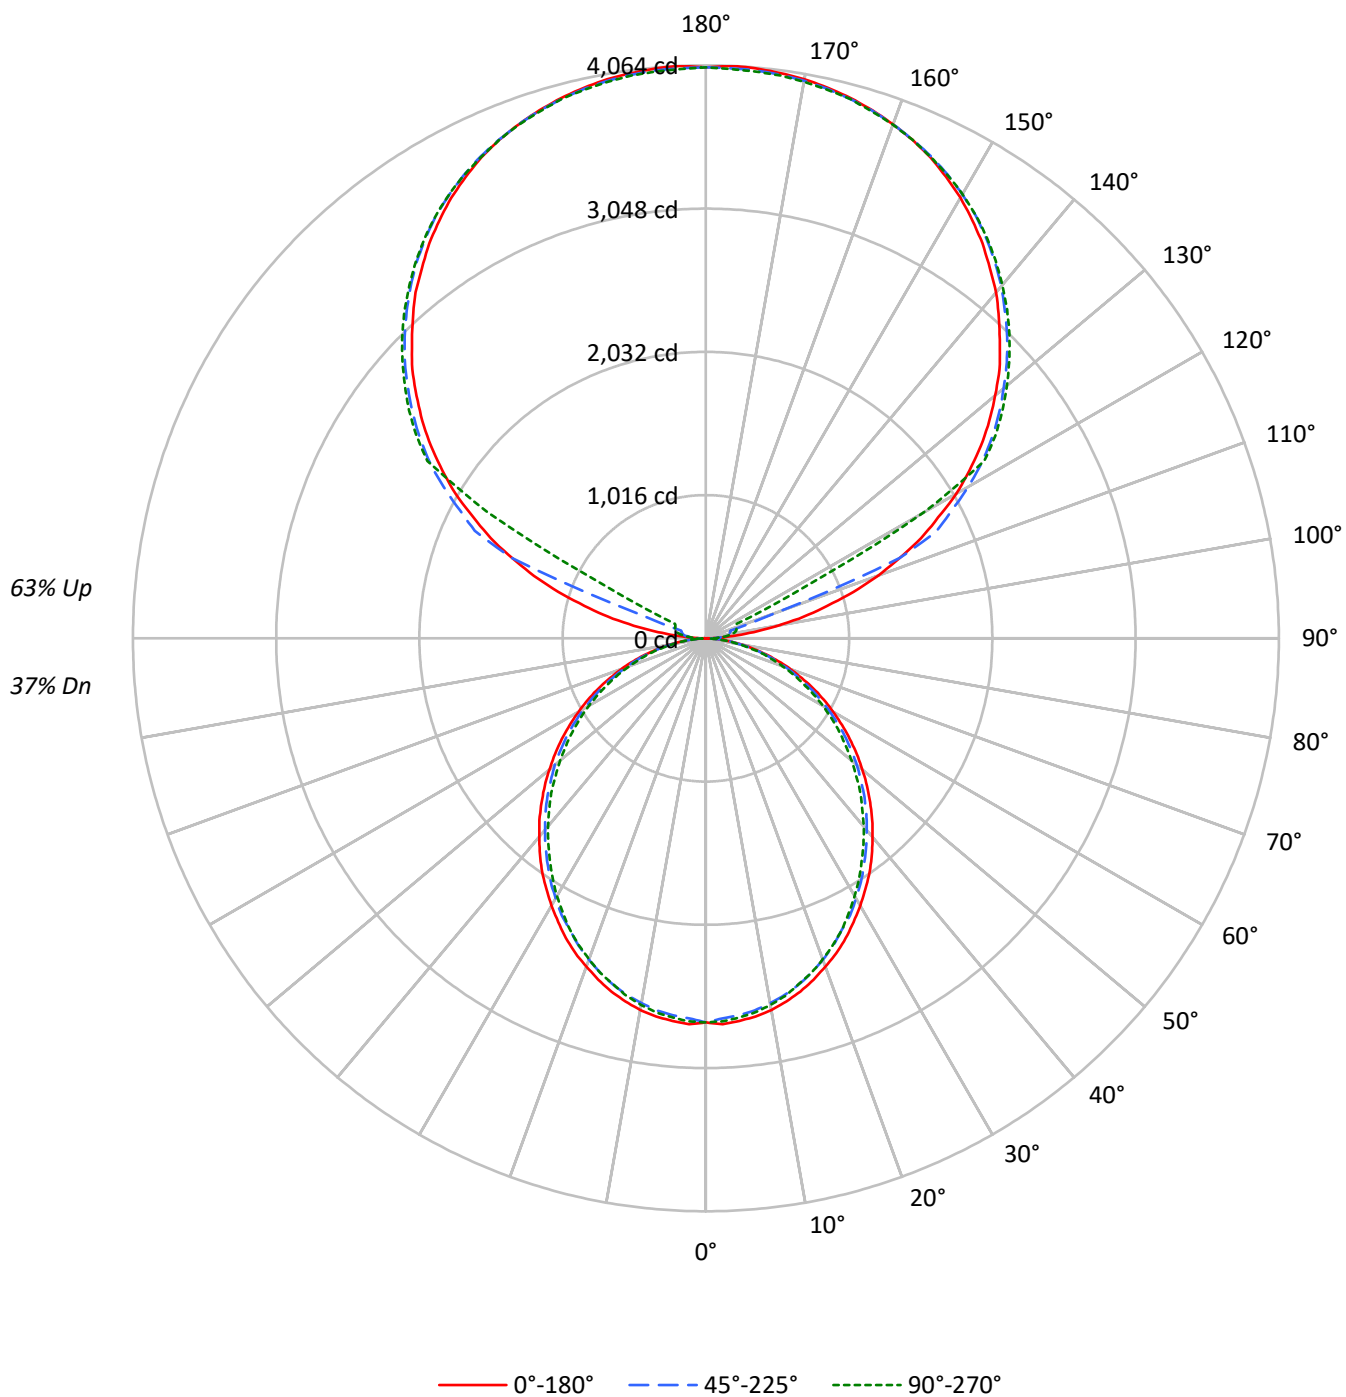

TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	83	86	82	79	76	67	64	62	52	51	49	39	38	37
2	86	79	73	68	78	72	67	62	58	55	52	46	43	41	34	33	31
3	79	69	62	57	71	63	57	52	51	47	43	40	37	35	30	28	27
4	72	61	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	32	29	26	24	22	20
6	61	49	41	35	55	45	38	33	37	31	28	29	25	23	22	20	18
7	56	44	36	31	51	40	33	29	33	28	24	26	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	21	24	20	18	19	16	14
9	48	36	29	24	44	33	27	22	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	25	21	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1988	1988	1988
5°	1991	1961	1974
10°	1975	1935	1948
15°	1946	1903	1906
20°	1907	1859	1864
25°	1868	1806	1815
30°	1819	1757	1752
35°	1773	1700	1686
40°	1716	1641	1623
45°	1659	1583	1559
50°	1596	1521	1484
55°	1531	1450	1416
60°	1458	1366	1338
65°	1377	1279	1245
70°	1275	1172	1146
75°	1133	1045	1055
80°	963	883	879
85°	696	603	588

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2160 cd/sqm

TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	1.4
10°-20°	721.3	3.8
20°-30°	1060.0	5.6
30°-40°	1231.1	6.5
40°-50°	1229.6	6.5
50°-60°	1072.2	5.7
60°-70°	792.6	4.2
70°-80°	448.4	2.4
80°-90°	125.5	0.7
90°-100°	133.5	0.7
100°-110°	497.8	2.6
110°-120°	1320.3	7.0
120°-130°	2189.8	11.6
130°-140°	2326.1	12.4
140°-150°	2161.8	11.5
150°-160°	1738.1	9.2
160°-170°	1119.9	6.0
170°-180°	385.5	2.0
0°-30°	2037.7	10.8
0°-40°	3268.8	17.4
0°-60°	5570.6	29.6
0°-90°	6937.2	36.9
90°-120°	1951.7	10.4
90°-150°	8629.4	45.9
90°-180°	11873.0	63.1
0°-180°	18810.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	3	35	58	73	79	17
95°	190	94	114	129	126	225
105°	891	979	179	211	223	952
115°	1685	1735	1808	451	240	1659
125°	2382	2421	2476	2497	2506	2125
135°	2948	2995	3021	3051	3045	2277
145°	3420	3417	3467	3487	3472	2139
155°	3766	3739	3775	3792	3769	1735
165°	3968	3950	3959	3980	3959	1121
175°	4058	4038	4044	4064	4035	386
180°	4050	4050	4050	4050	4050	

TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	2.8	35.1	58.5	73.4	79.0
92.5°	73.4	61.6	70.3	76.2	79.0
95°	190.3	93.6	114.1	129.1	126.0
97.5°	342.8	102.7	149.3	158.3	161.1
100°	518.8	117.3	167.0	190.3	196.3
102.5°	712.0	706.4	172.9	205.0	214.0
105°	890.8	978.9	178.9	210.9	222.7
107.5°	1098.9	1172.0	184.8	216.8	228.6
110°	1298.3	1359.6	512.9	219.9	231.4



TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1485.9	1538.4	1488.7	225.5	234.5
115°	1684.9	1734.7	1808.1	451.3	240.5
117.5°	1857.9	1916.4	1966.5	1547.1	779.5
120°	2051.4	2095.2	2148.1	2183.3	1787.6
122.5°	2215.3	2262.3	2321.1	2338.5	2341.6
125°	2382.3	2420.6	2476.3	2496.8	2505.5
127.5°	2534.7	2575.8	2620.0	2649.2	2652.0
130°	2678.4	2725.4	2757.4	2789.8	2787.0
132.5°	2824.9	2863.2	2895.2	2921.7	2918.9
135°	2948.1	2995.1	3021.2	3050.8	3044.9
137.5°	3076.9	3112.0	3141.6	3170.8	3162.1
140°	3202.9	3226.5	3258.5	3285.0	3270.4
142.5°	3308.6	3329.2	3367.1	3390.4	3375.8
145°	3420.0	3416.9	3466.6	3487.2	3472.5
147.5°	3516.4	3507.7	3557.5	3572.1	3560.6
150°	3610.3	3589.8	3636.8	3654.2	3639.6
152.5°	3689.3	3666.0	3709.9	3727.6	3707.1
155°	3765.5	3739.4	3774.6	3792.0	3768.7
157.5°	3827.1	3803.8	3830.3	3850.8	3827.1
160°	3880.0	3862.3	3880.0	3897.4	3876.9
162.5°	3926.7	3909.3	3923.9	3944.4	3918.0
165°	3967.7	3950.3	3959.0	3979.6	3959.0
167.5°	4000.1	3982.3	3991.4	4011.9	3985.5
170°	4026.5	4008.8	4014.7	4035.2	4008.8
172.5°	4043.9	4026.5	4032.5	4053.0	4026.5
175°	4058.5	4038.0	4043.9	4064.5	4035.2
177.5°	4064.5	4043.9	4047.1	4067.6	4041.2
180°	4049.9	4049.9	4049.9	4049.9	4049.9

TEST NUMBER: P906013

CATALOG NUMBER: DFN2DIP-PN4F0-070D120US835-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.32	9.07	9.38	10.13	11.58	7.88	8.63	8.94	9.69	11.14
	3H	9.97	10.65	11.04	11.72	13.19	9.49	10.16	10.56	11.24	12.70
	4H	10.56	11.20	11.64	12.27	13.74	10.07	10.71	11.15	11.78	13.26
	6H	10.95	11.54	12.04	12.62	14.10	10.46	11.05	11.55	12.13	13.61
	8H	11.05	11.62	12.15	12.71	14.19	10.56	11.12	11.66	12.22	13.70
	12H	11.10	11.63	12.20	12.72	14.22	10.60	11.13	11.70	12.22	13.72
4H	2H	8.76	9.41	9.85	10.48	11.95	8.41	9.05	9.50	10.13	11.60
	3H	10.62	11.16	11.72	12.26	13.75	10.22	10.76	11.32	11.86	13.34
	4H	11.34	11.83	12.44	12.92	14.42	10.92	11.41	12.02	12.50	14.01
	6H	11.85	12.27	12.96	13.38	14.88	11.42	11.84	12.53	12.96	14.46
	8H	12.00	12.39	13.11	13.50	15.01	11.57	11.96	12.68	13.07	14.58
	12H	12.07	12.42	13.19	13.54	15.06	11.63	11.98	12.75	13.10	14.62
8H	4H	11.52	11.92	12.63	13.03	14.54	11.15	11.55	12.26	12.65	14.17
	6H	12.15	12.48	13.29	13.63	15.14	11.78	12.10	12.91	13.25	14.76
	8H	12.38	12.66	13.51	13.79	15.32	11.99	12.28	13.13	13.41	14.94
	12H	12.50	12.75	13.65	13.88	15.45	12.10	12.35	13.24	13.48	15.05
12H	4H	11.50	11.86	12.63	12.98	14.50	11.14	11.50	12.27	12.62	14.14
	6H	12.18	12.47	13.32	13.60	15.13	11.82	12.10	12.96	13.23	14.76
	8H	12.42	12.67	13.56	13.80	15.37	12.05	12.30	13.19	13.43	14.99

END OF REPORT